

**nupigeco**

# PPR PIPING SYSTEM





# INDEX

## 1 PPR PIPING SYSTEM

PPR PIPING SYSTEM .....	14
WATER RECYCLING SYSTEMS.....	26
PPR AND FIBER GLASS.....	28
OXYGEN BARRIER .....	38
UV RAY PROTECTION .....	42
TECHNOPOLYMER BARRIER.....	44

## 2 TECHNICAL CHARACTERISTICS PRODUCT AND PRODUCTION PROCESS

2.1      BENEFITS	
2.1.1 POLYPROPYLENE .....	51
2.1.2 PROPERTIES OF THE MATERIAL.....	53
2.1.3 CHEMICAL AND THERMAL DISINFECTION .....	54
2.1.4 CERTIFIED QUALITY.....	55
2.1.5 CONTROL SYSTEM .....	56
2.1.6 QUALITY ASSURANCE.....	57

## 3 JOINING PROCEDURES

3.1      WELDING EQUIPMENT .....	70
3.2      POLYFUSION WELDING .....	73
3.2.1      WARNINGS AND PRELIMINARY RECOMMENDATIONS .....	73
3.2.2      POLYFUSION WELDING: FITTINGS.....	74
3.2.3      POLYFUSION WELDING: WELDING SADDLES .....	77
3.2.4      DIMENSIONAL TABLE FOR WELDING SADDLES.....	79
3.2.5      POLYFUSION WELDING: REPAIR OF A DAMAGED PIPE.....	80
3.3      ELECTROFUSION WELDING.....	82
3.3.1      INSTRUCTIONS FOR THE WHITE BLUE AND DARK SYSTEMS .....	86
3.4      BUTT FUSION WELDING .....	87
3.4.1      INTRODUCTION.....	87
3.4.2      RECOMMENDATIONS AND WARNINGS.....	87
3.4.3      BUTT FUSION WELDING PROCEDURE.....	88

**CATALOGUE:** PPR/2014  
**REVISION:** 01  
**VALID FROM:** 1st June 2014  
**FILE NAME:** NUPIGECO PPR Piping System\_en

# INDEX

## 4 TECHNICAL DATA

4.1	CHEMICAL, PHYSICAL AND MECHANICAL PROPERTIES OF PPR .....	96
4.2	THE PIPE .....	97
4.3	THERMAL EXPANSION .....	98
4.3.1	INSTALLATIONS WHERE THERMAL EXPANSION IS ALLOWED (UNI EN 806-4) .....	102
4.3.2	INSTALLATION OF PIPES NOT ALLOWING EXPANSION .....	108
4.4	HEAT LOSS .....	111
4.5	ANTI-CONDENSATION INSULATION IN AIR CONDITIONING SYSTEMS .....	112
4.5.1	MINIMUM INSULATION THICKNESS RECOMMENDED FOR PPR PIPES .....	114
4.6	HEAD LOSS .....	115
4.7	FITTING HEAD LOSS (DIN 1988) .....	119
4.8	SYSTEM DIMENSIONING (UNI9182) .....	120
4.8.1	HOW TO USE LOAD UNITS .....	120
4.9	HOT SANITARY WATER SUPPLY .....	126
4.10	SYSTEM TESTING .....	130
4.11	CHEMICAL COMPATIBILITY OF PPR .....	131
4.11.1	CHEMICAL COMPATIBILITY OF PLASTICS AND METALS .....	135

## 5 PRODUCT CATALOGUE

5.1	POLYPROPYLENE PIPES .....	144
5.1.1	NIRON PIPE FOR PLUMBING & HYDRONIC APPLICATIONS .....	144
5.1.2	NIRON-POLYSYSTEM PIPE FOR PLUMBING & HYDRONIC APPLICATIONS .....	152
5.1.3	NIRON RAIN WATER PIPE .....	155
5.1.4	NIRON PREINSULATED PIPE .....	156
5.1.5	NIRON OXYGEN BARRIER PIPE .....	159
5.1.6	NIRON UV RAY PROTECTION PIPE .....	162
5.1.7	NIRON CHEMICAL RESISTANCE PIPE .....	166
5.2	POLYFUSION & ELECTROFUSION FITTINGS .....	168
5.2.1	POLYFUSION FITTINGS .....	168
5.2.2	VALVES .....	201
5.2.3	SPECIAL FITTINGS .....	209
5.2.4	ELECTROFUSION FITTINGS .....	220
5.3	PPR COMPRESSION FITTINGS .....	224
5.4	PVDF COMPRESSION FITTINGS .....	228
5.5	PREINSULATED FITTINGS .....	232
5.6	EQUIPMENT .....	257



# THE COMPANY



Registered Office and Headquarters - Busto Arsizio (VA)



Production Facility - Castel Guelfo di Bologna (BO)



Production Facility - Imola (BO)

On October 1st 2008, two of our companies, **NUPI S.p.A.** and **GECO System S.p.A.** - both founded more than 40 years ago - merged to become **NUPIGECO S.p.A.** Combining their many years of experience and constant growth, the two firms decided to create a new flexible and advanced company, ready to play its role to satisfy the demands of the market whilst being environmentally astute.

**NUPIGECO S.p.A.** develops and produces pipe and fitting systems for the plumbing, heating, water pipelines, gas and irrigation fields. **Nupi Industrial Division (NUPI ID)**, which was founded in 1995, is dedicated to the production of the highest quality multilayer pipes specifically designed for the petroleum, oil, chemical and petrochemical markets.

Today, **NUPIGECO S.p.A.** offers a complete range of pipes and fittings, produced using the most modern thermoplastic materials and manufacturing processes. These product ranges are known worldwide by the following trademarks: **NIRON, MULTINUPI, MULTIGECO, ELOFIT, ELOTHERM, ELOPRESS, POLYSYSTEM, POLIETILENE TUBI, SMARTFLEX, OILTECH, SMARTLPG, ELOSMART, SMARTCONDUIT, ELAMID, RACCORDI PVC, ECOWAVE** and the **ELOSFERA** range dedicated to alternative energies: **NRGEO** and **ELOSOLAR**.

These systems are known as real problem solving systems capable of supplying every kind of installation while reducing costs, avoiding wastes and increasing productivity. Thanks to their quality, these products positively fulfil the most stringent field tests and obtained the most prestigious certifications, conforming to legislation from around the globe for water, gas networks and for the conveyance of fuels.

Producing better quality and being cost effective is the goal, which is made easier every day by new technology. **NUPIGECO S.p.A.** is continuously investing in research and development programs, while strengthening the production systems, operated by a sophisticated technology that guarantees the highest quality of its products. **NUPIGECO's** market leadership enforces its role in extremely competitive and highly technological fields such as thermo transformation of plastics and polymers.

# THE COMPANY APPROVALS

Customers can rely on the best quality materials and precise manufacture, obtained through completely automated production systems, and continuous on time deliveries that perfectly integrate the business functions in real time. Customer satisfaction is pursued through high quality products and the constant attention to the customers' needs and requirements, and by means of an effective team of people in **post-sales service**, effective and precise **technical assistance** and the **training** of installers.

**NUPIGECO S.p.A.** headquarters and production centre are located in Busto Arsizio near Milan, Italy, while the production and operation centres of Castel Guelfo and Imola are situated in strategic industrial areas near Bologna.

**NUPIGECO S.p.A.** is present all over the world, with manufacturing facilities, affiliated companies and warehouses in **Germany, France, Spain, Belgium, UK, China, Brazil, U.S.A. and UAE**.



UNI EN ISO 9001



UNI EN ISO 14001



OHSAS 18001



Industrial avant-garde  
in the transport of  
liquid and gaseous fluids  
using systems made  
of plastic material



Sanitary systems  
Heating systems  
Water networks  
Gas pipelines  
Irrigation  
Transport of food fluids  
Conditioning  
Cooling  
Industrial installations  
Petroleum industry  
Chemical industry  
Petrochemical industry

## Our numbers

- Presence in the market for more than 40 years
- 22 product lines
- 300 employees
- 3 production plants in Italy
- 3 production plants worldwide (U.S.A., Brazil, China)
- 26 extrusion lines in Italy, 4 lines in the U.S.A., 3 lines in China and 2 lines in Brazil
- 40 injection molding machines for the production of fittings
- 9 warehouses in Europe and the rest of the world (Germany, France, Spain, Belgium, UK, U.S.A., Brazil, China, UAE)
- 10% of turnover invested in R & D
- 150,000 square meters of surface area occupied by NUPIGECO in the world

## Our strengths

- Exports established in more than 70 countries in 5 continents
- Worldwide after-sales assistance
- R & D department dedicated to Internal Development, Technical Support, After-Sales Service
- Production of pipes and fittings from ø12 to ø1000
- Training center for each authorized distributor

# PPR PIPING SYSTEM



1

PPR PIPING SYSTEM

# PPR PIPING SYSTEM



## PPR PIPING SISTEM

PPR PIPING SYSTEMS allow the creation of mechanical installations suitable for carrying liquids under pressure.

It is too simple to consider PPR just as a carrier of sanitary fluids such as drinking water, heating, water supply and sewage, as new coextrusion technologies allow to produce pipes that can be used in particularly difficult conditions in terms of:

- 1) **chemical attack from transported fluids** - cooling towers or new generation biocide agents with a high percentage of chlorine;
- 2) **high operating pressures;**
- 3) **high volumetric flow rates** required for the air-conditioning of large buildings.

Consider the evolution of raw materials (classified degrees MRS 8, MRS 10 and MRS 12,5) and the techniques of thickness coextrusion that can increase the useful life of pipelines, from simple 3-layer pipes with fiber glass inner layer at different percentages

that minimizes the thermal expansion caused by the transport of fluid at high temperatures, to the most complex multilayer pipelines designed to increase the resistance to degradation caused by UV rays and/or strong oxidizing chemical agents ( $\text{Cl}_2$ ,  $\text{ClO}_2$ , ozone etc.).



CHARACTERISTICS	RANGE NAME	PIPE STRUCTURE	PRODUCT IDENTIFICATION COLOUR	DESCRIPTION	SDR	S	OD RANGE
PLUMBING & HYDRONIC INSTALLATIONS	NIRON	FULL	BLUE	PPR PIPE	6	2,5	16 and 40 ÷ 125
	NIRON	FULL	BLUE	PPR PIPE	7,4	3,2	25 ÷ 250
	NIRON	FULL	BLUE	PPR PIPE	11	5	32 ÷ 630
	NIRON	FULL	BLUE	PP-RP PIPE	9	4	32 ÷ 400
	NIRON	FG	BLUE	PPR FIBER GLASS PIPE	7,4	3,2	20 ÷ 400
	NIRON	FIBER	BLUE	PP-RP FIBER GLASS PIPE	9	4	32 ÷ 400
	NIRON	CLIMA 11	BLUE	PPR FIBER GLASS PIPE	11	5	32 ÷ 400
	NIRON	FIBER	BLUE	PP-RP FIBER GLASS PIPE	17	8	160 ÷ 400
PLUMBING & HYDRONIC INSTALLATIONS	NIRON POLYSYSTEM	FULL	GREEN	PPR PIPE	6	2,5	16 ÷ 125
	NIRON POLYSYSTEM	FULL	GREEN	PPR PIPE	7,4	3,2	25 ÷ 250
	NIRON POLYSYSTEM	FG	GREEN	PPR FIBER GLASS PIPE	7,4	3,2	20 ÷ 400
RAIN WATER	NIRON	FULL	PURPLE	PPR PIPE	7,4	3,2	20 ÷ 25
	NIRON	FULL	PURPLE	PPR PIPE	11	5	32 ÷ 160
PRE-INSULATION (*)	NIRON	FG	CARBON BLACK	PREINSULATED PPR FIBER GLASS PIPE	7,4	3,2	32 ÷ 315
PRE-INSULATION (*)	NIRON	CLIMA	CARBON BLACK	PREINSULATED PPR FIBER GLASS PIPE	11	5	32 ÷ 315
PRE-INSULATION (*)	NIRON	OB - FG	CARBON BLACK	PREINSULATED OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
OXYGEN BARRIER (*)	NIRON	OB - FG	WHITE BLUE	OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
OXYGEN BARRIER (*)	NIRON	OB - CLIMA	WHITE BLUE	OXYGEN BARRIER PPR PIPE	11	5	32, 40, 50, 63, 90, 110
OXYGEN BARRIER (*)	NIRON	OB - FULL	WHITE BLUE	OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
UV RAY PROTECTION (*)	NIRON	FG	DARK	PPR FIBER GLASS PIPE UV RAY BARRIER	7,4	3,2	20 ÷ 400
UV RAY PROTECTION (*)	NIRON	FIBER	DARK	PP-RP FIBER GLASS PIPE UV RAY BARRIER	9	4	32 ÷ 400
UV RAY PROTECTION (*)	NIRON	CLIMA 11	DARK	PPR FIBER GLASS PIPE UV RAY BARRIER	11	5	32 ÷ 400
UV RAY PROTECTION (*)	NIRON	FIBER	DARK	PP-RP FIBER GLASS PIPE UV RAY BARRIER	17	8	160 ÷ 400
CHEMICAL RESISTANCE (*)	NIRON	MULTILAYER	BLUE	PPR PIPE FOR POTABLE WATER CHEMICAL BARRIER	7,4	3,2	32 ÷ 110
CHEMICAL RESISTANCE (*)	NIRON	MULTILAYER	BLUE	PPR PIPE FOR NON-POTABLE WATER CHEMICAL BARRIER	7,4	3,2	32 ÷ 110

	HVACR							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry

(\*) upon request - key on page 12

Available in stock until diameter 250mm. Delivery timing for bigger diameters to be agreed when ordering.

# PPR PIPING SYSTEM

MONOLAYER PIPE									
OD In	mm	SDR 6 - S 2,5					SDR 7,4 - S 3,2		
		Th	ID	kg/m	liter/m	Th	ID	kg/m	liter/m
	16	2,7	10,60	0,11	0,09				
1/2"	20	3,4	13,20	0,17	0,14				
3/4"	25	4,2	16,60	0,26	0,22	3,5	18,00	0,23	0,25
1"	32	5,4	21,20	0,43	0,35	4,4	23,20	0,37	0,42
1 1/4"	40	6,7	26,60	0,66	0,56	5,5	29,00	0,57	0,66
1 1/2"	50	8,4	33,20	1,03	0,87	6,9	36,20	0,88	1,03
2"	63	10,5	42,00	1,62	1,38	8,7	45,60	1,39	1,63
2 1/2"	75	12,5	50,00	2,29	1,96	10,4	54,20	1,98	2,31
3"	90	15,0	60,00	3,30	2,83	12,5	65,00	2,83	3,32
4"	110	18,4	73,20	4,92	4,21	15,2	79,60	4,25	4,97
	125	20,8	83,40	6,30	5,46	17,1	90,80	5,41	6,47
6"	160					21,9	116,20	8,79	10,60
8"	200					27,4	145,20	13,70	16,55
	250					34,2	181,60	21,25	25,89
10"	315								
	355								
16"	400								
	450								
20"	500								
	560								
24"	630								

MONOLAYER PIPE									
OD In	mm	SDR 11 - S 5					SDR 9 - S 4		
		Th	ID	kg/m	liter/m	Th	ID	kg/m	liter/m
	16								
1/2"	20								
3/4"	25								
1"	32	2,9	26,20	0,26	0,54	3,6	24,80	0,31	0,48
1 1/4"	40	3,7	32,60	0,40	0,83	4,5	31,00	0,48	0,75
1 1/2"	50	4,6	40,80	0,63	1,31	5,6	38,80	0,74	1,18
2"	63	5,8	51,40	0,99	2,07	7,1	48,80	1,17	1,87
2 1/2"	75	6,8	61,40	1,37	2,96	8,4	58,20	1,65	2,66
3"	90	8,2	73,60	1,99	4,25	10,1	69,80	2,38	3,82
4"	110	10,0	90,00	2,96	6,36	12,3	85,40	3,54	5,73
	125	11,4	102,20	3,84	8,20	14,0	97,00	4,58	7,39
6"	160	14,6	130,80	6,22	13,43	17,9	124,20	7,46	12,11
8"	200	18,2	163,60	9,76	21,01	22,4	155,20	11,57	18,91
	250	22,7	204,60	15,00	32,86	27,9	194,20	17,96	29,61
10"	315	28,6	257,80	23,70	52,17	35,2	244,60	28,36	46,97
	355	32,2	290,60	30,00	66,29	39,7	275,60	35,95	59,62
16"	400	36,3	327,40	38,20	84,14	44,7	310,60	45,50	75,73
	450	40,9	368,20	48,10	106,42				
20"	500	45,4	409,20	59,10	131,44				
	560	50,8	458,40	74,00	164,95				
24"	630	57,2	515,60	93,50	208,69				

VALUES AS PER STANDARDS	DIN 8077	ISO 15874
	ISO 4065	
OD	Outside Diameter	
Th	Thickness	
ID	Inside Diameter	
kg/m	Kilogram per meter	
liter/m	Liters per meter	
SDR	Standard Dimension Ratio	
S	Series (SDR-1)/2	

VALUES AS PER STANDARDS	DIN 8077	ISO 15874	FIBER GLASS COEXTRUDED PIPE										
	ISO 4065		SDR 7,4 - S 3,2				SDR 9 - S 4						
OD	In	mm	Th	ID	kg/m	liter/m	Th	ID	kg/m	liter/m			
Outside Diameter	1/2"	20	2,8	14,40	0,16	0,16							
Thickness	3/4"	25	3,5	18,00	0,24	0,25							
Inside Diameter	1"	32	4,4	23,20	0,39	0,42	3,6	24,80	0,33	0,48			
Kilogram per meter	1 1/4"	40	5,5	29,00	0,59	0,66	4,5	31,00	0,51	0,75			
Liters per meter	1 1/2"	50	6,9	36,20	0,91	1,03	5,6	38,80	0,78	1,03			
Standard Dimension Ratio	2"	63	8,6	45,80	1,45	1,63	7,1	48,80	1,24	1,87			
Series (SDR-1)/2	2 1/2"	75	10,3	54,40	2,06	2,31	8,4	58,20	1,74	2,66			
	3"	90	12,3	65,40	2,94	3,32	10,1	69,80	2,51	3,82			
	4"	110	15,1	79,80	4,36	4,97	12,3	85,40	3,73	5,73			
		125	17,1	90,80	5,61	6,47	14,0	97,00	4,82	7,39			
		6"	160	21,9	116,20	9,09	10,60	17,9	124,20	7,83	12,11		
		8"	200	27,4	145,20	14,23	16,55	22,4	155,20	12,00	18,91		
			250	34,2	181,60	22,80	25,89	27,9	194,20	18,70	29,61		
			10"	315	43,1	229,80	34,89	39,39	35,2	244,60	29,50	46,97	
				355	48,5	259,00	44,16	51,45	39,7	275,60	37,40	59,62	
				16"	400	54,7	290,60	56,00	65,38	44,7	310,60	47,30	75,73
					450								
					20"	500							
						560							
						24"	630						

OD	SDR 11 - S 5						SDR 17 - S 8			
	In	mm	Th	ID	kg/m	liter/m	Th	ID	kg/m	liter/m
1"	32	2,9	26,20	0,28	0,54					
1 1/4"	40	3,7	32,60	0,43	0,83					
1 1/2"	50	4,6	40,80	0,67	1,31					
2"	63	5,8	51,40	1,04	2,07					
2 1/2"	75	6,8	61,40	1,44	2,96					
3"	90	8,2	73,60	2,08	4,25					
4"	110	10,0	90,00	3,10	6,36					
	125	11,4	102,20	4,02	8,20					
6"	160	14,6	130,80	6,50	13,43	9,5	141,00	4,65	15,61	
8"	200	18,2	163,60	10,09	21,01	11,9	176,20	6,90	24,37	
	250	22,7	204,60	15,01	32,86	14,8	220,40	10,68	38,13	
10"	315	28,6	257,80	24,67	52,17	18,7	277,60	16,91	60,49	
	355	32,2	290,60	31,20	66,29	21,1	312,80	21,39	76,81	
16"	400	36,3	327,40	39,51	84,14	23,7	352,60	27,03	97,60	
	450									
20"	500									
	560									
	24"	630								

# NIRON®

BLUE PPR PIPE

Polysystem

# NIRON®

GREEN PPR PIPE

# PPR PIPING SYSTEM

## PPR PIPING SYSTEM

It is the **Polypropylene Random Copolymer (PP-R)** pipe and fitting system produced by **NUPIGECO**

The system meets the requirements of a wide range of applications thanks to its different product ranges which are distinguished by the composition of the raw materials used and are easy to identify thanks to the **COLOUR** that characterizes each product range.

**PPR PIPING SYSTEM** by **NUPIGECO** allows the transport of hot, cold, sanitary, industrial, chemical and farming fluids under pressure. It is suitable for different types of installations such as risers, connections to sanitary ware, piping for chilled water for fan convectors, connections between thermal generators and distribution manifolds, cooling towers.

**PPR PIPING SYSTEM** by **NUPIGECO** can be used in several installations such as houses, large apartment buildings, hotels, hospitals, shopping malls, churches, schools, gyms, cruise and cargo ships.

Produced since 1982, **PPR PIPING SYSTEM** by **NUPIGECO** boasts more than **300,000 km** of pipes and respective fittings **installed in 5 continents** leaving installers and final users completely satisfied.





	HVACR							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry
●	●	●	●		●	●	●	●

● Not at all satisfactory

●● Unsatisfactory

●●● Rather satisfactory

●●●● Very satisfactory

●●●●● Extremely satisfactory

CHARACTERISTICS	STEEL	COPPER	PPR PIPING SYSTEM BY NUPIGECO
Corrosion resistance	●●●●	●●●●	●●●
Available sizes	●●	●●	●●●●●
Types of junction	●●●	●●●	●●●●
Efficiency of the junction	●●●●	●●●●	●●●●●
Installation time	●●●	●●●	●●●●●
Anti-condensation insulation thickness	●●●	●●●	●●●●
Impact strength	●●●●	●●●	●●●●●
Crack propagation	●●●●	●●●	●●●
Chemical resistance	●●●●●	●●●●	●●●●
Hygiene & potability	●●	●●	●●●●●
Durability	●●●●	●●●●	●●●●
Eco friendly	●	●	●●●●●
Installation costs	●●	●●●	●●●●●
Surface smoothness and head loss	●●●	●●●	●●●●
Available sizes	●●●	●●●	●●●●
Suitability in cold areas	●●●●	●●●●	●●●●

N.B. For more information, see the chemical compatibility table at the end of the catalogue

### Mechanical properties

#### PPR

Parameter	UM	Requirements	Test parameters	Test method
Internal pressure resistance	h	> 1	T=20C =16MPa	EN ISO 1167
Internal pressure resistance	h	> 22	T=95C =4,3MPa	EN ISO 1167
Internal pressure resistance	h	> 165	T=95C =3,8MPa	EN ISO 1167
Internal pressure resistance	h	> 1000	T=95C =3,6MPa	EN ISO 1167

#### PP-RP

Parameter	UM	Requirements	Test parameters	Test method
Internal pressure resistance	h	> 1	T=20C =15MPa	EN ISO 1167
Internal pressure resistance	h	> 22	T=95C = 4,2MPa	EN ISO 1167
Internal pressure resistance	h	> 165	T=95C = 4,0MPa	EN ISO 1167
Internal pressure resistance	h	> 1000	T=95C = 3,8MPa	EN ISO 1167

### Physical properties

#### PPR and PP-RP

Parameter	UM	Requirements	Test parameters	Test method
Heat shrink	%	<2	T= 135C e8 mm --> t = 1 h 8<e16 mm --> t = 2 h e>16 mm --> t = 4 h	EN743 Method B
Resistance to impact	%	no break	T= 0C	ISO/DIS 9854
MFI	%	30, max difference between pipe and MP	T= 230C m= 2,16 Kg	ISO 1133 CONDITION 12 / UNI5640/74

#### PPR

Parameter	UM	Requirements	Test parameters	Test method
Thermal stability through pressure tests	h	>8760	=1,9 Mpa -T=110C	EN ISO 1167

#### PP-RP

Parameter	UM	Requirements	Test parameters	Test method
Thermal stability through pressure tests	h	>8760	=2,3 Mpa T=110C	EN ISO 1167



---

#### Physical properties of the raw material

---

#### PPR and PP-RP

	UM	Requirements	Test parameters	Test method
Modulus of elasticity	MPa	850-900	1 mm/min	ISO 527-2
MFI	g/10'	0,2-0,3	T= 230C - m= 2,16 Kg	ISO 1133 COND. 12; UNI5640/74
MFI	g/10'	0,4-0,5	T= 230C - m=5,0 Kg	ISO 1133 COND. 18; UNI5640/74

## TECHNOLOGY AND APPLICATIONS

	Monolayer pipe	Fiber glass	Preinsulated	Oxygen barrier	UV barrier	Chemical barrier
Drinking water						
Heating systems						
Heating/cooling systems						
Radiant systems						
Industrial cooling						
Industrial heating						
Chilled water technology						
Cooling towers						
Agriculture						
Swimming pools						
Chemical fluid conveyance						
Transport of chlorine						
Rainwater and recycled water						
Irrigation						
Ship building						
District heating pipeline systems						
Compressed air systems						
Geothermal systems						

The system is suitable for this application

## HOW TO READ THE TABLE

The table shows which technology to use, depending on the applications. Once you select the box that represents the APPLICATION, you can find the TECHNOLOGY to be used following the line corresponding to the selected box.

The choice can sometimes be multiple, as more than one product can satisfy the requirements of the same application. The solutions proposed by NUPIGE-CO meet the pressure values and the characteristics of the liquid to be transported, allowing the installation of major projects (airports, shopping malls, air conditioning systems) and the most common household plumbing installations.



# PPR PIPING SYSTEM



## Drinking water distribution networks

The system allows the transport of hot and cold drinking water.




## Systems for central thermal regulation

Installations in large civil and industrial buildings for commercial or residential use that require the vertical distribution of piping for the transport of the fluid.



## Air handling units and rooftop units

Systems designed to ensure the perfect installation of connections between large climatic rooms and main manifolds for the distribution of chilled fluids.

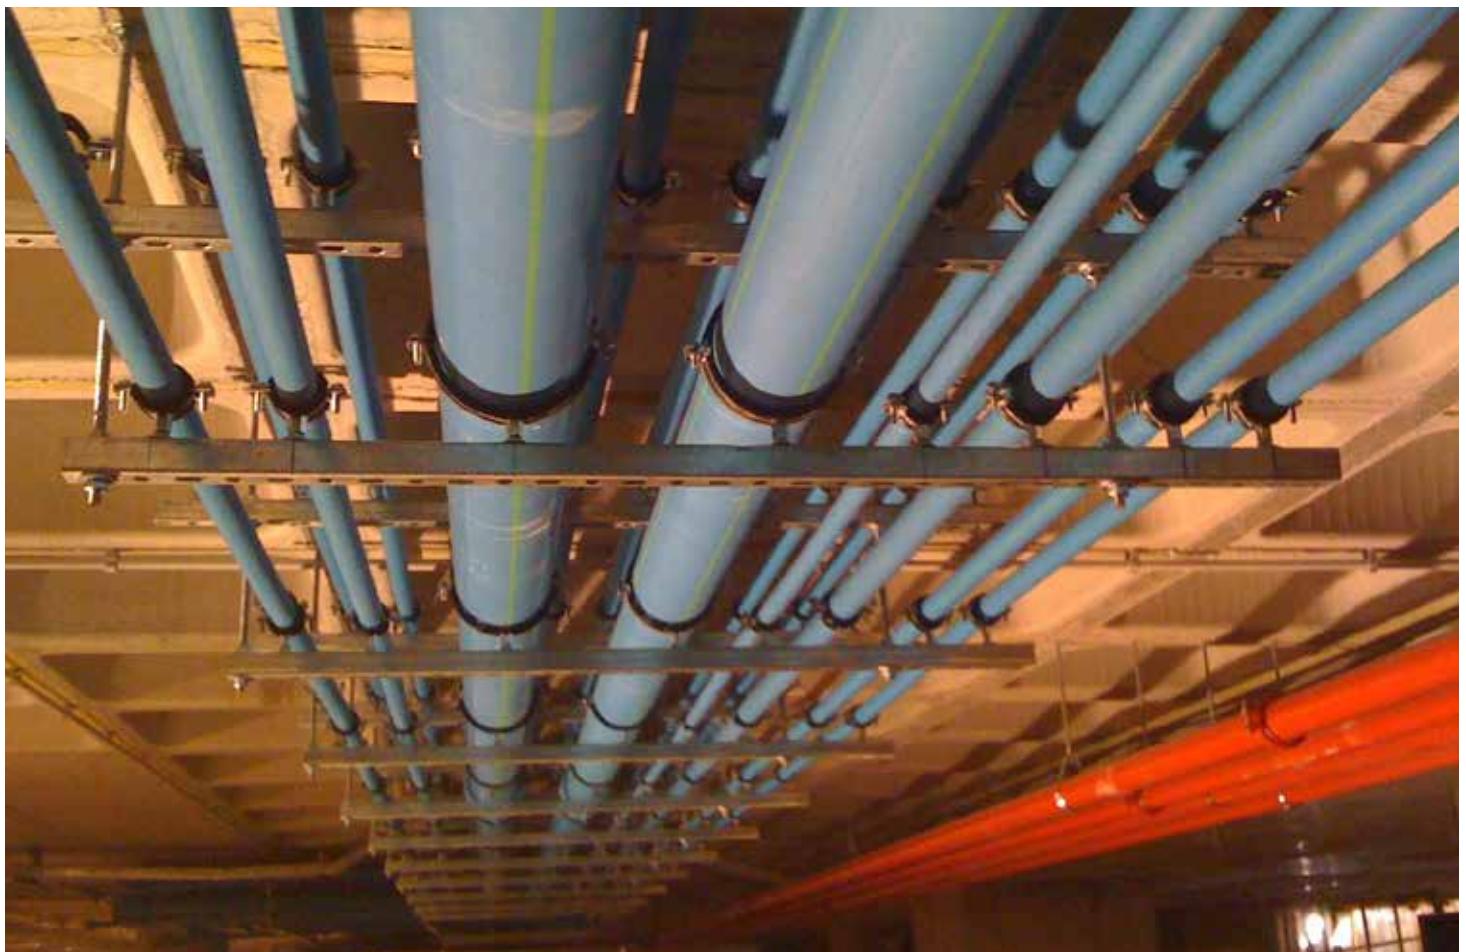

Chilled water is used to cool the air in a building and the equipment for refrigeration units, especially when many individual rooms must be separately controlled (e.g. a hotel).

Chilled water is produced by an individual unit sized according to the dimensions of the room to serve. The advantage provided by the size of the refrigeration unit is based on the principles of the economy of scale.

As a consequence, the greater the size of the refrigeration unit, the lower its power consumption. According to these considerations, it is necessary to rely on a PPR pipe and fitting system that can fulfil saving requirements in terms of piping insulation, heat transmission, installation times and head loss.

Thanks to the **PPR PIPING SYSTEM** by **NUPIGECO**, commercial buildings can lower installation costs by up to 20%.



VERSATILE HORIZONTAL AND VERTICAL INSTALLATIONS




## RISERS

Hot and cold water distribution networks made with vertical risers in the following configurations:

- water distribution from public water pipelines to apartment blocks;
- branching pattern;
- horizontal ring pattern;
- cage pattern.

## TERMINATING COLLECTION POINTS

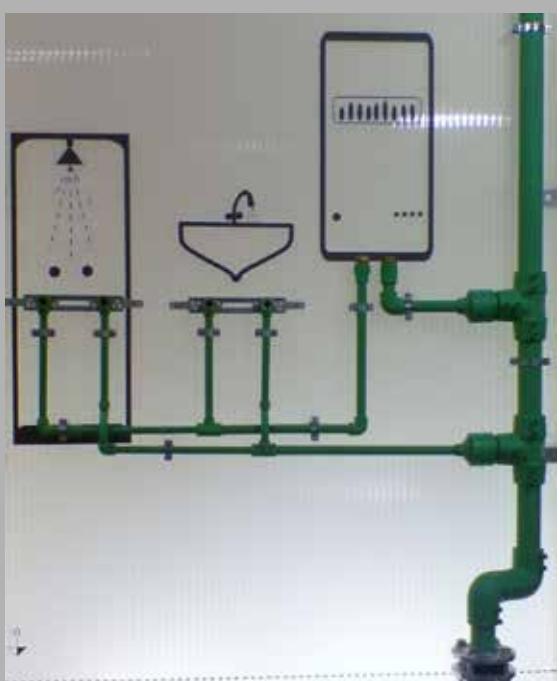

# Piping System



**COOLING TOWERS:** used to dispose of unwanted heat produced by a cooler. Big office buildings, hospitals and schools typically use one or more cooling towers as part of their air conditioning systems. Industrial and commercial cooling towers are used to remove the heat of the production process. The main aim of large industrial cooling towers is to eliminate the heat absorbed by the circulating system for cooling water.



## PUMP ROOMS

Class 1 pipes and fittings used for the mechanical units adopted that shall always be designed RESPECTING PPR PRESSURE CLASSES: centrifugal pumps, multi-stage pumps, wet rotor pumps, impellers, magnet dynamic fluid pumps, axial pumps, hydraulic water hammer pumps, linear dynamic fluid pumps.





## PPR PIPING SYSTEMS FOR THE TRANSPORT OF FLUIDS UNDER PRESSURE AND AGGRESSIVE FLUIDS

**Mining industry**  
**Iron and steel industry**  
**Metallurgy industry**  
**Chemical industry**  
**Pharmaceutical industry**  
**Defense industry**

**Mechanical industry**  
**Engineering industry**  
**Automotive industry**  
**Motorcycle industry**  
**Petrochemical industry**  
**Ship building industry**


**Manufacturing industry**  
**Textile industry**  
**Woodworking industry and paper mills**  
**Food industry**  
**Livestock industry**  
**Construction material industry**



Installations on **MARINE VESSELS** such as passenger ships, motorboats, cruise ships, ferries, oil tankers, merchant ships, container ships and leisure boats.

# NIRON®

PURPLE PPR PIPE

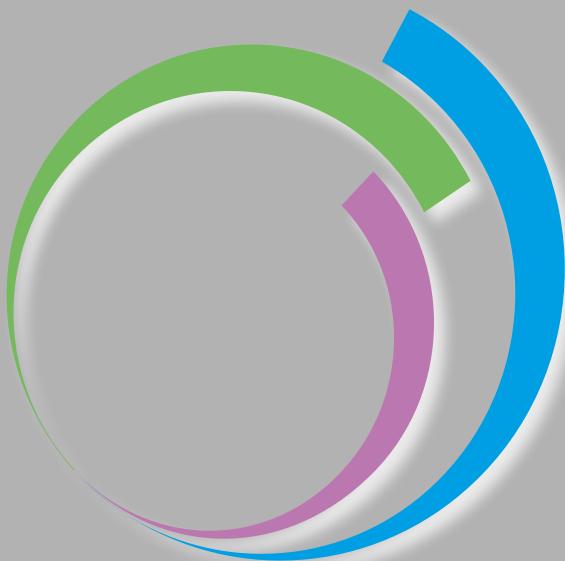

## WATER RECYCLING SYSTEMS

The **water average consumption** of a four person individual house in a temperate climate is over **200.000 liters per year**, around 17.000 liters per month.

Waste water or rainwater is routed to a central sump basin to be recycled. The sump then moves the water through some filtration stages and starts a disinfection cycle before it enters the storage tank. On a pre-determined schedule, a timer controlled pump recirculates water in the storage tank through the entire filtration process to maintain it clear and bacteria free. Recycled water in the storage tank is drawn out by a pressure regulated pump. When the irrigation timer turns on or a toilet is flushed, the system automatically provides the recycled water stored in the storage tank. When the storage tank is full, excess water drains into the sewage system.

For commercial building owners the need to **store water** is a **mandatory requirement**. Additionally, it is just the right thing to do, both from a financial and environmental point of view.

Resort, hotel and shopping mall owners who have to deal with a **high number of visitors** are increasing water storage especially in arid climates where lush foliage and landscaping is mandatory for visitors.

In the near future, the use of recycled water will have a huge impact on operating costs and profitability. Therefore, **PPR PIPING SYSTEM** by **NUPIGECO** offers to its users a piping range that allows the building of this type of installations. The **PURPLE** colour is in accordance with international standards regarding "waste and recycled water systems" and allows the pipe to be immediately identified.




	HVACR							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry



SISTEMA  
**NIRON<sup>®</sup> FG**

**NIRON<sup>®</sup> Clima**

*Polysystem*  
**NIRON<sup>®</sup> FG**

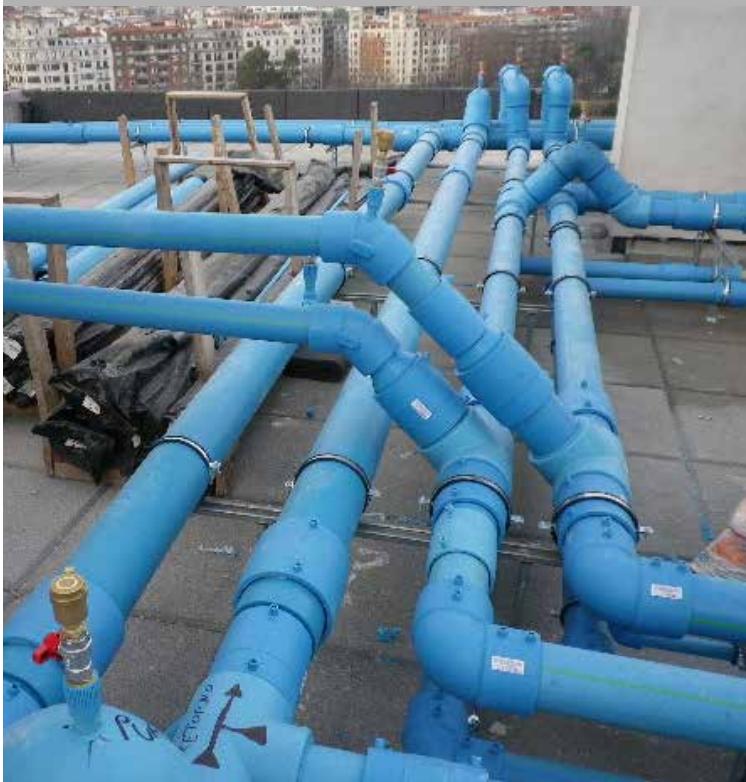

## PPR AND FIBER GLASS


Pipes made of polypropylene with an inner layer made also of fiber glass are visually characterized by coextrusion lines of different colour and are composed of several layers.

The inner and outer layers are made of Polypropylene Random Copolymer with an MRS of 10, while the intermediate layer is composed of a particular heterophasic PPR containing a given percentage of fiber glass.

The intermediate layer including fiber glass makes the product more dimensionally stable to thermal shock.

The technological contribution of the glass fibers consists especially in the **LOWER THERMAL EXPANSION** and the **HIGHER RESISTANCE TO COMPRESSION** with a significantly lower tendency to distortion.

These pipes are available in 4m, 5,8m or 11,6m bars.

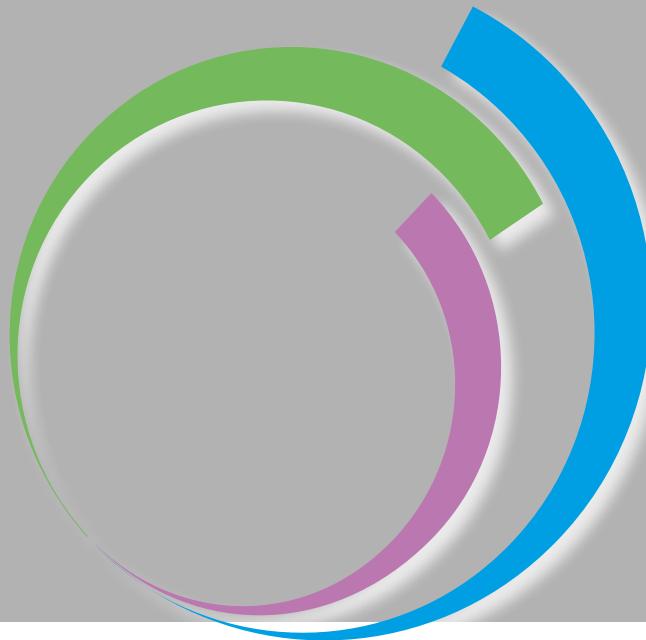



	<b>HVACR</b>							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry
	●	●			●	●	●	●





#### SYSTEM TESTING

The installation must be tested according to the European standards CEN TR 12108 and EN 806-4.

PPR PIPING SYSTEM pipes with fiber glass (NIRON CLIMA, NIRON FG, POLYSYSTEM NIRON FG) have been specially designed to meet the needs of air conditioning systems.

They are suitable for installations where the presence of chilled water is predominant but also for installations where the values of temperature and nominal pressure rates of fluids are close to the limits of performance ranges.

The system is **IN ACCORDANCE WITH CURRENT REGULATIONS ABOUT THE SALUBRITY OF WATER** that regulate the hygienic and sanitary criteria for the prevention and control of Legionellosis and bacterial proliferation in general.

#### REGULATIONS AND CERTIFICATES

The system is completely non-toxic and fully meets the hygienic-sanitary standards in force to safeguard the health of users.

PPR pipes with fiber glass are produced respecting German regulations DIN 8077/78 DIN 16962, as well as the international standard UNI EN ISO 15874 for the production of polypropylene pipes and fittings for the conveyance of hot and cold water for domestic use.

They also conform to the circular letter no. 174 of the Italian Ministry of Health dated 6th April 2004.



**PPR PIPING SYSTEMS WITH FIBER GLASS** are currently the most suitable solution to the problems caused by metal installations thanks to the following characteristics:

- LOW HEAT TRANSMISSION
- LIMITED HEAT LOSS AND CONDENSATION
- 100% CORROSION RESISTANT
- LOWER SURFACE ROUGHNESS
- ACOUSTIC ABSORPTION AND INSULATION
- HIGH CHEMICAL RESISTANCE
- INSTALLATION TIME SAVING
- TOTALLY RECYCLABLE AND ECO-FRIENDLY
- HIGH RESISTANCE TO IMPACT AND ABRASION
- LIMITED THERMAL EXPANSION
- TOTALLY COMPATIBLE WITH TREATMENTS AGAINST THE LEGIONELLOSIS BACTERIA

## STEEL PIPE DIMENSIONS

STEEL PIPE IN ACCORDANCE WITH UNI ISO7/1 - UNI ISO 50					STEEL PIPE IN ACCORDANCE WITH EN 12208				
DN	OD mm	ID mm	Th mm	w kg/m	DN	OD mm	ID mm	Th mm	w kg/m
16	17,2	<b>12,6</b>	2,3	0,90	16				
20	21,3	<b>14,70</b>	3,3	1,29	20				
25	26,9	<b>18,30</b>	4,3	1,66	25				
32	33,7	<b>23,10</b>	5,3	2,57	32				
40	42,4	<b>29,80</b>	6,3	3,31	40				
50	48,3	<b>33,70</b>	7,3	3,81	50				
63	60,3	<b>43,70</b>	8,3	5,40	63	60,3	<b>54,50</b>	2,9	4,11
75	76,1	<b>57,50</b>	9,3	6,93	75	76,1	<b>70,30</b>	2,9	5,24
90	88,9	<b>68,30</b>	10,3	9,03	90	88,9	<b>83,10</b>	2,9	6,15
110	114,3	<b>91,70</b>	11,3	13,00	110	114,3	<b>107,90</b>	3,2	8,77
125	139,7	<b>115,10</b>	12,3	17,30	125	139,7	<b>132,50</b>	3,6	12,10
160	165,1	<b>138,50</b>	13,3	20,80	160	168,3	<b>160,30</b>	4,0	16,20
200					200	219,1	<b>209,10</b>	5,0	26,40
250					250	273	<b>261,80</b>	5,6	36,90
315					315	323,9	<b>312,10</b>	5,9	46,30
355					355	355,6	<b>343,00</b>	6,3	54,30
400					400	406,4	<b>393,80</b>	6,3	62,20
450					450	457	<b>444,40</b>	6,3	70,00
500					500	508	<b>495,40</b>	6,3	77,90
560					560				
630					630	610	<b>595,80</b>	7,1	123,00

DN NOMINAL DIAMETER  
 OD OUTSIDE DIAMETER  
 ID INTERNAL DIAMETER  
 Th THICKNESS  
 w WEIGHT



### PPR PIPE DIMENSIONS

PPR PIPING SYSTEM FIBER GLASS SDR 7,4 S 3,2- UNI EN ISO 15874				
DN	OD mm	ID mm	Th mm	w kg/m
16				
20	20	<b>14,40</b>	2,8	0,16
25	25	<b>18,00</b>	3,5	0,24
32	32	<b>23,20</b>	4,4	0,39
40	40	<b>29,00</b>	5,5	0,59
50	50	<b>36,20</b>	6,9	0,91
63	63	<b>45,80</b>	8,6	1,45
75	75	<b>54,40</b>	10,3	2,06
90	90	<b>65,40</b>	12,3	2,94
110	110	<b>79,80</b>	15,1	4,36
125	125	<b>90,80</b>	17,1	5,61
160	160	<b>116,20</b>	21,9	9,09
200	200	<b>145,20</b>	27,4	14,73
250	250	<b>181,60</b>	34,2	22,08
315	315	<b>229,80</b>	42,6	34,89
355	355	<b>259,00</b>	48,5	44,16
400	400	<b>290,60</b>	54,7	56,00
450				
500				
560				
630				

PPR PIPING SYSTEM - CLIMA SDR 9 S 4- UNI EN ISO 15874				
DN	OD mm	ID mm	Th mm	w kg/m
16				
20				
25				
32	32	<b>24,80</b>	3,6	0,33
40	40	<b>31,00</b>	4,5	0,51
50	50	<b>38,80</b>	5,6	0,78
63	63	<b>48,80</b>	7,1	1,24
75	75	<b>58,20</b>	8,4	1,74
90	90	<b>69,80</b>	10,1	2,51
110	110	<b>85,40</b>	12,3	3,73
125	125	<b>97,00</b>	14,0	4,82
160	160	<b>124,20</b>	17,9	7,83
200	200	<b>155,20</b>	22,4	12,00
250	250	<b>194,20</b>	27,9	18,70
315	315	<b>244,60</b>	35,2	29,50
355	355	<b>275,60</b>	39,7	37,40
400	400	<b>310,60</b>	44,7	47,30
450				
500				
560				
630				

PPR PIPING SYSTEM - CLIMA SDR 11 S 5- UNI EN ISO 15874				
DN	OD mm	ID mm	Th mm	w kg/m
16				
20				
25				
32	32	<b>26,20</b>	2,9	0,28
40	40	<b>32,60</b>	3,7	0,43
50	50	<b>40,80</b>	4,6	0,67
63	63	<b>51,40</b>	5,8	1,04
75	75	<b>61,40</b>	6,8	1,44
90	90	<b>73,60</b>	8,2	2,08
110	110	<b>90,00</b>	10,0	3,10
125	125	<b>102,20</b>	11,4	4,02
160	160	<b>130,80</b>	14,6	6,50
200	200	<b>163,60</b>	18,2	10,09
250	250	<b>204,60</b>	22,7	15,01
315	315	<b>257,80</b>	28,6	24,67
355	355	<b>290,60</b>	32,2	31,20
400	400	<b>327,40</b>	36,3	39,51
450				
500				
560				
630				

DN NOMINAL DIAMETER  
 OD OUTSIDE DIAMETER  
 ID INTERNAL DIAMETER  
 Th THICKNESS  
 w WEIGHT





## DISTRIBUTION MANIFOLDS

Nowadays, more and more companies choose PPR manifolds.

Installations are often required to serve high flow rates and their weight and implementation difficulties require special expensive equipment.

NUPIGECO produces a wide range of welding saddles that allows the construction of distribution manifolds in just a few steps.

The company also provides a technical service whose task is to make and test the manifolds needed for a specific project as per customers' needs according to water tightness tests as per CEN TR 12108.

The company's Plumbing Division has a special department dedicated to these manifolds and equipped with specific equipment and programs for their design and making according to customers' requirements. This department offers assistance during the installation and facilitates the work of project managers and installation professionals thanks to the versatility offered by **PPR PIPING SYSTEM** by **NUPIGECO**.





Drinking water	HVACR	Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry
●	●	●	●			●	●	●





It is the innovative PRE-INSULATED pipe and fitting system that is ideally suitable for application in areas where the heat loss reduction is essential.

This product range was specifically designed for networks for the distribution or adduction of hot fluids.

The reliability, ease of installation and relevant physical-mechanical properties of the materials used allow installers to overcome many problems when installing heat distribution and conditioning systems.

## **THERMAL INSULATION (PUR)**

The insulation of the primary pipe is made with a rigid polyurethane foam according to EN 253 standard and is free from Freon. The coefficient of thermal conductivity is 0,027 W/mK at a medium temperature of 50°C.

This excellent characteristic of the material allows to obtain high levels of thermal insulation with significantly reduced insulation layers if compared to those that would be required if other materials were to be used.

In addition, due to its closed cell structure, under normal conditions of use it does not have any transformation caused by water absorption, compression, sacking, etc.

## **JACKET PIPE (HDPE)**

The layer of polyurethane insulation is protected by a jacket pipe made of High Density Polyethylene (HDPE) according to EN 253.





	<b>HVACR</b>							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry
●	●		●			●	●	●

## ■ APPLICATIONS

- District heating/cooling
- Transport of energy on site and remote
- Transport of water
- Cooling systems
- Geothermal systems
- Industry and agriculture




## ■ BENEFITS

- Ease of installation and reduced installation time
- Excellent thermal insulation
- Low specific weight
- Low pressure drop
- Excellent weldability thanks to the fittings of the NIRON range
- High resistance to corrosion
- High durability
- Reliable junction
- Resistance to abrasion
- Resistance to stray currents

# NIRON<sup>®</sup>

## WHITE BLUE PPR PIPE

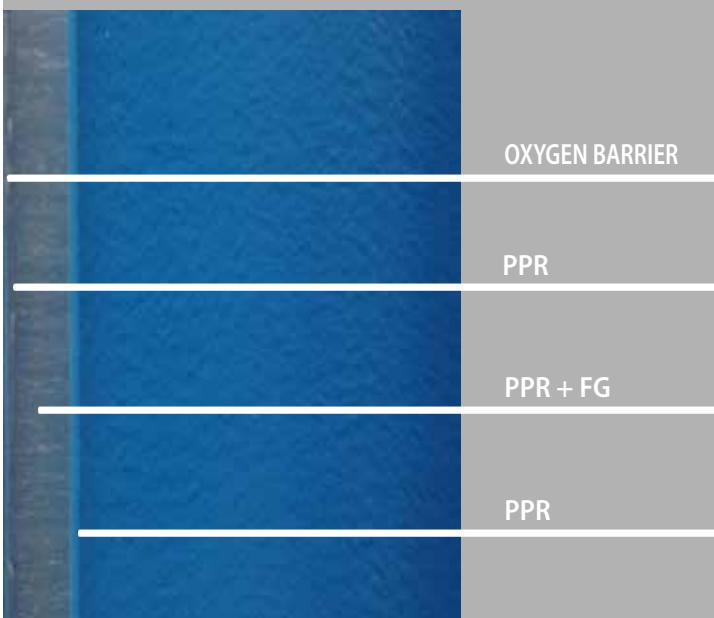

## OXYGEN BARRIER

Permeation is a multistage process where the permeant molecule (e.g. O<sub>2</sub>) collides first with the polymer, then dissolves in the polymer matrix, crosses it and reaches the opposite surface from which it is desorbed and finally moves away migrating in the transported fluid.



As the oxygen moves through the system, it can lead to corrosion of metallic components, especially in a recirculating system. It is typically a concern in high temperature systems.

Barrier polymers limit the transport of permeant substances through or inside the polymer.

This avoids the problem of water oxygenation and the consequent oxidation and corrosion of metal components that constitute the system. Consequently, the entire system benefits from this situation in terms of duration in time.

## EVAL™ layer thickness and OTR

Conditions: EVAL™ EF-F multilayer film 35°C, 0% RH

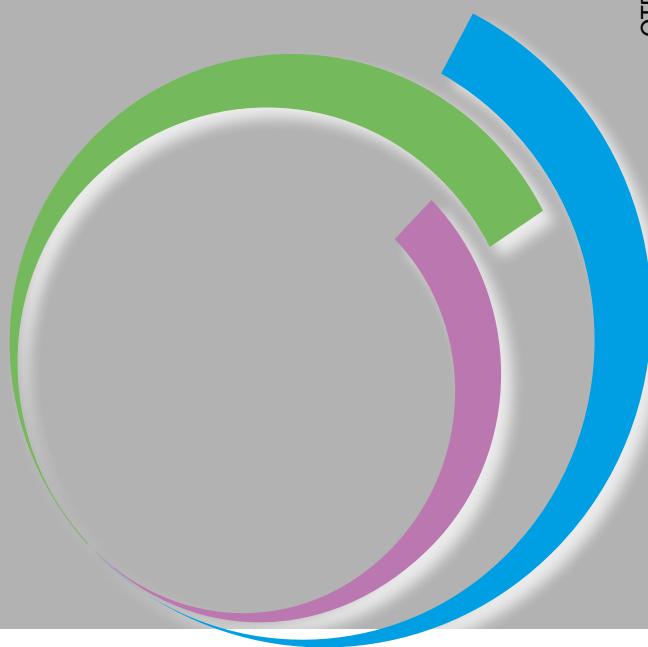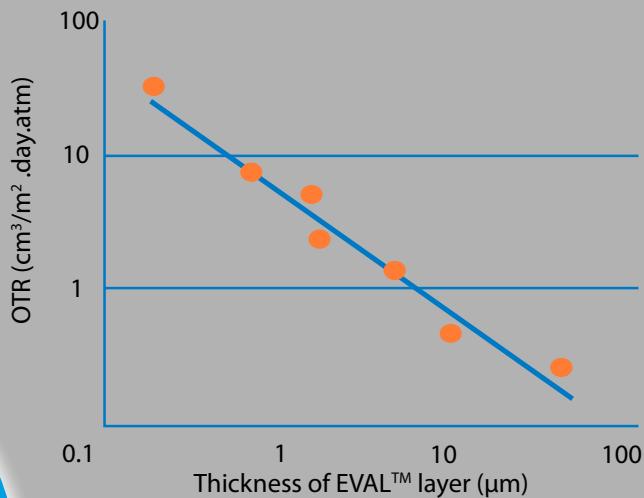




	<b>HVACR</b>							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry

We hereby list a group of reference values of the diffusion-limited current density of oxygen for some specific installations/settings. The relationship between current density and speed of generalized corrosion for steel is **1,16 microns / year for 1 mA/m<sup>2</sup>**.

#### Approximate values for diffusion-limited current density of oxygen in ventilated mediums

Installation/setting	Diffusion-limited current density of oxygen (mA/m <sup>2</sup> )
underground installations	5 – 100
offshore installations	50 – 200
water: turbulent flow	200 – 1000
concrete scaffolds: suspended structures	5 – 15
concrete scaffolds: submersed structures	0,2 – 2

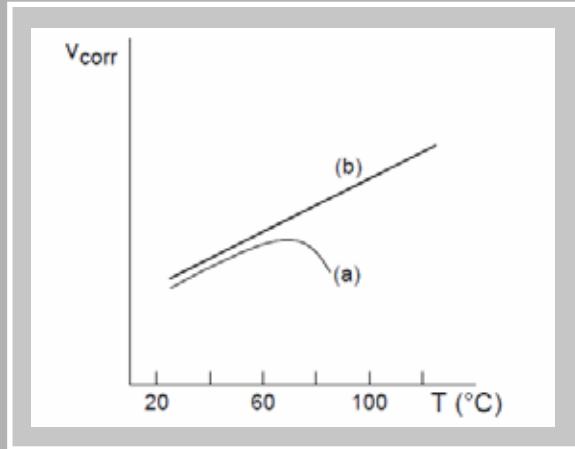

## INFLUENCE OF TEMPERATURE ON OXYGEN CORROSION RATE:

(A) OPEN SYSTEMS, (B) CLOSED SYSTEMS

The rate of oxygen corrosion in the water increases with increasing temperature. It is however necessary to distinguish between closed systems, line (b) and open systems, line (a) as per figure. In open systems, the corrosion rate decreases above about 80° C because of the predominance of the decreasing effect of oxygen solubility.

The concentration of oxygen  $\text{CO}_2$ , for water in equilibrium with the atmosphere, can be calculated by the following formula:


$$\text{CO}_2 = 14,59 - 0,397 \cdot T + 0,008 \cdot T^2 - 8 \cdot 10^{-5} \cdot T^3 - 6,0443 \cdot C_{\text{NaCl}} \cdot (0,0167 - 0,00059 \cdot T + 10^{-5} \cdot T^2)$$

where:

$\text{CO}_2$  is the concentration of oxygen in the water in ppm;

$C_{\text{NaCl}}$  is the salinity expressed as NaCl in g/l;


T is the temperature in °C.

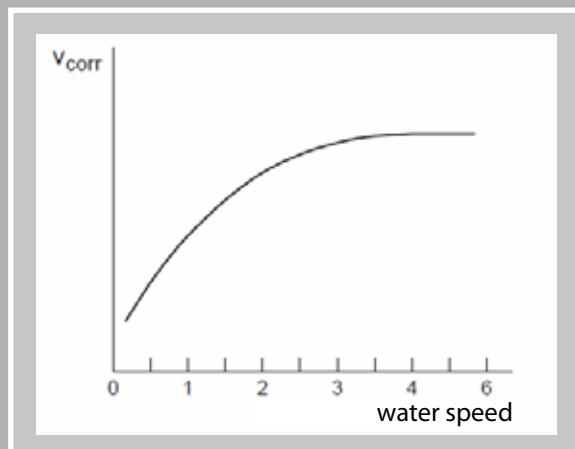

## INFLUENCE OF WATER SPEED ON OXYGEN CORROSION RATE:

The figure shows the trend of corrosion rate of steel in aerated water according to water speed. The effect of increasing rate of corrosion is due to the greater supply of oxygen on the metal surface. The corrosion rate tends towards an asymptotic value, where the controlling stadium is the oxygen diffusion through a thin layer of corrosion products.

It is well known that by imposing adequate plastic cold deformation, you can increase mechanical properties such as hardness and yield strength of the materials. After these treatments we also assist to a decrease in the strength of the material due to many reasons. At a thermodynamic level, it is likely that there is an influence on the activity of the constituent atoms of metal (even though this is not a very clear aspect), while at kinetic level you can assume the effect of a higher density of lattice defects, as well as of any crystallographic textures and, ultimately, of a greater microstructural inhomogeneities. In case of materials with active-passive behaviour, it is also likely that the protective surface layers are less compact and more defective, therefore less able to perform their shielding action. Mechanical stresses induced by external loads or even related to auto-tension states, further decrease the corrosion resistance of the materials. The combined action of a voltage imposed to the material in a corrosive environment is in many cases much worse than the damage made by the two separate causes. In such circumstances, phenomena such as Stress-Corrosion-Cracking (SCC), Hydrogen-Stress-Cracking and Corrosion-Fatigue can be easily triggered and can induce intense and insidious damage to mechanical or structural components.

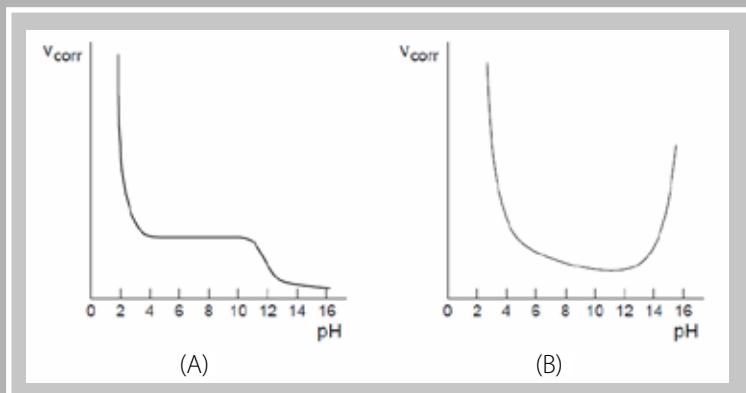

INFLUENCE OF PH ON OXYGEN CORROSION RATE:  
(A) IRON, (B) ZINC

A generalized corrosion is observed in acidic environments, where the cathodic reaction is the reduction of hydrogen ions to molecular hydrogen gas. The pH is the controlling parameter: the figure shows the influence of pH on corrosion speed for iron and steels in general. Acid corrosion becomes significant for pH lower than 4, increasing exponentially for lower values of pH. With alkaline pH, however, where the presence of OH-ions in solution prevails, the corrosion rate becomes negligible for the formation of a film protective oxide. The behaviour of alkaline pH is different for amphoteric metals such as zinc and aluminum, that in the presence of OH-ions form complex galvanized and aluminized species.



## UV RAY PROTECTION

The influence of ultraviolet (UV) radiation on organic structures is well known. Our skin is not the only organic structure that suffers; even polymers are affected by the oxidation caused by the exposure to sunlight and ultraviolet rays.

The main problem is that there are many parameters that have an influence on photo-oxidation and also several ways to limit its effects.

All types of UV rays can cause a photochemical effect within the polymer structure, that can negatively affect the system performance and cause the degradation of some of its components.

The main visible effects are a chalky appearance and a colour shift.


Photo-oxidation is favored by UV radiation that activates the break of c-c bonds and the formation of hydroperoxides, thermolabile compounds that then trigger a chain reaction.

To solve this problem in installations requiring exposure to sunlight (without the need to find other solutions such as insulated piping, insulating products that cover the pipes or a paint that must be periodically replaced), the best option is an HDPE layer, because CARBON BLACK is the material that presents the best and most long-lasting protection against UV rays.




		HVACR							
Drinking water			Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry
	●						●		

- NO PHOTOCHEMICAL ATTACK TO THE POLYMER STRUCTURE
- NO PIGMENTATION CHANGE
- NO CRACKING
- NO THICKNESS REDUCTION DUE TO LIGHT DAMAGE
- TOTALLY COMPATIBLE WITH THE FITTING RANGE

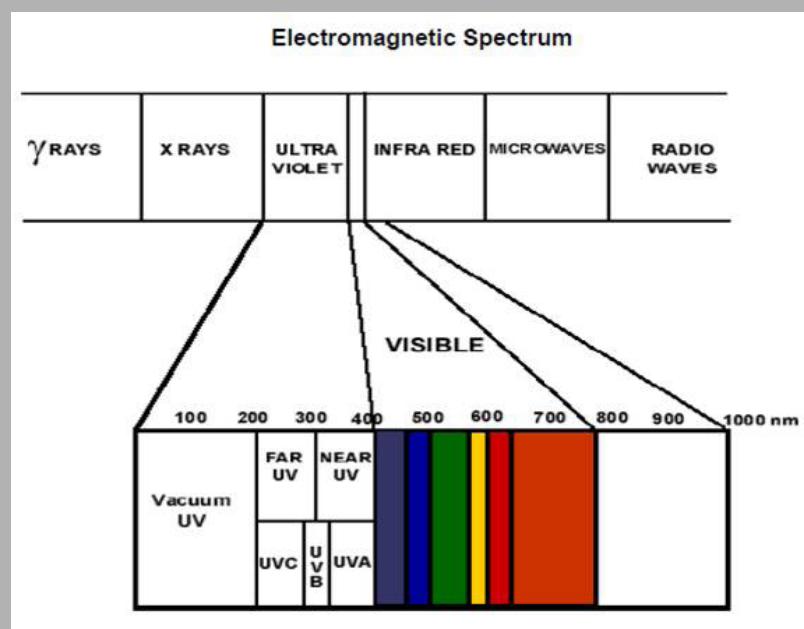

# NIRON®

## PLATINUM PPR PIPE

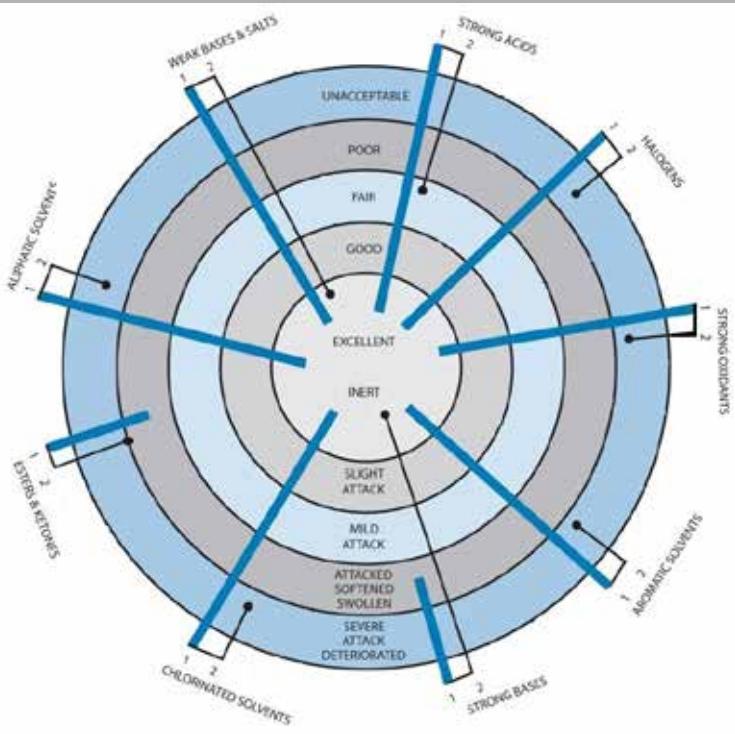

### PRODUCT PERFORMANCE:

- 1) PPR + TECHNOPOLYMER BARRIER
- 2) PPR

## TECHNOPOLYMER BARRIER

Thanks to its **BARRIER EFFECT**, NIRON PLATINUM represents the technical solution to the problems caused by the transport of fluids with high percentages of chemical agents at high pressure and temperature within the PPR PIPING SYSTEM range.


These problems cause premature aging of polypropylene and are cancelled thanks to the introduction of an inner piping layer made with a **STATE OF THE ART TECHNOPOLYMER**.

Among the most widely used chemicals, there are solutions for water disinfection, biocidal agents used to prevent the formation of mold and bacteria (in air conditioning systems) and inhibitors that prevent the most common bacterial proliferation in drinking water (such as Legionellosis).

The main mechanisms for the disinfection of drinking water are based on the following chemicals:

- **SODIUM HYPOCHLORITE (NaOCl)**  
 $\text{NaOCl} + \text{H}_2\text{O} \Rightarrow \text{NaOH} + \text{HOCl}$
- **CHLORINE DIOXIDE (ClO<sub>2</sub>)**

In the first case, the disinfecting agent is HOCl, while in the second case this function is performed by ClO<sub>2</sub>. Both are strong oxidizing agents.

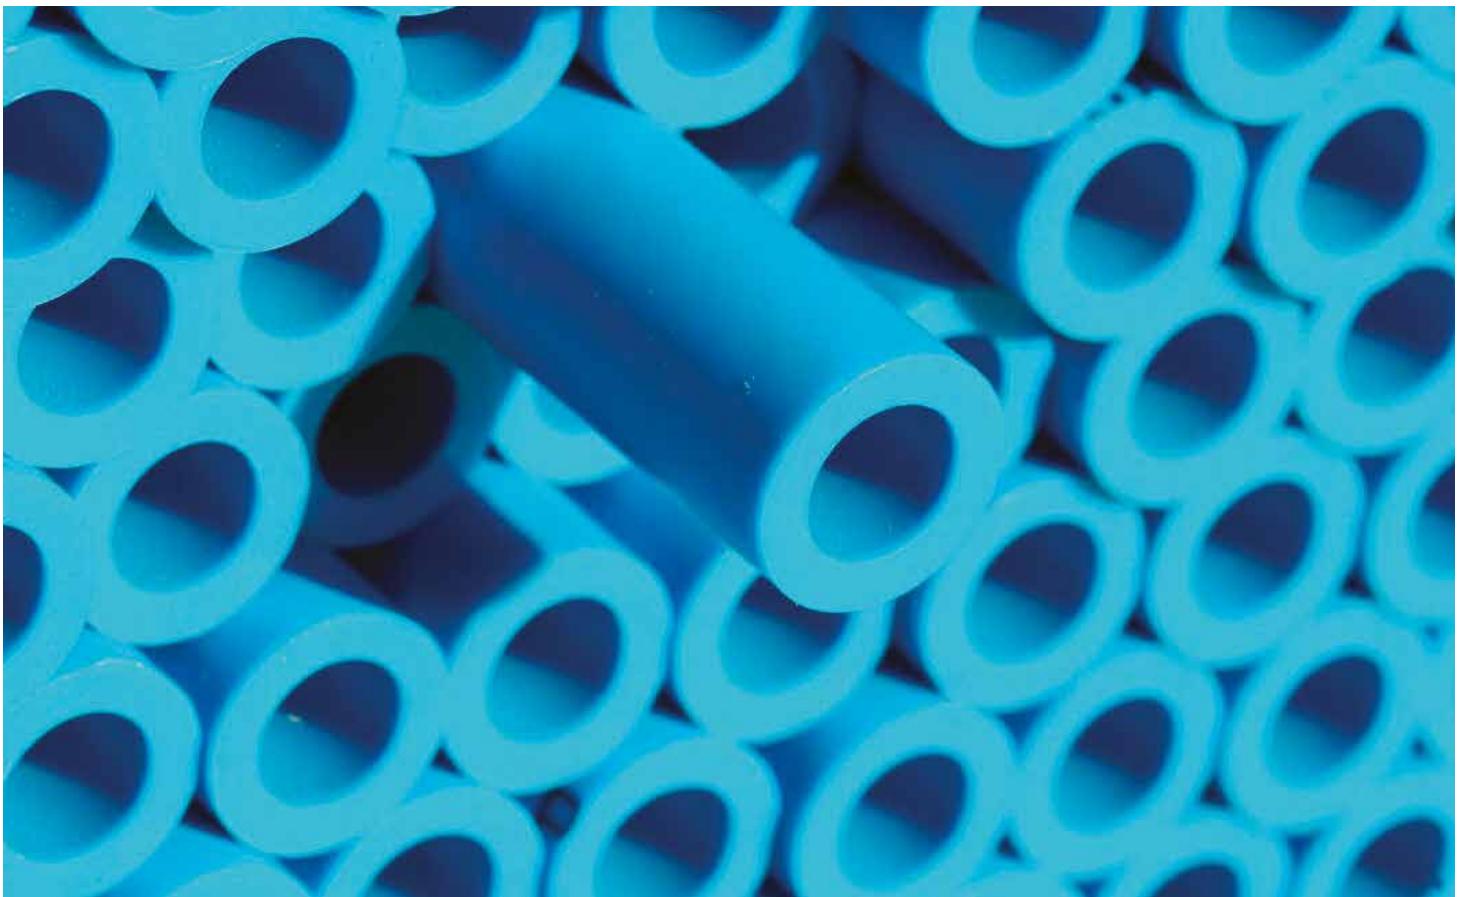

	<b>HVACR</b>							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry

## OXIDIZING ACTION


The oxidizing action manifests itself through the early consumption of antioxidants present in the raw material and triggers premature breakage on the molecular ramifications of the material.

As a result, **PREMATURE LONGITUDINAL BREAKAGE** occurs inside the pipe.

## CRITICAL KEY FACTORS

The main critical factors are shown in pipes belonging to high classes of SDR (reduced thickness) and pipes installed in systems that are subjected to frequent chlorine-based disinfections, with high working pressure and temperature.

The growing practice of chemical disinfection of water based on chlorinated agents (eg: sodium hypochlorite and chlorine dioxide), used with an increasingly critical combination of frequency/concentration/temperature/pH, requires a different and more accurate design solution ensuring greater durability.

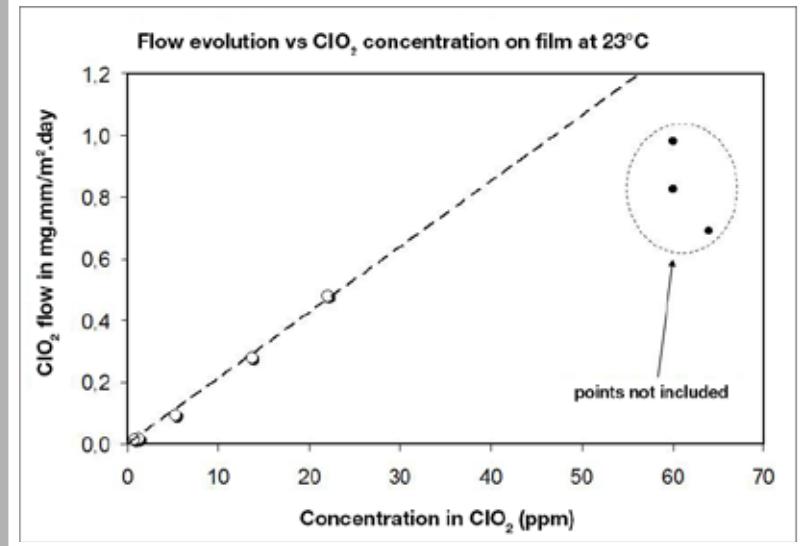

Amount of chlorine deposited on PVDF film (at 23°C) detected considering the presence of  $\text{ClO}_2$  in the circuit (ppm) and flow circulating in the system ( $\text{mg} \cdot \text{mm}/\text{m}^2 \cdot \text{day}$ )

The permeation of chemical agents is extremely low thanks to the barrier effect produced by the technopolymer layer.

The mechanical action represented not only by the internal working pressure but also by the effect of any bending that may occur during the installation adds up to this chemical action.

The flexural modulus is a characteristic of the material and indicates the resistance limit of a specific pipe with a given thickness when subjected to bending. When the working conditions of the piping system already stress the material to its limit as regards its resistance to bending, further aggressive action represented by a chemical attack can lead to a real drift in terms of mechanical strength.


We should also consider the effect due to the action of the transported fluid. In case of high flow rates, this effect may further worsen the situation described so far by adding the erosive factor to the numerous factors already considered.

The solution proposed by NUPIGECO is **NIRON PLATINUM** pipe and its range of fittings. PPR pipe is protected by a PVDF barrier which defends it against attacks by aggressive fluids.


PVDF is a technopolymer characterized by excellent chemical resistance to strong acids and oxidants, high solubility in polar solvents, resistance to UV rays and wide heat applicability range: -40°C/+150°C.

The network conveying aggressive fluids is thus totally secured, both in the linear sections and in the most vulnerable points, i.e. the fittings: bends, elbows and tees.

The installation is chemically protected and structurally improved and the product promotes the maintenance of all the advantages of PPR pipes.

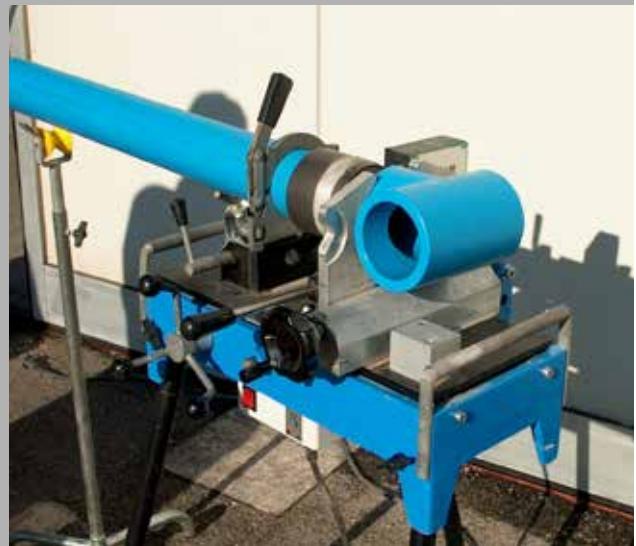


# PPR PIPING SYSTEM

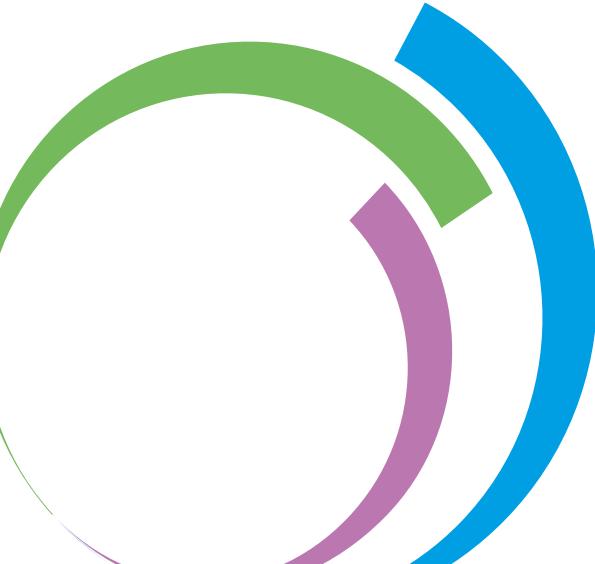


# 2

TECHNICAL CHARACTERISTICS  
PRODUCT AND PRODUCTION PROCESS

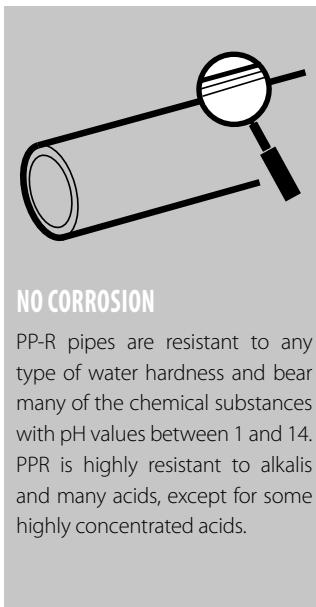


#### NO CORROSION

PP-R pipes are resistant to any type of water hardness and bear many of the chemical substances with pH values between 1 and 14. PPR is highly resistant to alkalis and many acids, except for some highly concentrated acids.

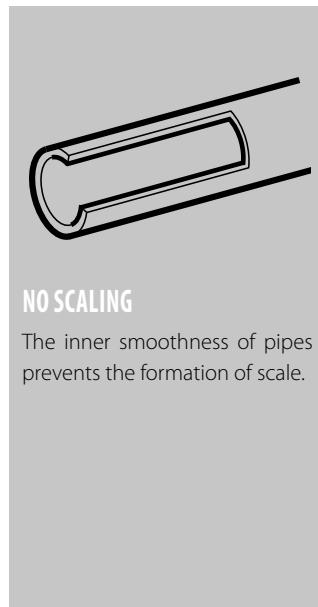


#### NO SCALING

The inner smoothness of pipes prevents the formation of scale.

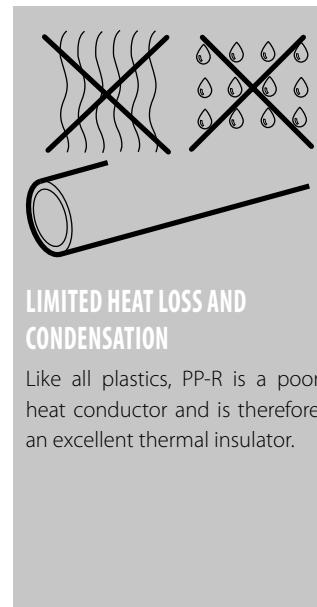

#### LIMITED HEAT LOSS AND CONDENSATION

Like all plastics, PP-R is a poor heat conductor and is therefore an excellent thermal insulator.

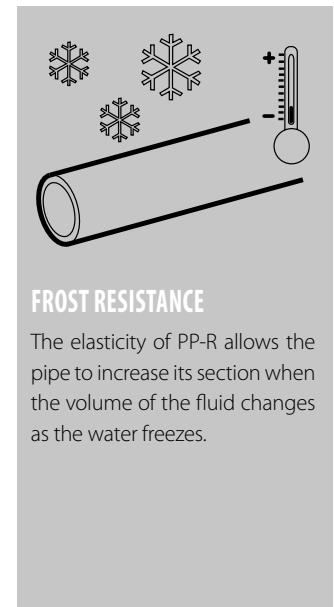


#### FROST RESISTANCE

The elasticity of PP-R allows the pipe to increase its section when the volume of the fluid changes as the water freezes.




#### SUITABLE FOR USE IN SEISMIC HAZARD AREAS

This feature is recognized by international boards of experts, as polypropylene is resilient within the structure of a building.

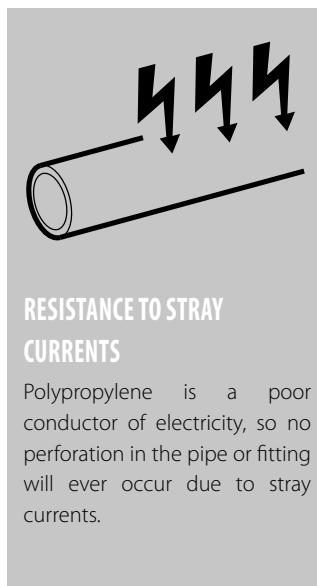


#### RESISTANCE TO STRAY CURRENTS

Polypropylene is a poor conductor of electricity, so no perforation in the pipe or fitting will ever occur due to stray currents.

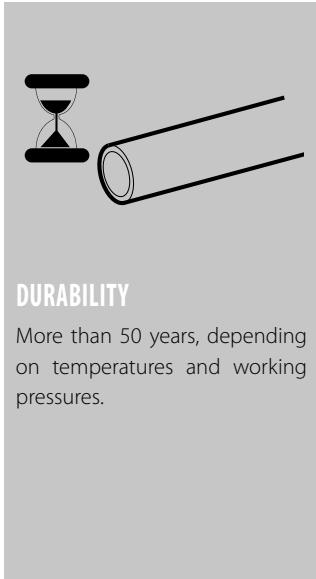


#### DURABILITY

More than 50 years, depending on temperatures and working pressures.

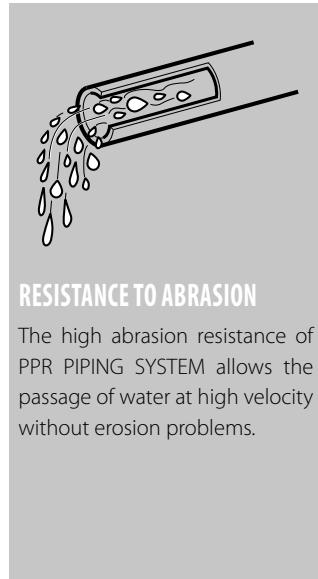


#### RESISTANCE TO ABRASION

The high abrasion resistance of PPR PIPING SYSTEM allows the passage of water at high velocity without erosion problems.

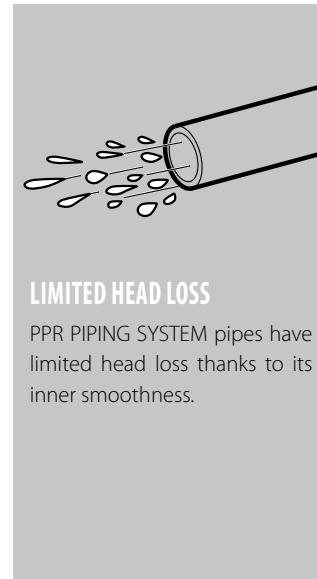

#### LIMITED HEAD LOSS

PPR PIPING SYSTEM pipes have limited head loss thanks to its inner smoothness.

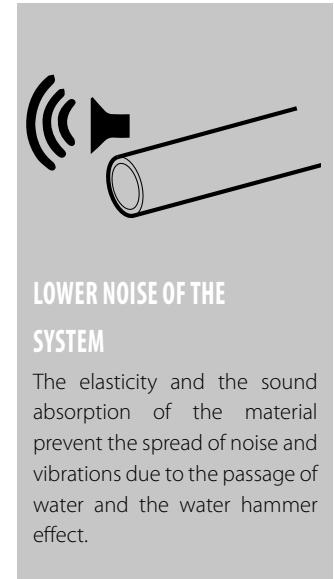

#### LOWER NOISE OF THE SYSTEM

The elasticity and the sound absorption of the material prevent the spread of noise and vibrations due to the passage of water and the water hammer effect.

## 2.1 BENEFITS



- No corrosion
- No scaling
- Frost resistance
- Limited heat loss and condensation
- Low noise
- Limited head loss
- Resistance to abrasion
- Resistance to stray currents
- Durability
- Lightness

### 2.1.1 POLYPROPYLENE

The polypropylene used for the **PPR PIPING SYSTEM** by **NUPIGECO** is a special type of Random Copolymer with high molecular weight.

The special structure of its molecules and the appropriate additives used ensure the mechanical resistance and prolonged duration.

PPR is very light and easy to process, therefore the material is effectively used to produce a complete system that allows installation time saving from 30 to 50 %, if compared to the traditional metal systems (steel and copper).

**PPR PIPING SYSTEM** by **NUPIGECO** is used for the conveyance of drinking water in heating and cooling applications and is also used in the production of refrigeration systems. It is also used for the industrial, agricultural and shipbuilding fields.

The raw material is supplied by international certified suppliers and complies with the most important organoleptic requirements for the transport of drinking water and contact with food fluids.

Polypropylene is available in 4 main types of polymer:


TYPE 1	TYPE 2	TYPE 3	TYPE 4
HOMOPOLYMER	BLOCK COPOLYMER	RANDOM COPOLYMER	RANDOM COPOLYMER WITH MODIFIED CRYSTALLINITY
PP-H	PP-B	PP-R	PP-RCT



**NUPIGECO uses PP-R and PP-RCT (internally codified as PP-RP) for its NIRON system.**

PP-RCT represents the evolution of the 2000s of PP-R. It presents better performance characteristics than its predecessor PP-R.


The regression curve flattened by ensuring lower decay of pressure/temperature performances and the “knee” of the curve disappeared for a more enhanced durability.

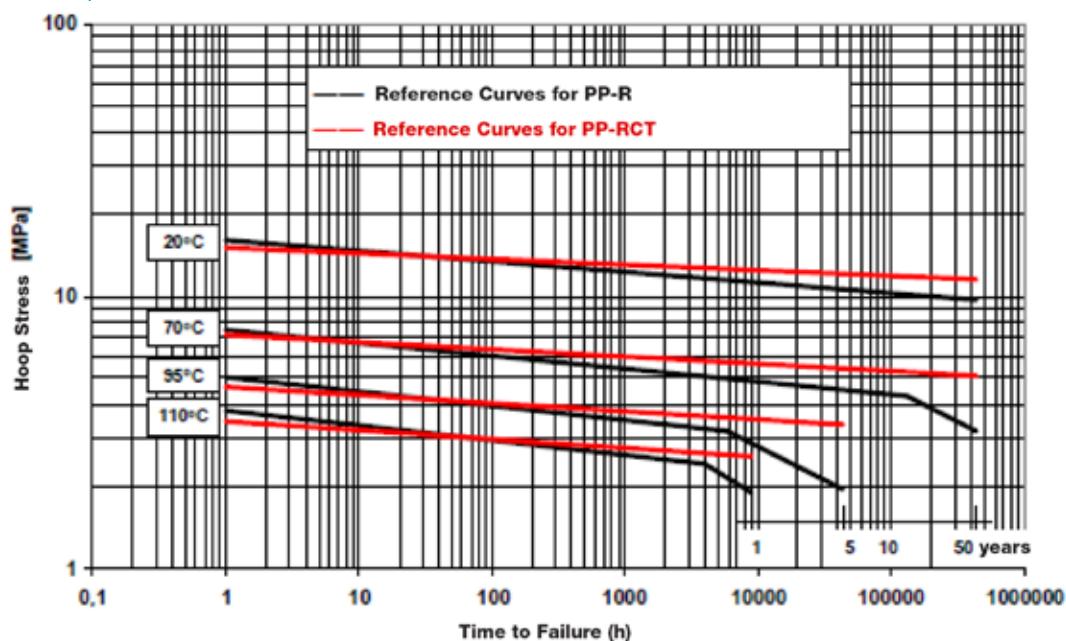

The required pipe series for a particular application class is calculated from the design stress and the operating pressure. The outcome of this calculation for operating pressures of 8 bar and 10 bar are presented in table V.

**Table V: Comparison of the required pipe series and SDR for PP-R and PP-RCT for the individual application classes**

	Operating pressure 8 bar (116 psi)		Operating pressure 10 bar (145 psi)	
	PP-R	PP-RCT	PP-R	PP-RCT
Application class 1 60°C hot water supply	S 3,2 SDR 7,4	S 4 SDR 9	S 2,5 SDR 6	S 3,2 SDR 7,4
Application class 2 70°C hot water supply	S 2,5 SDR 6	S 4 SDR 9	S 2 SDR 5	S 3,2 SDR 7,4
Application class 4 Underfloor heating and low temperature radiators	S 3,2 SDR 7,4	S 4 SDR 9	S 3,2 SDR 7,4	S 3,2 SDR 7,4
Application class 5 High temperature radiators	S 2 SDR 5	S 3,2 SDR 7,4	-	S 2,5 SDR 6

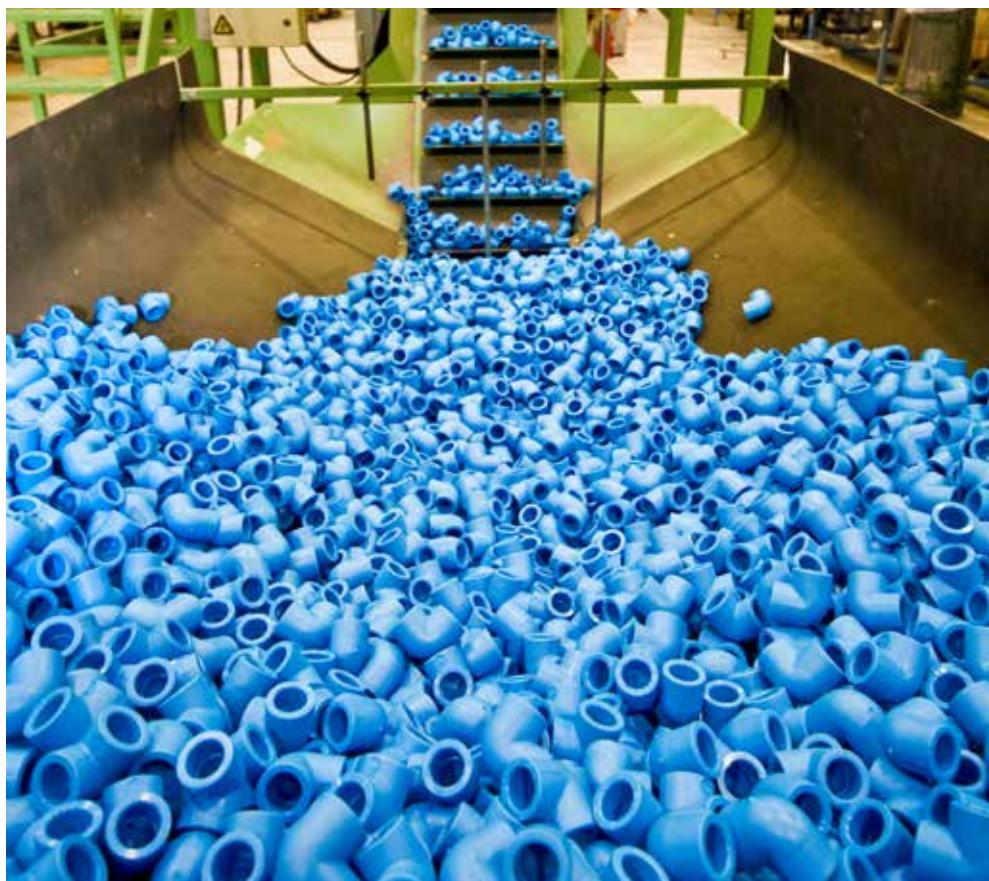

Numerous international certificates ensure high quality standard of the **PPR PIPING SYSTEM** by **NUPIGECO**:

**KIWA (Italy)**  
**DVGW (Germany)**  
**AENOR (Spain)**  
**OVGW (Austria)**  
**Certif (Portugal)**  
**CSTBat (France)**  
**ATG (Belgium)**  
**WRAS (UK)**  
**RINA (Italy)**  
**Lloyd Register (UK)**  
**Eurofins (France)**

## 2.1.2 PROPERTIES OF THE MATERIAL

Properties	Test method	Values at 23°C	Unit of measure
Volumic mass	ISO 1183	<b>0,898</b>	g/cm <sup>3</sup>
Yield strength	ISO 527	<b>23</b>	N/mm <sup>2</sup>
Elongation at break	ISO 527	<b>&gt; 50</b>	%
Modulus of elasticity	ISO 527	<b>850</b>	N/mm <sup>2</sup>
Melt flow index MFI 190/5	ISO 1133 Procedure 18	<b>0,5</b>	g/10 min
Heat conductivity (λ)	DIN 52612	<b>0,24</b>	W/mk
Linear thermal expansion coefficient	VDE 0304	<b>1,5 x 10<sup>-4</sup></b>	K <sup>-1</sup>
Melting point	DIN 53736b2	<b>150 - 154</b>	°C
Impact strength (Charpy)	+23°C	<b>no break</b>	KJ/m <sup>2</sup>
	-30°C	<b>50</b>	KJ/m <sup>2</sup>
Volumic strength	IEC 93	<b>&gt;10<sup>15</sup></b>	Ω cm
Dielectric strength	IEC 243/1	<b>75</b>	KV/mm
Dielectric loss factor	DIN 53483	<b>&lt; 5 x 10<sup>-4</sup></b>	
Fire resistance	DIN 4102	<b>B2</b>	



## 2.1.3 CHEMICAL AND THERMAL DISINFECTION

### A) CHEMICAL DISINFECTION OF DRINKING WATER

The continuous disinfection with chlorinated drinking water may occur with a concentration of free chlorine up to 0,5 ppm (mg / l).

#### GENERAL INDICATIONS FOR ALL PLUMBING APPLICATIONS

**We hereby list some possible actions aimed at preventing the spread of the bacterium that causes Legionellosis in water supply zones:**

- avoid pipes with closed end sections;
- move the recirculation loop (if any) as close as possible to the user;
- periodically increase the water supply temperature to 55° C (more if required by maintenance protocols);
- expose the supply of water to UV rays using special lamps.

**The preventive treatments against the bacterium, in air conditioning systems, are the following:**

- use of special devices (droplet separator) in cooling towers;
- design of cooling towers so that the air flow can be channeled into the outer air intakes;
- regular cleaning of prevention systems, in order to eliminate the nutrients of the bacterium;
- regular chlorination of the network, according to the standards and parameters of the law.

In Italy, the maximum allowable concentration of free chlorine in water is 0,2 ppm (mg / l).

The maximum temperature of 70° C shall not be exceeded.

The level of parameters is different for each country, for this reason the system must comply with the restrictions relating to drinking water in the country where the pipe will be installed.

#### **Chlorine dioxide as a disinfectant**

The use of chlorine dioxide as a disinfectant in drinking water supply is increasing in recent years, as the chemical reactivity (and therefore the effects of the disinfection) is about three times higher in case of free chlorine.

This high oxidation generates potential damage to the **PPR PIPING SYSTEM**.

### B) THERMAL DISINFECTION OF THE SYSTEM

The washing temperature is adjusted so that the level of 70° C for a minimum of 3 minutes at all points of the drinking water network is maintained.

It is essential to observe the maximum allowable limits indicated by the regulations in force, as regards temperature and working pressure, that differ according to the application and use of the building where the system is placed.

### C) UV TREATMENT FOR THE DISINFECTION OF DRINKING WATER SYSTEMS

The irradiation with ultraviolet light is a valid alternative method for the disinfection of drinking water. The application of ultraviolet light is a method of disinfection which seems to be more effective in the proximity of the point of use.

## 2.1.4 CERTIFIED QUALITY

We hereby list the reference laws, guidelines and standards for the **PPR PIPING SYSTEM** by **NUPIGECO**:

### - GENERAL QUALITY AND DIMENSION REQUIREMENTS

**UNI EN ISO 15874** Plastics piping systems for hot and cold water installations -- Polypropylene (PP).

**ASTM F2389** Standard Specification for Pressure-rated Polypropylene (PP) Piping Systems.

**CSA B137.11** Polypropylene (PP-R) pipe and fittings for pressure applications.

**NSF/ANSI Standard 14** Plastics Piping System Components and Related Materials.

**DIN 8077** Polypropylene (PP) Pipes - PP-H, PP-B, Pp-R, PP-RCT – Dimensions.

**DIN 8078** Polypropylene (PP) Pipes - PP-H, PP-B, Pp-R, PP-RCT – General quality requirements and testing.

**DVGW** Working sheets.

### - HYGIENIC LAWS AND SPECIFICATIONS

**W270** (Germany) [Increase of Microorganisms on materials. Used for potable water application-Test and Evaluation].

**BS 6920** British Standard Suitability Of Non-Metallic Products For Use In Contact With Water Intended For Human Consumption With Regard To Their Effect On The Quality Of The Water.

**ACS** (Attestation de Conformité Sanitaire)

**Hydrocheck** (Belgaqua)

**D.M. 174 of 16.04.04** (Italy)

**NSF/ANSI Standard 61** Drinking Water System Components - Health Effects.

### - INSTALLATION STANDARDS

**DIN 2000** Guidelines For Drawing Up Requirements For The Design, Construction, Operation And Maintenance Of Public Drinking Water Supply System.

**EN 806** Specifications For Installations Inside Buildings Conveying Water For Human Consumption.

**DIN 1988** Codes of practice for drinking water installations - DVGW code of practice.

**DIN 4109** Standard for the elimination of noise in the field of structural engineering.

**DIN 16962** Pipe Joints And Elements For Polypropylene (Pp) - Pressure Pipelines.

**DVS 2207** Welding of thermoplastic materials.

**DVS 2208** Welding machines and devices for thermoplastic materials.

**DIN 18381** German construction contract procedures (VOB) - Part C: General technical specifications in construction contracts (ATV) - Installation of gas, water and drainage pipework inside buildings.

**DIN 16928** Pipes of Thermoplastic Materials; Pipe Joints, Elements for Pipes, Laying; General Directions.

### CERTIFIED QUALITY

The quality of the PPR PIPING SYSTEM by NUPIGECO is guaranteed by numerous national and international independent bodies.





## 2.1.5 CONTROL SYSTEM

The production of pipes and fittings requires the supervision, regulation and control of all the working operations. All results are recorded and documented.

### OUR STANDARD INCLUDES:

- acceptance testing of raw materials and incoming goods;
- process control;
- inspection and testing of products;
- final inspection and sample tests on the production batches.

This procedure is required by the standard that regulates the Quality Management System (UNI EN ISO 9001) and the relevant protocols for the quality control of piping systems for the transport of water inside buildings (UNI EN ISO 15874, ASTM F2389, etc.).

### INTERNAL CONTROL

Skilled employees ensure that all assessments are carried out according to the appropriate regulations and fulfill all technical arrangements in accordance with the quality policy.

All internal quality controls are documented, recorded and stored in accordance with the provisions of law.



## 2.1.6 QUALITY ASSURANCE

### ACCEPTANCE OF INCOMING GOODS

All incoming goods are subject to specific tests that guarantee that incoming products conform to the specified requirements.

### INSPECTION AND TEST

The quality plan adopted by NUPIGECO requires that tests and inspections are carried out before and during the production process.

During the production phase, the quality plan establishes that products pass the following tests:

- dimensional check;
- surface check;
- marking check;
- control of process parameters.

The samples are collected and sent to the quality department that performs quality checks and performance testing on the products and submits them to various degrees and types of stress (pressure, temperature, oxidation, etc.).



## FINAL INSPECTION AND TESTING

The quality plan adopted by NUPIGECO requires that the inspections and tests are carried out on the entire production cycle.

All test results are documented in the test report and the certificate 3.1 (available on request).

Final tests include:

- internal pressure test at 95° C (time and pressure are specified in the reference standard);
- cold impact test;
- oxidation induction time;
- melt flow index;
- homogeneity test with polarized light microscopy;
- dimensional checks;
- elongation test with dynamometer;
- tensile test ( $> 23 \text{ N/mm}^2$ ) with dynamometer.

After the final tests, more tests are carried out on some batches:


- thermal cycle: pipes and fittings are subjected to temperature cycles lasting 15 minutes at 95° C and 15 minutes at 20° C with a pressure of 10 bar for a total of 5.000 cycles;
- oxidation induction time: determining the percentage of antioxidants in the product after the extrusion process;
- thermal stability at 110° C for 8.760 hours (= 1 year).

## STORAGE/PACKING/SHIPPING

Upon positive test results, the products are suitably packaged and stored in suitable warehouses.

The internal procedure regarding the method of packing, storage and shipping of products is represented by the following diagram.

## INTERNAL CONTROL - SYSTEM CONTROL

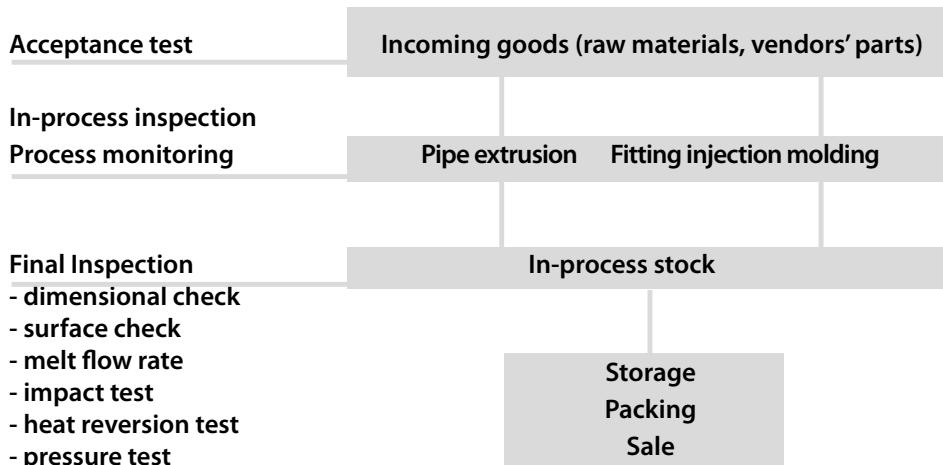

## EXTERNAL AUDIT

NUPIGECO submits its management and production system to external audits performed by third party certification bodies.


The external audit consists of tests carried out at given intervals.

Audit frequency depends on the procedure established by the specific standard and by each certification body.

The external supervision also provides:

- verification of the quality system;
- calibration of test equipment;
- hygiene and toxicity tests.


The results are confirmed by test certificates obtained by NUPIGECO.

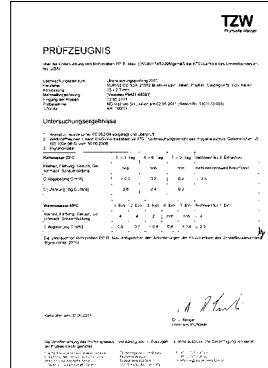



## REGRESSION CURVES FOR PP-R

UNI EN ISO 15874-2 (E)

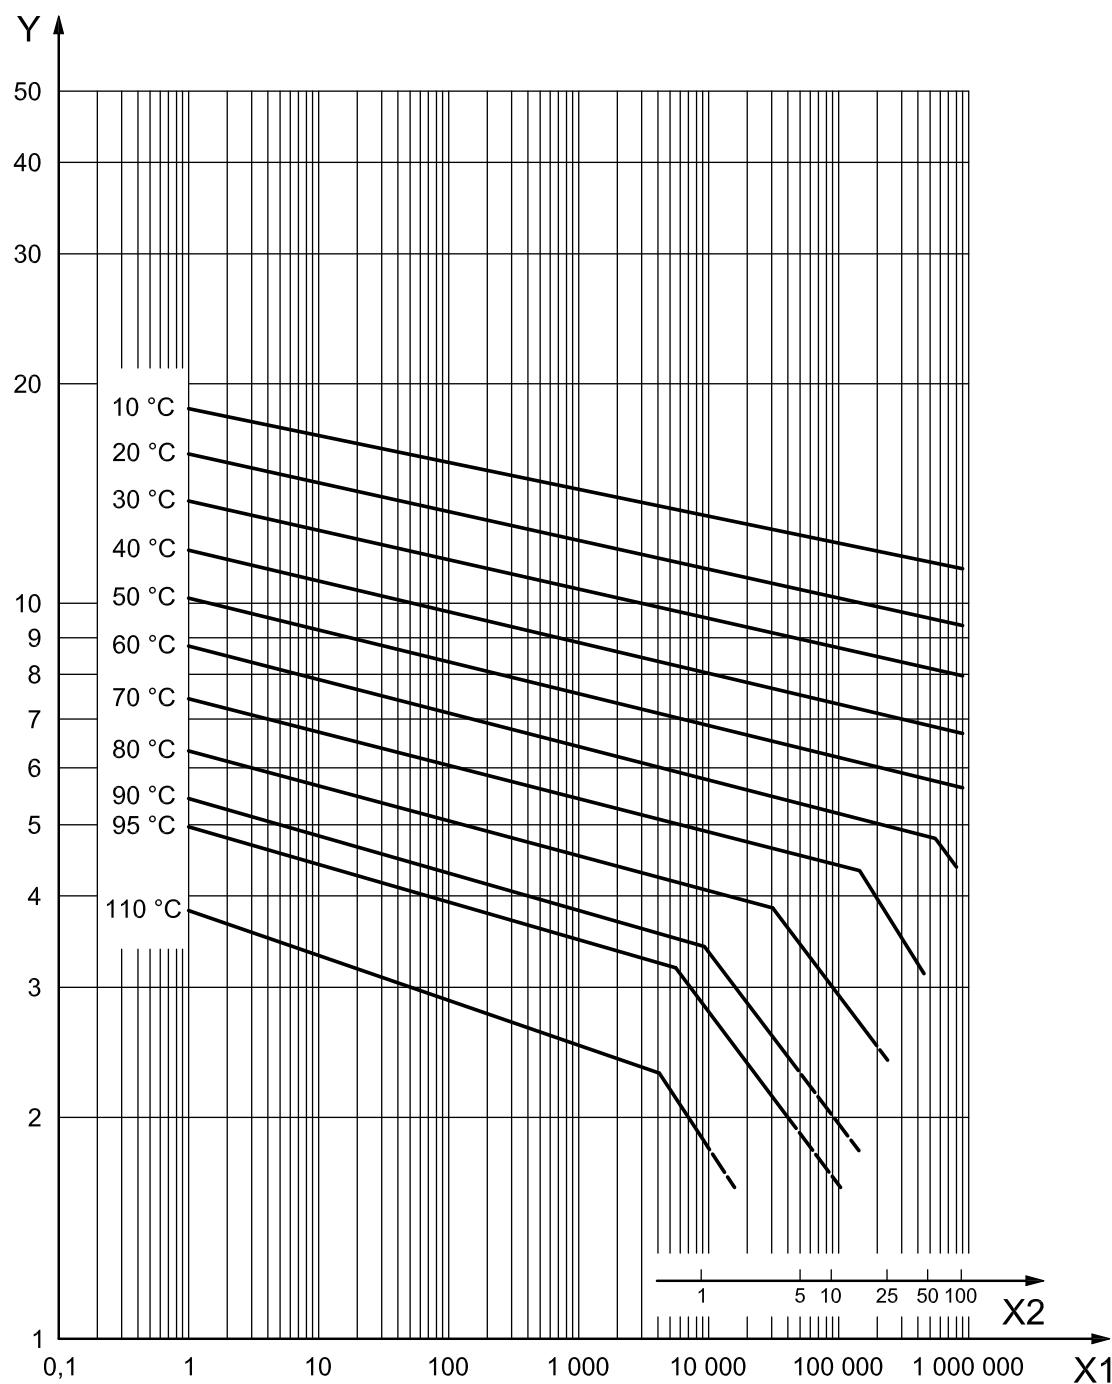

Key

X1 time,  $t_1$ , to fracture, in hours

Key


X1 time,  $t_1$ , to fracture, in hours

X2 time,  $t_2$ , to fracture, in years

Y hoop stress,  $\sigma$ , in megapascal

## REGRESSION CURVES FOR PP-RCT

UNI EN ISO 15874-2 (E)

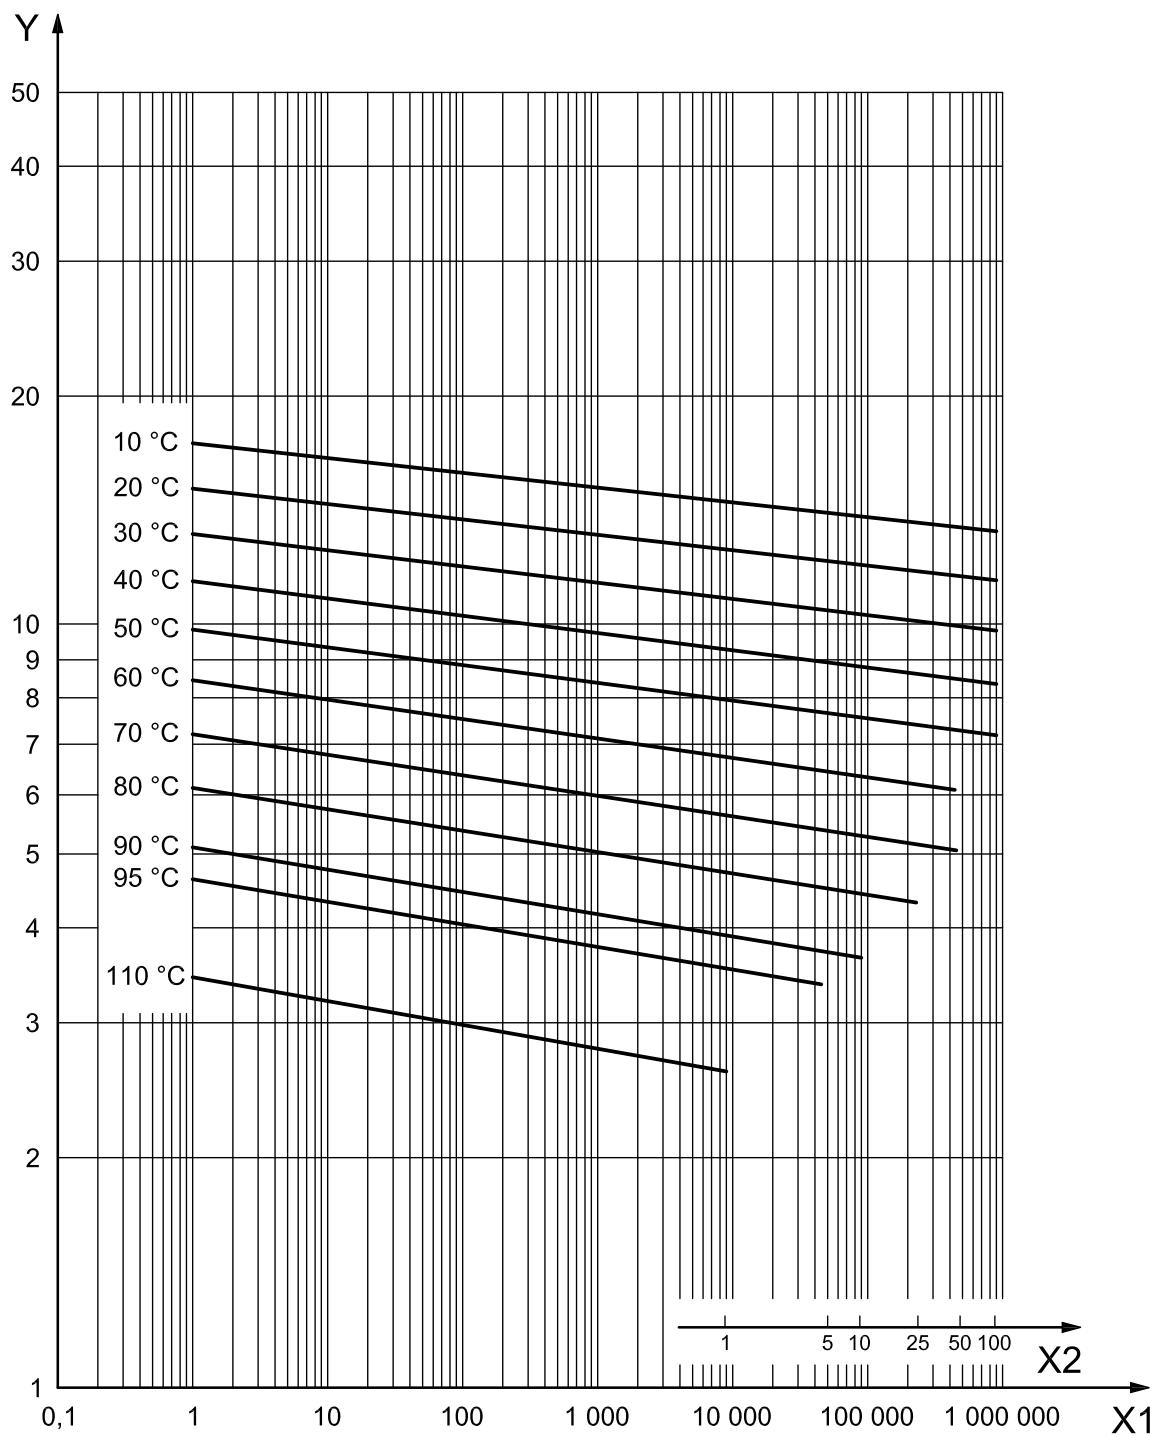

**Key**

X1 time,  $t_1$ , to fracture, in hours

X2 time,  $t_2$ , to fracture, in years

Y hoop stress,  $\sigma$ , in megapascal



## DIN 8077-09 - TABLE 9 ALLOWABLE OPERATING PRESSURES FOR PPR PIPES CONVEYING WATER

Safety factor (SF) = 1,25

T°	Years of service	S 2,5 SDR 6	S 3,2 SDR 7,4	S 4 SDR 9	S 5 SDR 11	S 8 SDR 17
ALLOWABLE OPERATING PRESSURE (bar)-(psi)						
10	1	42,10	33,40	26,50	21,10	13,30
	5	39,70	31,50	25,00	19,80	12,50
	10	38,60	30,70	24,40	19,30	12,20
	25	37,40	29,70	23,60	18,70	11,80
	50	36,40	28,90	23,00	18,20	11,50
	100	35,50	28,20	22,40	17,80	11,20
20	1	35,90	28,50	22,60	18,00	11,30
	5	33,70	26,80	21,30	16,90	10,60
	10	32,80	26,10	20,70	16,40	10,40
	25	31,70	25,20	20,00	15,90	10,00
	50	30,90	24,50	19,50	15,40	9,70
	100	30,10	23,90	18,90	15,00	9,50
30	1	30,50	24,20	19,20	15,30	9,60
	5	28,60	22,70	18,00	14,30	9,00
	10	27,80	22,10	17,50	13,90	8,80
	25	26,80	21,30	16,90	13,40	8,40
	50	26,10	20,70	16,40	13,00	8,20
	100	25,40	20,10	16,00	12,70	8,00
40	1	25,90	20,60	16,30	13,00	8,20
	5	24,20	19,20	15,30	12,10	7,60
	10	23,50	18,70	14,80	11,80	7,40
	25	22,60	18,00	14,30	11,30	7,10
	50	22,00	17,40	13,90	11,00	6,90
	100	21,40	16,90	13,50	10,70	6,70
50	1	21,90	17,40	13,80	11,00	6,90
	5	20,40	16,20	12,90	10,20	6,40
	10	19,80	15,70	12,50	9,90	6,20
	25	19,00	15,10	12,00	9,50	6,00
	50	18,50	14,70	11,60	9,20	5,80
	100	17,90	14,20	11,30	9,00	5,60
60	1	18,50	14,70	11,60	9,20	5,80
	5	17,20	13,60	10,80	8,60	5,40
	10	16,60	13,20	10,50	8,30	5,20
	25	16,00	12,70	10,10	8,00	5,00
	50	15,50	12,30	9,70	7,70	4,90
70	1	15,50	12,30	9,80	7,80	4,90
	5	14,40	11,40	9,10	7,20	4,50
	10	13,90	11,10	8,80	7,00	4,40
	25	12,10	9,60	7,60	6,00	3,80
	50	10,20	8,10	6,40	5,10	3,20
80	1	13,00	10,30	8,20	6,50	4,10
	5	11,50	9,10	7,20	5,70	3,60
	10	9,70	7,70	6,10	4,80	3,00
	25	7,80	6,20	4,90	3,90	2,40
95	1	9,20	7,30	5,80	4,60	2,90
	5	6,20	4,90	3,90	3,10	1,90

**DIN 8077-09 - TABLE 11 ALLOWABLE OPERATING PRESSURES FOR PP-RP PIPES CONVEYING WATER**
**Safety factor (SF) = 1,25**

T°	Years of service	S 3,2 SDR 7,4	S 4 SDR 9	S 8 SDR 17
<b>ALLOWABLE OPERATING PRESSURE (bar)-(psi)</b>				
<b>10</b>	1	36,20	28,80	14,40
	5	35,10	27,90	14,00
	10	34,70	27,50	13,80
	25	34,10	27,10	13,50
	50	33,60	26,70	13,40
	100	33,20	26,30	13,20
<b>20</b>	1	31,50	25,00	12,50
	5	30,50	24,20	12,10
	10	30,10	23,90	12,00
	25	29,60	23,50	11,70
	50	29,20	23,10	11,60
	100	28,80	22,80	11,40
<b>30</b>	1	27,30	21,70	10,80
	5	26,40	20,90	10,50
	10	26,00	20,60	10,30
	25	25,50	20,20	10,10
	50	25,10	19,90	10,00
	100	24,80	19,70	9,80
<b>40</b>	1	23,50	18,60	9,30
	5	22,60	18,00	9,00
	10	22,30	17,70	8,80
	25	21,80	17,30	8,70
	50	21,50	17,10	8,50
	100	21,20	16,80	8,40
<b>50</b>	1	20,10	15,90	8,00
	5	19,30	15,30	7,70
	10	19,00	15,10	7,50
	25	18,60	14,70	7,40
	50	18,30	14,50	7,20
	100	18,00	14,30	7,10
<b>60</b>	1	17,00	13,50	6,70
	5	16,30	13,00	6,50
	10	16,00	12,70	6,40
	25	15,70	12,40	6,20
	50	15,40	12,20	6,10
<b>70</b>	1	14,30	11,30	5,70
	5	13,70	10,90	5,40
	10	13,50	10,70	5,30
	25	13,10	10,40	5,20
	50	12,90	10,20	5,10
<b>80</b>	1	11,90	9,50	4,70
	5	11,40	9,00	4,50
	10	11,20	8,90	4,40
	25	10,90	8,60	4,30
<b>95</b>	1	8,90	7,10	3,50
	5	8,50	6,70	3,30
	10) <sup>a</sup>	(8,30)	(6,60)	(3,30)

<sup>a</sup>The values between parentheses apply in cases where it can be demonstrated that the test was carried out for more than a year at 110°C.



## DIN 8077-TABLE 10 ALLOWABLE OPERATING PRESSURES FOR PPR PIPES CONVEYING WATER

		Safety factor (SF) = 1,50				
T°	Years of service	S 2,5 SDR 6	S 3,2 SDR 7,4	S 4 SDR 9	S 5 SDR 11	S 8 SDR 17
		ALLOWABLE OPERATING PRESSURE (bar)-(psi)				
10	1	35,10	27,80	22,10	17,50	11,10
	5	33,00	26,20	20,80	16,50	10,40
	10	32,20	25,60	20,30	16,10	10,10
	25	31,10	24,70	19,60	15,60	9,80
	50	30,30	24,10	19,10	15,20	9,60
	100	29,60	23,50	18,60	14,80	9,30
20	1	29,90	23,70	18,80	15,00	9,40
	5	28,10	22,30	17,70	14,10	8,90
	10	27,40	21,70	17,20	13,70	8,60
	25	26,40	21,00	16,60	13,20	8,30
	50	25,70	20,40	16,20	12,90	8,10
	100	25,00	19,90	15,80	12,50	7,90
30	1	25,40	20,20	16,00	12,70	8,00
	5	23,80	18,90	15,00	11,90	7,50
	10	23,20	18,40	14,60	11,60	7,30
	25	22,30	17,70	14,10	11,20	7,00
	50	21,70	17,20	13,70	10,90	6,80
	100	21,10	16,80	13,30	10,60	6,60
40	1	21,60	17,10	13,60	10,80	6,80
	5	20,20	16,00	12,70	10,10	6,30
	10	19,60	15,50	12,30	9,80	6,20
	25	18,80	15,00	11,90	9,40	5,90
	50	18,30	14,50	11,50	9,20	5,80
	100	17,80	14,10	11,20	8,90	5,60
50	1	18,20	14,50	11,50	9,10	5,70
	5	17,00	13,50	10,70	8,50	5,30
	10	16,50	13,10	10,40	8,20	5,20
	25	15,90	12,60	10,00	7,90	5,00
	50	15,40	12,20	9,70	7,70	4,80
	100	14,90	11,80	9,40	7,50	4,70
60	1	15,40	12,20	9,70	7,70	4,80
	5	14,30	11,30	9,00	7,10	4,50
	10	13,90	11,00	8,70	6,90	4,30
	25	13,30	10,50	8,40	6,60	4,20
	50	12,90	10,20	8,10	6,40	4,00
	1	12,90	10,30	8,10	6,50	4,10
70	5	12,00	9,50	7,50	6,00	3,80
	10	11,60	9,20	7,30	5,80	3,60
	25	10,00	8,00	6,30	5,00	3,10
	50	8,50	6,70	5,30	4,20	2,60
	1	10,80	8,60	6,80	5,40	3,40
	5	9,60	7,60	6,00	4,80	3,00
80	10	8,10	6,40	5,10	4,00	2,50
	25	6,50	5,10	4,10	3,20	2,00
	1	7,60	6,10	4,80	3,80	2,40
	5	5,20	4,10	3,20	2,60	1,60

**DIN 8077-TABLE 12 ALLOWABLE OPERATING PRESSURES FOR PP-RP PIPES CONVEYING WATER**
**Safety factor (SF) = 1,50**

T°	Years of service	S 3,2 SDR 7,4	S 4 SDR 9	S 8 SDR 17
		ALLOWABLE OPERATING PRESSURE (bar)-(psi)		
<b>10</b>	1	30,20	24,00	12,00
	5	29,30	23,20	11,60
	10	28,90	22,90	11,50
	25	28,40	22,50	11,30
	50	28,00	22,20	11,10
	100	27,60	21,90	11,00
<b>20</b>	1	26,30	20,90	10,40
	5	25,40	20,20	10,10
	10	25,10	19,90	10,00
	25	24,60	19,60	9,80
	50	24,30	19,30	9,60
	100	24,00	19,00	9,50
<b>30</b>	1	22,70	18,10	9,00
	5	22,00	17,40	8,70
	10	21,70	17,20	8,60
	25	21,20	16,90	8,40
	50	20,90	16,60	8,30
	100	20,60	16,40	8,20
<b>40</b>	1	19,60	15,50	7,80
	5	18,90	15,00	7,50
	10	18,60	14,70	7,40
	25	18,20	14,40	7,20
	50	17,90	14,20	7,10
	100	17,60	14,00	7,00
<b>50</b>	1	16,70	13,30	6,60
	5	16,10	12,80	6,40
	10	15,80	12,60	6,30
	25	15,50	12,30	6,10
	50	15,20	12,10	6,00
	100	15,00	11,90	5,90
<b>60</b>	1	14,20	11,20	5,60
	5	13,60	10,80	5,40
	10	13,40	10,60	5,30
	25	13,10	10,40	5,20
	50	12,80	10,20	5,10
	100			
<b>70</b>	1	11,90	9,40	4,70
	5	11,40	9,10	4,50
	10	11,20	8,90	4,40
	25	10,90	8,70	4,30
	50	10,70	8,50	4,20
	100			
<b>80</b>	1	9,90	7,90	3,90
	5	9,50	7,50	3,70
	10	9,30	7,40	3,70
	25	9,10	7,20	3,60
	100			
<b>95</b>	1	7,40	5,90	2,90
	5	7,10	5,60	2,80
	10) <sup>a</sup>	(6,90)	(5,50)	(2,70)

<sup>a</sup>The values between parentheses apply in cases where it can be demonstrated that the test was carried out for more than a year at 110°C.



OD		SDR 6 - S 2,5 - FULL PIPE		SDR 7,4 - S 3,2 - FULL PIPE		SDR 7,4 - S 3,2 - MULTILAYER		SDR 9 - S 4 - FULL PIPE	
In	mm	kWh/m	kJ/m	kWh/m	kJ/m	kWh/m	kJ/m	kWh/m	kJ/m
16		1,41	5.060,00						
1/2"	20	2,20	7.912,00			2,05	7.360,00		
3/4"	25	3,40	12.236,00	2,94	10.580,00	3,20	11.500,00		
1"	32	5,56	19.964,00	4,74	17.020,00	5,12	18.400,00	3,94	14.167,12
1 1/4"	40	8,59	30.866,00	7,30	26.220,00	7,81	28.060,00	6,19	22.233,80
1 1/2"	50	13,31	47.840,00	11,26	40.480,00	12,03	43.240,00	9,50	34.128,28
2"	63	20,74	74.520,00	17,79	63.940,00	19,07	68.540,00	14,97	53.810,22
2 1/2"	75	29,31	105.340,00	25,47	91.540,00	27,01	97.060,00	21,16	76.050,48
3"	90	42,24	151.800,00	36,22	130.180,00	38,53	138.460,00	30,52	109.690,11
4"	110	62,98	226.320,00	54,40	195.500,00	57,22	205.620,00	45,36	163.014,26
	125	80,64	289.800,00	69,25	248.860,00	73,60	264.500,00	58,67	210.840,40
6"	160			112,51	404.340,00	119,17	428.260,00	95,49	343.165,06
8"	200			180,48	648.600,00	192,06	690.230,00	148,10	532.234,45
	250			282,88	1.016.600,00	300,42	1.079.620,00	229,85	826.032,43
10"	315					464,64	1.669.800,00	363,05	1.304.703,58
	355					588,80	2.116.000,00	460,15	1.653.671,74
16"	400							582,44	2.093.138,03
	450								
20"	500								
	560								
24"	630								

OD		SDR 9 - S 4 - MULTILAYER		SDR 11 - S 5 - FULL PIPE		SDR 11 - S 5 - MULTILAYER		SDR 17 - S 8 - MULTILAYER	
In	mm	kWh/m	kJ/m	kWh/m	kJ/m	kWh/m	kJ/m	kWh/m	kJ/m
16									
1/2"	20								
3/4"	25								
1"	32	4,20	15.088,00	3,33	11.960,00	3,58	12.880,00		
1 1/4"	40	6,54	23.506,00	5,12	18.400,00	5,50	19.780,00		
1 1/2"	50	10,12	36.386,00	8,06	28.980,00	8,58	30.820,00		
2"	63	16,14	58.006,00	12,67	45.540,00	13,31	47.840,00		
2 1/2"	75	22,67	81.466,00	17,54	63.020,00	18,43	66.240,00		
3"	90	32,64	117.300,00	25,47	91.540,00	26,62	95.680,00		
4"	110	48,50	174.294,00	37,12	133.400,00	39,68	142.600,00		
	125	62,54	224.756,00	49,15	176.640,00	51,46	184.920,00		
6"	160	102,23	367.402,00	79,62	286.120,00	83,20	299.000,00	55,42	199.180,00
8"	200	159,86	574.494,00	124,93	448.960,00	130,69	469.660,00	152,32	547.400,00
	250	248,61	893.458,00	192,00	690.000,00	201,98	725.880,00	189,44	680.800,00
10"	315	395,23	1.420.342,00	314,88	1.131.600,00	321,02	1.153.680,00	213,76	768.200,00
	355	501,80	1.803.338,00	399,36	1.435.200,00	399,36	1.435.200,00	271,36	975.200,00
16"	400	582,44	2.093.138,03	506,88	1.821.600,00	517,25	1.858.860,00	343,04	1.232.800,00
	450			641,28	2.304.600,00	641,28	2.304.600,00	433,92	1.559.400,00
20"	500							536,32	1.927.400,00
	560							672,00	2.415.000,00
24"	630							851,20	3.059.000,00

Test methods used to evaluate the fire behaviour differ according to the specific application. Our tests show that the raw material used to produce the **PPR PIPING SYSTEM** by **NUPIGECO** (blue and green versions) without flame retardants are classified as B2 MATERIALS, which means **NORMALLY FLAMMABLE**.

According to European Standard EN 13501 - Sheet 1 the worst fire behaviour class is class E.

At temperatures above 300° C, the polypropylene melts and starts decomposing and developing flammable gases at temperatures above 350° C.

According to ASTM D 1929 Standard, the self ignition temperature is approximately 360°C and the flash ignition temperature is 330°C.

The main products of complete combustion found in our raw material are carbon, carbon dioxide and water.

Other secondary products are carbon monoxide and hydrocarbons with low molecular weight.

The toxicity of the combustion gases depends on the content of carbon monoxide. The product of thermal degradation is less toxic than the one released by other types of combustion such as that of wood, in the same circumstances.


The oxygen index of our PPR without flame retardant is 18% (test carried out according to Standard ASTM D 2683 / ISO 4589).

The fumes are not particularly corrosive.

The lower heating power of the material is about 46.000 kJ/kg or 12,8 kWh/kg, similar to the value of fuel oil.

The tables indicating the combustion values on page 66 are based on the lower heating power of the material (in kWh/kg or kJ/kg) and the mass of the pipe (in kg/m).

# PPR PIPING SYSTEM

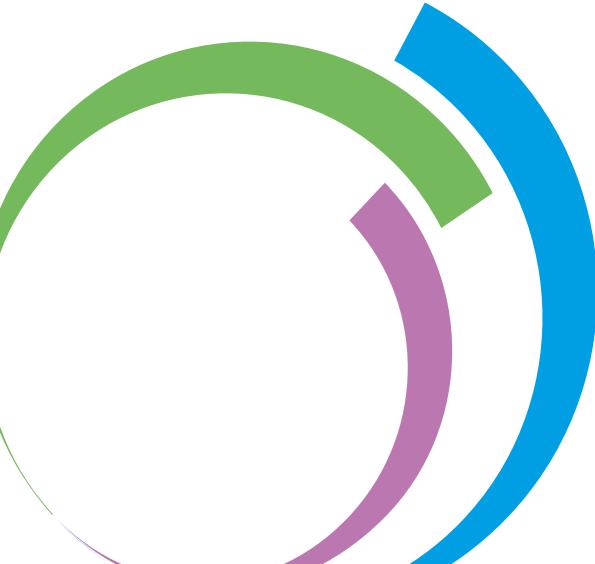

# 3

JOINING PROCEDURES



## 3.1 WELDING EQUIPMENT

Suitable equipment complying with guidelines DVS2207 shall be used for a fast and efficient installation of **PPR PIPING SYSTEM**:

- 1) Welder 800 W - 220V AC – 50 Hz model **00NSBEP** supplied in a special carrying case, complete with die pairs required for the welding of diameters 20 - 25 - 32. The welder is equipped with an automatic thermostat to maintain the temperature of the die pair constant at  $260 \pm 10$  °C and is available with a voltage of 110V or 48V upon request.
- 2) Welder on wheels (1400 W - 220V AC - 50 Hz) model **00STL125** is supplied on pallet complete with die pairs from diameter 25 to diameter 125 and pipe support.

Equipment	Item code	Power supply	16	20	25	32	40	50	63	75	90	110	125	160	200	250	315	355	400	450	500	560	630
	<b>00NSBEP</b>	220W 800W	X	X	X	X																	
	<b>00NSBEP63</b>	220W 800W	X	X	X	X	X	X	X	X													
	<b>00NPCC</b>	800W	X	X	X	X	X	X	X	X													
	<b>00NPCC125</b>	1400W	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X						
	<b>00STL125</b>	1400W			X	X	X	X	X	X	X	X	X	X	X	X	X						
	<b>00S10160</b>					X	X	X	X	X	X	X	X	X	X	X	X						
	<b>00S10250</b>							X	X	X	X	X	X	X	X	X	X						
	<b>00S10315</b>							X	X	X	X	X	X	X	X	X	X						
	<b>00E8500</b>	230W		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
	<b>00E9001</b>	230V		X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X

- 3) The **multi-function electrofusion welding machine** for electrofusion fittings is available in two models:
- with automatic insertion of the welding parameters, i.e. provided with a scanner to read the barcodes on the fitting to be welded (model **00E9001**);
  - with manual input of welding parameters (model **00E8500**).
- Both welding machines are equipped with a power cable 3,5 m long.  
The length of the connecting cables between the machine and the fitting is 3m.  
The total weight is 15kg.
- 4) The **welding machines for butt fusion fittings** differ according to the diameter to be welded:
- a. from Ø40mm to Ø160mm (model **00E10160**);
  - b. from Ø63mm to Ø250mm (model **00E10250**);
  - c. from Ø63mm to Ø315mm (model **00E10315**).

Each unit is supplied complete with:

- basic machine;
- heating plate;
- hydraulic control unit;
- electric milling machine;
- hydraulic hoses;
- adapters.


#### Technical data

Voltage	230V - Single phase 50/60 Hz (TE)	230V - Single phase 50/60 Hz (TE)
Working temperature		TFE: 260°C ( $\pm 1^\circ$ ) TE: 180 $\div$ 290°C
Ambient temperature		-5 $\div$ +40°C
Material		HDPE, PP, PP-R, PB, PVDF



Models	Ø Max diameter	Power supply	Dimensions (W x D x H)	Weight
<b>00NSBEP63</b>	63 mm	500 W	115 x 50 x 320 mm	1,44 Kg
<b>00NPCEE</b>	63 mm	800 W	175 x 50 x 360 mm	1,82 Kg
<b>00NPCC125</b>	125 mm	1400 W	115 x 50 x 396 mm	3,16 Kg



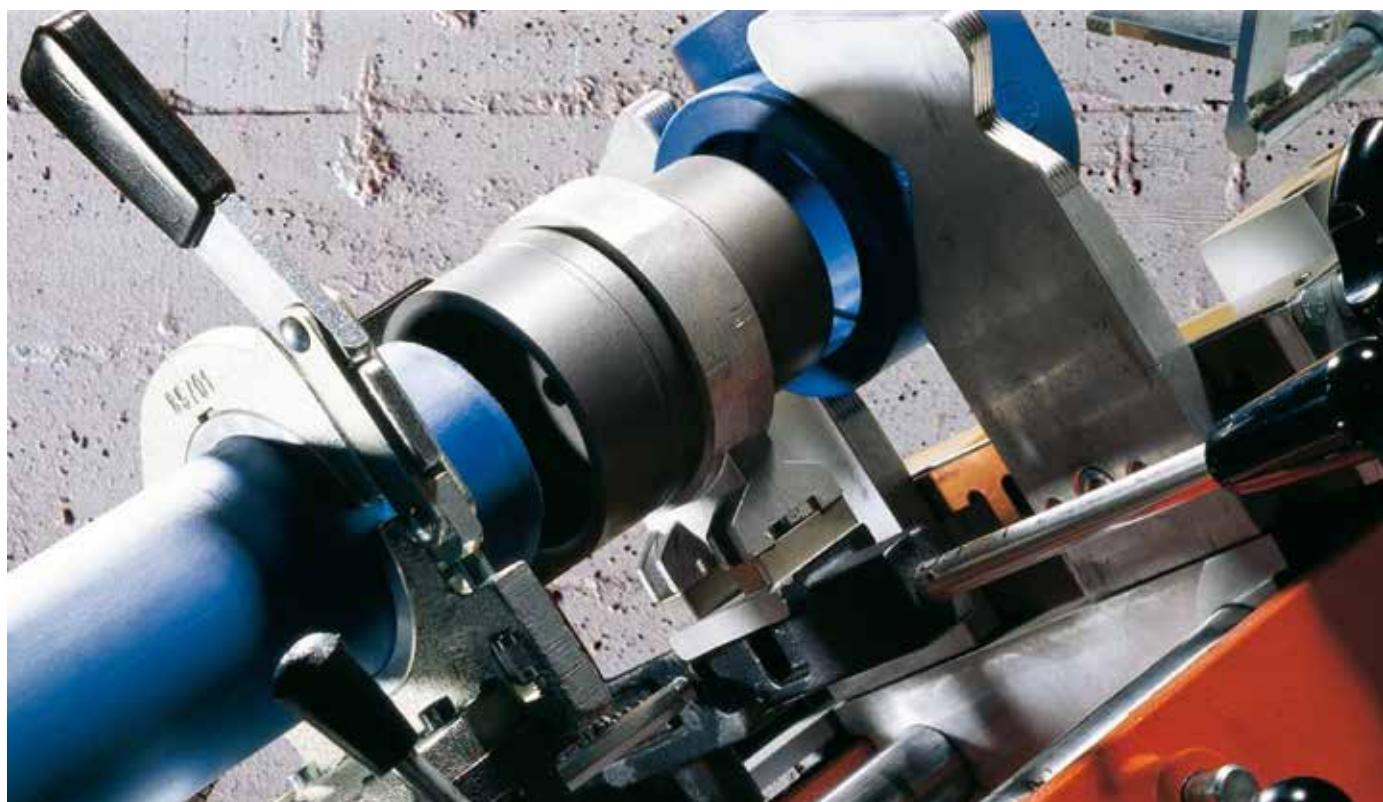

#### Technical Data



Working range	25 ÷ 125 mm	
Voltage	110V	230V
	Monophase - 50/60 Hz	
Total absorbed power	1400W	1400W
Working temperature	180 ÷ 280°C	
Room temperature range	-5°C ÷ +40°C	
Time to reach welding temperature	~ 10 min.	
Materials	PEAD, PP, PP-R, PB, PVDF	

#### Dimensions (W x D x H) and Weight

Machine	1080 x 840 x 580 mm
Carrying case	1500 x 800 x 1300 mm
Weight	100 kg



## 3.2 POLYFUSION WELDING

### 3.2.1 WARNINGS AND PRELIMINARY RECOMMENDATIONS


POLYFUSION welding is one of the most widely used junction techniques for the installation of PPR systems. There are just a few and simple steps necessary to complete it but they need the greatest attention.

#### **Welding equipment check**

It is necessary to evaluate the efficiency of the equipment and tools to be used.

In particular you should carry out the following operations:

- check the functioning of the thermostat by measuring the temperature on the surface of the die pairs with an appropriate contact thermometer ( $260^{\circ}\text{C}$ );
- if you are using a polyfusion welder, check the functioning of the clamps and the handling system of the welding machine so as to ensure the proper alignment of the parts to be welded;
- check the integrity of the non-stick coating of the die pairs.

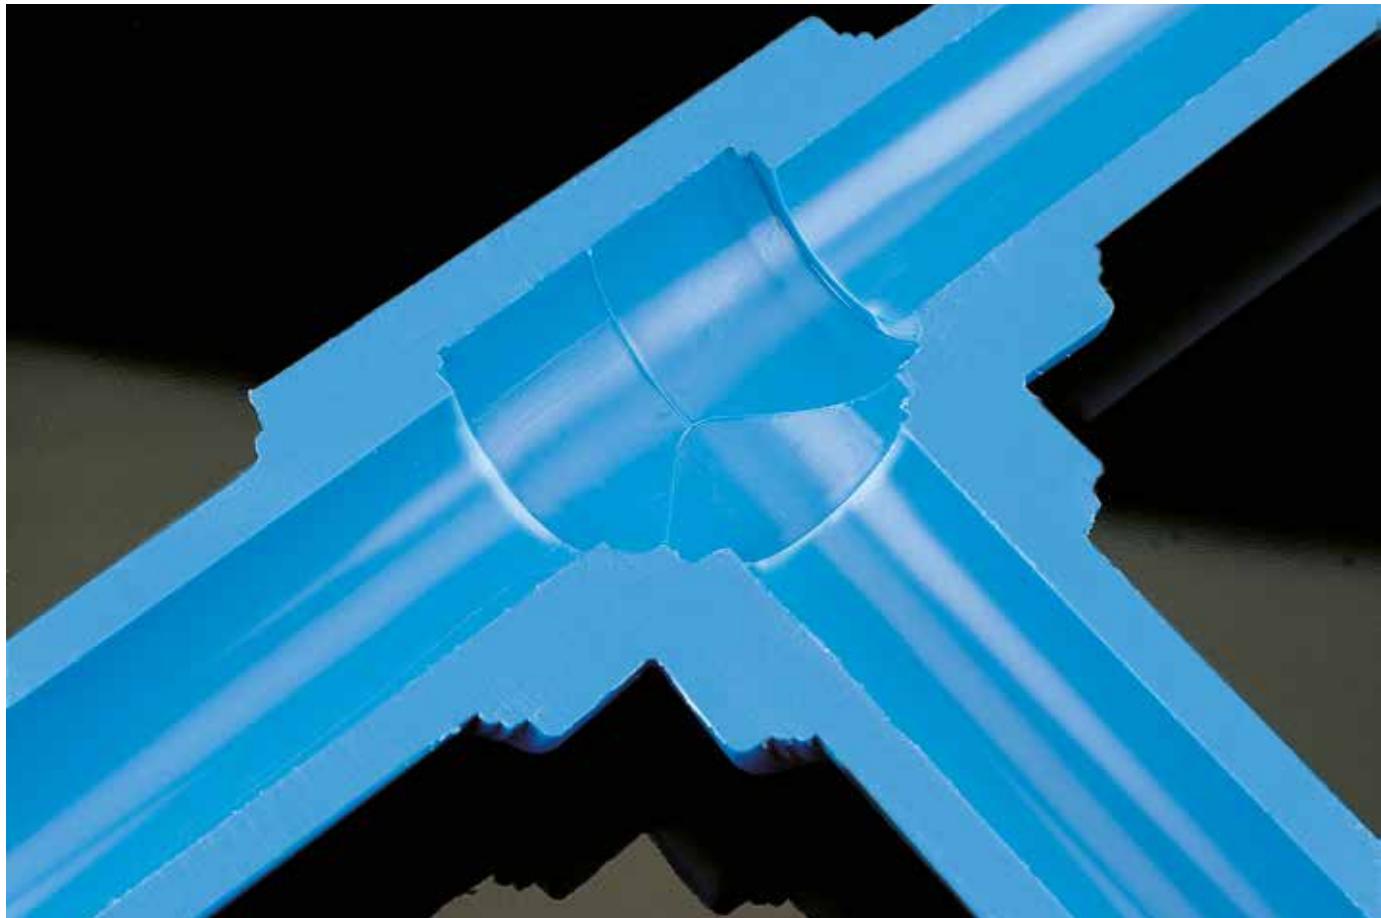



If a perfect polyfusion welding of the **PPR PIPING SYSTEM** by **NUPIGECO** has been carried out, the section of the junction does not show any difference of material between the pipe and the fitting, proving correct molecular fusion.

### 3.2.2 POLYFUSION WELDING: FITTINGS



Assemble the die pairs on the cold plate and connect the welder to the power network.

Wait for the sound signal (see the user's manual of the welder) that informs that the required temperature has been reached.



Cut the pipe perpendicularly to its axis using the suitable pipe cutter.




Inside the case that contains the welder you will find a sheet that shows the welding parameters (diameter, pipe insertion depth, heating time, fusion time and time prior to testing).




Mark the insertion length on the pipe.

Mark a longitudinal sign as a reference on the external surfaces of the pipe and fitting to avoid turning the components to be welded while performing the welding procedure (do not cut the surface of the pipe and fitting).

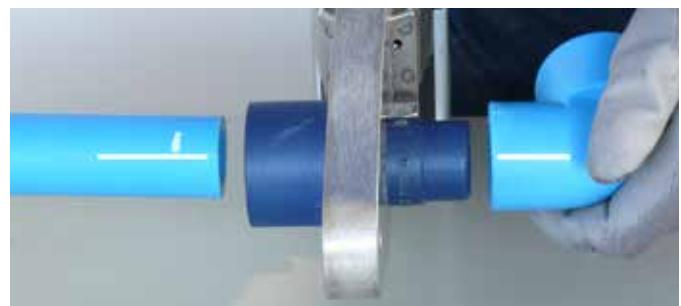


Place the ends to be welded close to each other to be able to begin the heating process of the material simultaneously.

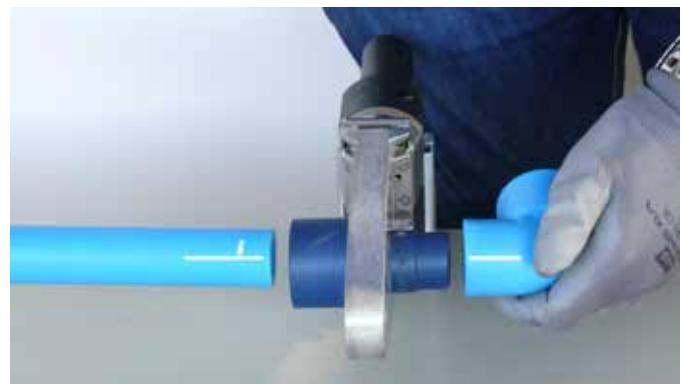


After checking the surface temperature of the die pairs, insert the pipe inside the female die pair without rotating it and the fitting into the male die pair up to the sign previously marked for the heating time  $t_1$  as shown in table A (page 76). Do not heat up the parts to be welded twice.



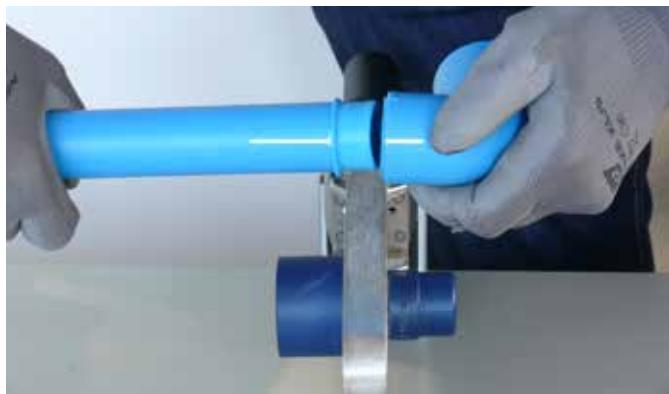

After the heating time, quickly remove the elements from the die pairs and insert them one inside the other, within time t2, until you reach the insertion depth previously marked. Be careful not to rotate the pipe into the fitting and carefully align the reference longitudinal signs.

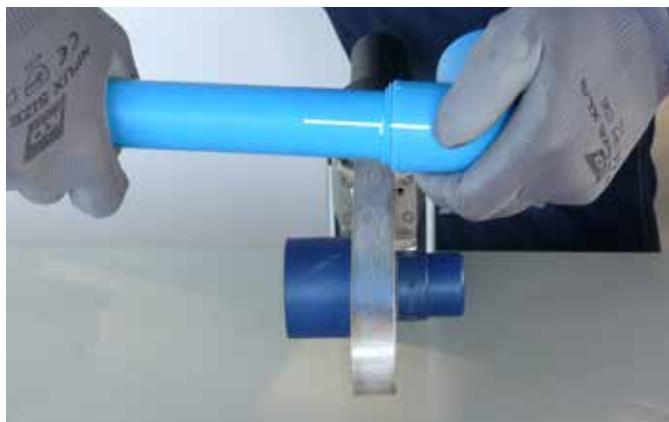

Once the assembly is complete it is possible to **TEST** it according to the indications as per Standards CEN TR 12108 and EN806-4).

**TABLE A**

<b>Ø</b>	<b>Heating sec (t1)</b>	<b>Assembly sec (t2)</b>	<b>Test after min</b>	<b>Pipe insertion mm</b>	<b>Welding procedure (Standard DVS 2207 – Sec. 1-6.1)</b>
16	5	4	2	13	
20	5	4	2	14	
25	7	4	3	15	
32	8	6	4	17	
40	12	6	4	18	
50	18	6	4	20	
63	24	8	6	26	
75	30	8	6	29	
90	40	8	6	32	
110	50	10	8	35	
125	60	10	8	40	
160					
200				Butt fusion welding or electric socket welding	• With suitable equipment
250					
315					
355					
400					
450				Butt fusion welding	• With suitable equipment
500					
560					
630					

### 3.2.3 POLYFUSION WELDING: WELDING SADDLES

Threaded and not threaded welding saddles allow to make intervals or derivations on large section pipes already installed and also pipe arrays for water meters.

Drill a hole in the pipe with the suitable cutter (item code 00FGS) at the point where you want to make a new derivation.




Make sure that the parts to be welded (especially the pipe) are clean and dry.



Check that the welder and die pairs have reached the correct operating temperature (260° C).



Insert the male die pair into the pipe hole until the concave part touches the outer surface of the pipe.

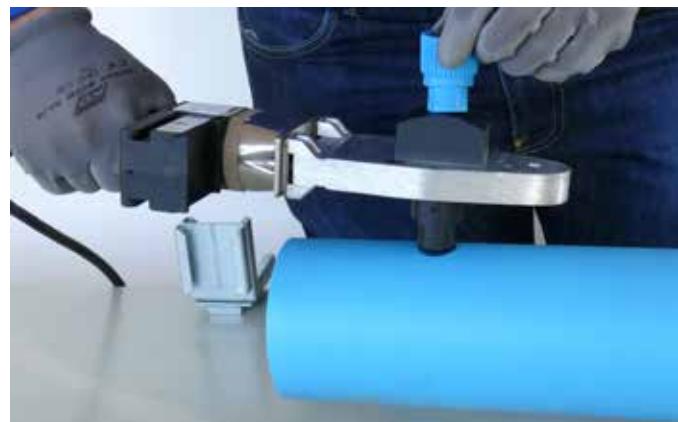




Insert the fitting into the female die pair simultaneously. The contact time between die pairs, fitting and pipe shall be those listed in the relevant table.



Once the heating time is over, immediately insert the welding saddle into the heated hole without turning. The fitting must be perfectly fixed and pressed against the pipe surface for about 30 seconds.



After a cooling time of 10 minutes, the new joint can support the operating parameters.

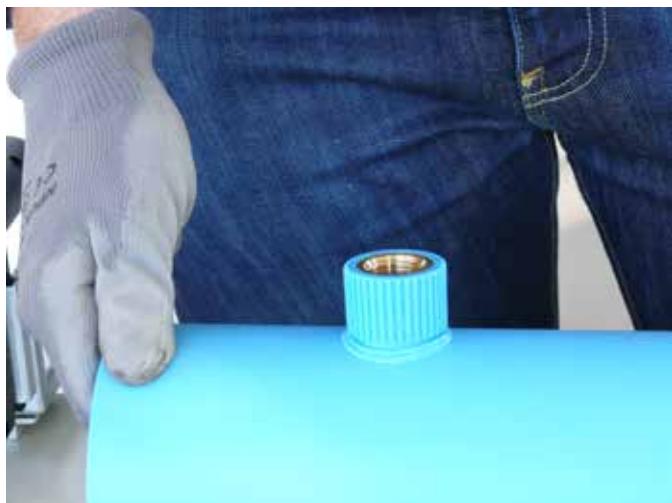

When making double pipe arrays for water meters we suggest to:


- mark in advance the two opposing drilling axes;
- make all the holes at the same time with the suitable cutter;
- make the joints staggered between them.

### 3.2.4 DIMENSIONAL TABLE FOR WELDING SADDLES



Code	Type	$\emptyset$	DN1	DN2	D1
<b>03NGS5020</b>	A	50/25x20	50	20	25
<b>03NGS5025</b>	A	50/25x25	50	25	25
<b>03NGS6320</b>	A	63/25x20	63	20	25
<b>03NGS6325</b>	A	63/25x25	63	25	25
<b>03NGS6332</b>	A	63/32x32	63	32	32
<b>03NGS7520</b>	A	75/25x20	75	20	25
<b>03NGS7525</b>	A	75/25x20	75	25	25
<b>03NGS7532</b>	A	75/32x32	75	32	32
<b>03NGS9020</b>	A	90/25x20	90	20	25
<b>03NGS9025</b>	A	90/25x20	90	25	25
<b>03NGS9032</b>	A	90/32x32	90	32	32
<b>03NGS11020</b>	A	110/25x20	110	20	25
<b>03NGS11025</b>	A	110/25x20	110	25	25
<b>03NGS11032</b>	A	110/32x32	110	32	32
<b>03NGS12563</b>	B	125/63x63	160	40	40
<b>03NGS16040</b>	B	160/40x40	125	63	63
<b>03NGS16063</b>	B	160/63x63	160	63	63

Code	Thread (F)	$\emptyset$	DN	D1
<b>03NGSF4012</b>	1/2"	40/25	40	25
<b>03NGSF5012</b>	1/2"	50/25	50	25
<b>03NGSF6312</b>	1/2"	63/25	63	25
<b>03NGSF7512</b>	1/2"	75/25	75	25
<b>03NGSF9012</b>	1/2"	90/25	90	25
<b>03NGSF11012</b>	1/2"	110/25	110	25
<b>03NGSF5034</b>	3/4"	50/25	50	25
<b>03NGSF6334</b>	3/4"	63/25	63	25
<b>03NGSF7534</b>	3/4"	75/25	75	25
<b>03NGSF9034</b>	3/4"	90/25	90	25
<b>03NGSF11034</b>	3/4"	110/25	110	25
<b>03NGSF631</b>	1"	63/32	63	32
<b>03NGSF751</b>	1"	75/32	75	32
<b>03NGSF901</b>	1"	90/32	90	32
<b>03NGSF1101</b>	1"	110/32	110	32

Type A

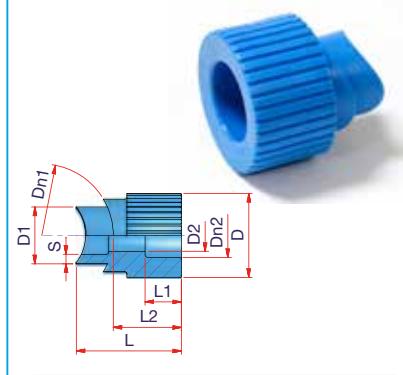

Type B

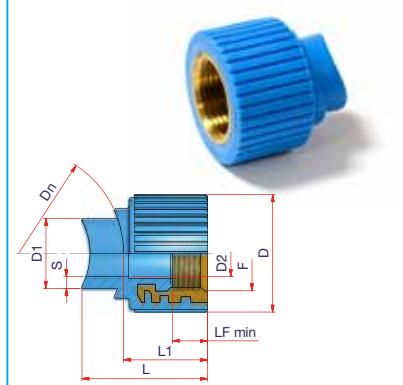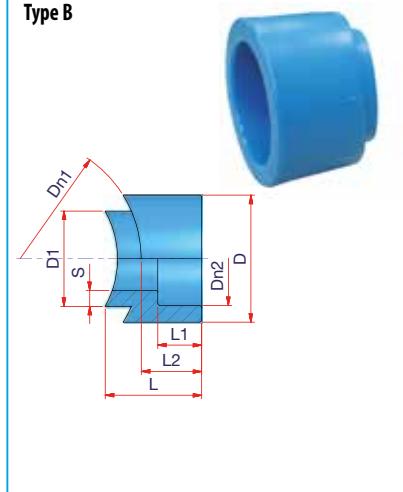

00FGS25 ø 25  
00FGS32 ø 32

00MATGS40	ø 40/25
00MATGS50	ø 50/25
00MATGS63	ø 63/25
00MATGS75	ø 75/25
00MATGS7532	ø 75/32
00MATGS90	ø 90/25
00MATGS110	ø 110/25
00MATGS6332	ø 63/32
00MATGS9032	ø 90/32
00MATGS11032	ø 110/32



### 3.2.5 POLYFUSION WELDING: REPAIR OF A DAMAGED PIPE

This system applies when a pipe or a fitting have been pierced just from one side and perpendicularly to their axis.



Enlarge the hole up to a diameter of 6 mm or 10 mm with a suitable tip.

Make sure that the previous hole has not damaged the other inner surface of the pipe or fitting.



Insert the male die pair into the pipe hole and the repair cap into the female die pair.

After the insertion, heat up for 5 seconds.



Once the heating time is over, insert the male cap inside the hole without rotating it.


Wait for a cooling time of 1 minute and cut the cap.



The picture shows how the pipe looks after the repair.



### 3.3 ELECTROFUSION WELDING

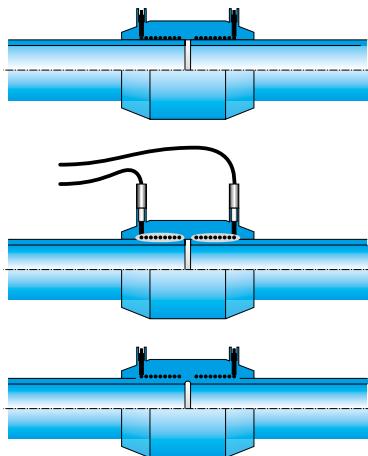

Electrofusion fittings are manufactured with a molded-in-place resistance wire which can be connected to suitable welding machines by means of a set of connecting wire leads.

When voltage is applied and electrical energy goes through, this resistance generates the heat needed to melt the PPR.

Energy is directly transmitted to the contact surface between the fitting and the pipe causing heat welding of the parts.

The main features of PPR PIPING SYSTEM electrofusion fittings are the high quality and the reliability of the joints. When it cools down, the joint is homogeneous, strong, safe and reliable.



#### **WELDING BARCODE** (in conformity with standard ISO13956)

Scan the barcode with the barcode scanner or manually enter the welding parameters of time and voltage reported on the barcode. You can carry out the welding procedure by using the multifunction welding unit in automatic mode (with barcode scanner) or in manual mode. In case of automatic welding, always check time and voltage parameters on the display after scanning the barcode. In case of manual welding, use time and voltage parameters indicated on the barcode. If the welding unit does not perform welding time compensation according to ambient temperature, use the parameters on the bag label.

**N.B.:** Keep at a safe distance during the welding procedure.




Use the PPR PIPING SYSTEM welding units and follow the instructions below to obtain a reliable weld.

Cut the pipes at right angles with a pipe cutter.



Scrape the pipe surface and the fitting spigot uniformly with the appropriate pipe scraper. Scrape at least 1 cm beyond the insertion length of the fitting to completely remove the oxidized polypropylene layer.

Mechanical scrapers are recommended. Hand scrapers can be used.

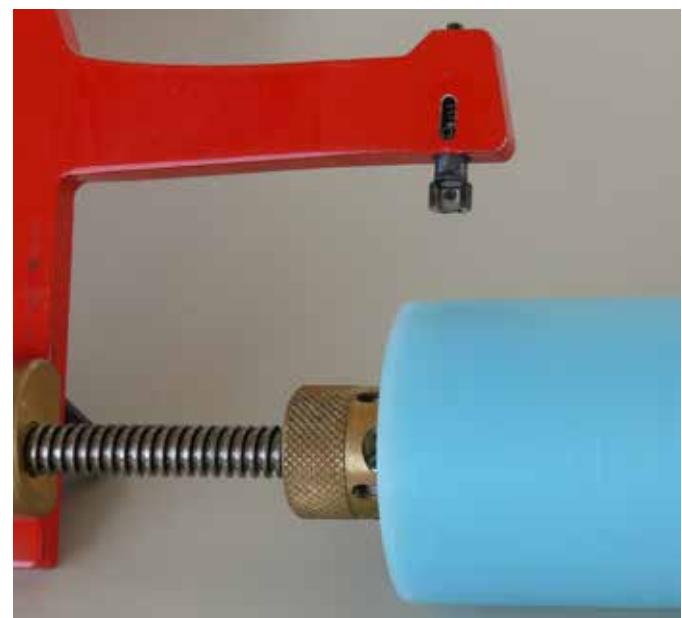

Remove any mud, dust, grease or other traces of dirt from the pipe or spigot ends and the welding area of the fitting. Use only isopropanol (isopropyl alcohol) and a soft clean wiping cotton cloth. Wait until the cleaned parts are completely dry.





Measure the insertion length of the pipe inside the fitting.



Mark the welding length on the pipe (equal to the length of the electrofusion fitting socket) with the appropriate marker.



Insert the pipe or spigot ends into the fitting up to the marked insertion length (position the aligners in order to keep the position and avoid any mechanical stress during the welding procedure and cooling time if necessary).

AVOID ANY MECHANICAL STRESS ON THE WELDING AREA DURING THE WELDING PROCEDURE AND THE COOLING TIME.

### IMPORTANT

Please refer to the user's manual of the welding machine for its correct use.

Prepare the pipe and fitting to be welded following the directions in the previous chapter. Make sure that the pipe and fitting to be welded are lined up without any possibility of movement (use a suitable aligner if necessary).

Connect the welding cables to the fitting connectors, scan the barcode with the barcode scanner or enter the welding parameters manually.



### ATTENTION!

Always check the welding parameters before starting the welding procedure.



At the end of the welding procedure, disconnect the cables and wait for the cooling time indicated on the barcode.

The welding data can be downloaded using a USB pen drive or instantly printed through a printer. The exact position of the joint can be recorded with the Bluetooth GPS device (only for model E9001).

When the cooling time is over, remove the aligners and start the pressure test by using the pressure test unit.






### 3.3.1 INSTRUCTIONS FOR THE WHITE BLUE AND DARK SYSTEMS

The installation of WHITE BLUE and DARK systems carried out using ELECTROFUSION FITTINGS rather than BUTT FUSION WELDING FITTINGS needs further attention, especially during the preparation of the pipe.

It is essential to completely remove the outer layer of the material until the PPR layer can be seen clearly. This operation makes the welding procedure fully reliable. If it is not performed, the fusion between the PPR used for the production of the fittings and the oxygen barrier or the UV protection layer does not occur.

**NIRON®**  
WHITE BLUE PPR PIPE

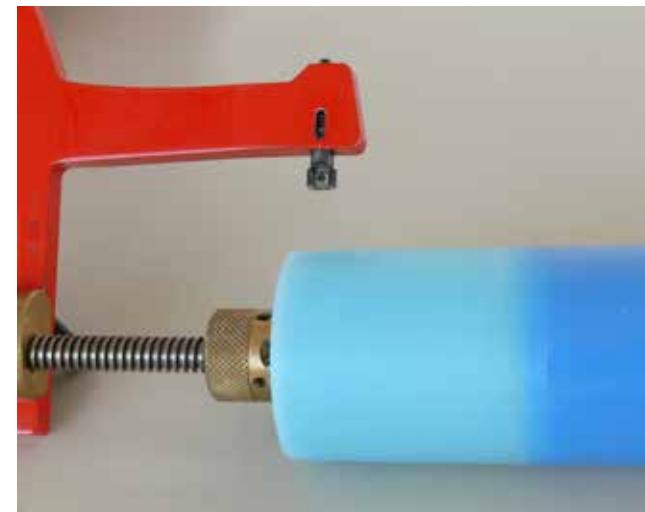

**NIRON®**  
DARK PPR PIPE



## 3.4 BUTT FUSION WELDING

### 3.4.1 INTRODUCTION

The welding process consists in the joining of two elements (pipes and/or fittings) of equal diameter and thickness in which the surfaces to be welded are heated until melting by contact with a heating element and then, after its removal, are butt joined by pressure welding.

The instructions below are for guidance only. Unlike socket fusion, butt fusion welding implies that the operators are suitably trained on the use of welding machines and have a thorough knowledge of the procedures to be performed.

#### ATTENTION!

Each manufacturer of BUTT FUSION WELDING equipment publish his/her own reference literature based on the working parameters of the equipment produced.

The user SHALL REFER to this specific literature for every detail not expressly stated and for any reference information regarding the equipment.

### 3.4.2 RECOMMENDATIONS AND WARNINGS

To perform a proper fusion procedure and ensure a reliable joint, it is necessary to remember the following steps:

- the working temperature of the heating element shall be checked using a calibrated contact thermometer. This measurement shall be done after about 10 minutes from the moment when the nominal temperature is reached, allowing the heating element to heat up evenly over the entire section;
- check the surface of the heating element (integrity of the non-stick layer) and properly clean it by using soft paper or cloth, free of fibers;
- check the proper functioning of the welding machine;
- check the efficiency of the clamp supports of the welding machine so that the correct alignment of the pieces to be welded and the parallelism of the surfaces touching each other are ensured;
- check the drag force of the movable trolley, both as friction and in relation to the load being handled (pipes and/or fittings);
- check the efficiency of the measuring equipment (pressure gauge and timer);
- check that the pipes and/or fittings to be welded are of the same diameter and thickness (SDR);
- the planing tool supplied with the welding machine shall mill and align the pipes and fittings frontally and also absorb the pressures developed during the welding process without deforming the welding point irreversibly;
- the welding machine should be prepared for use according to the manufacturer's instructions.




### 3.4.3 BUTT FUSION WELDING PROCEDURE



#### PREPARATION FOR WELDING

##### Cleaning the surfaces

Before positioning the parts to be welded, clean the welding area to remove any dust, grease or dirt.

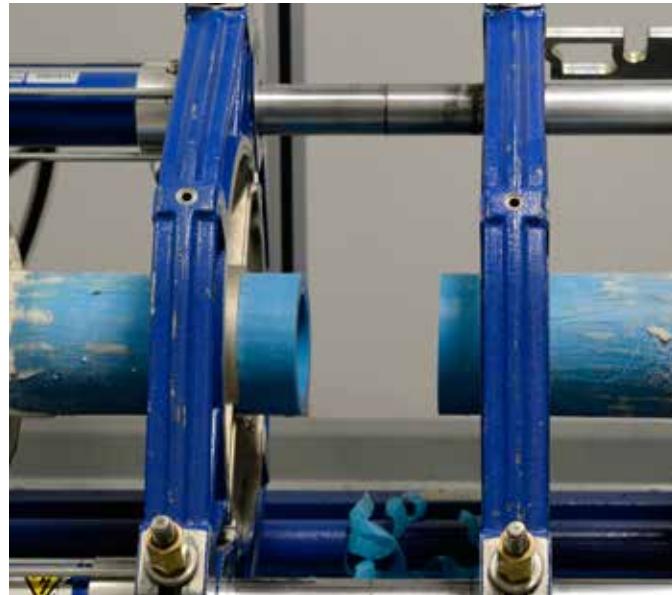

##### Locking the ends

The pipes and/or fittings must be locked in the clamps of the welding machine so that the contact surfaces to be welded are aligned between them. The possibility of axial movement without significant friction shall be ensured by using rollers or oscillating suspensions to allow the pipe sliding to remove any mechanical stress from the clamps resulting from the weight of the locked pipes.

The pipes and/or fittings shall be positioned so as to contain the misalignment within 10%. To obtain this result, rotate at least one of the elements until the most favorable coupling condition is reached and/or the locking force exerted on the fastening systems of the clamps is not excessive as it could damage the surfaces of the components.

## Milling the edges to be welded

The ends of the two components to be welded shall be milled to ensure adequate parallelism and to remove any trace of oxide.

The milling operation shall be carried out by bringing the parties close to each other only when the milling cutter inserted between them is working and by exerting gradual pressure so as not to stop the tool and prevent excessive heating of the surfaces in contact.

The milling chips must be formed continuously on both edges to be welded: otherwise, investigate the cause and repeat the process until the required result is reached.



The milling machine must be turned off only after the removal of the ends to be welded.

After the milling procedure is finished, milling chips shall be removed from the inner surface and the surrounding area of the elements to be welded, by using a brush or a clean cloth, free of fibers, fluff and lint, and not synthetic soaked in a suitable cleaning liquid (e.g. isopropyl alcohol, trichloroethane chlorothene). Do not use any solvent such as gasoline, denatured alcohol or trichlorethylene.

The milled surfaces shall not be touched or otherwise contaminated.



At the end of this phase, by bringing the two ends into contact, the space between the two edges must not exceed the value of 0,5 mm.



## WELDING PROCEDURE

### Welding procedure by means of contact heating elements

The butt fusion welding of pipes and/or fittings by means of contact heating elements shall be carried out following the different steps of the welding procedure shown in the drawing.

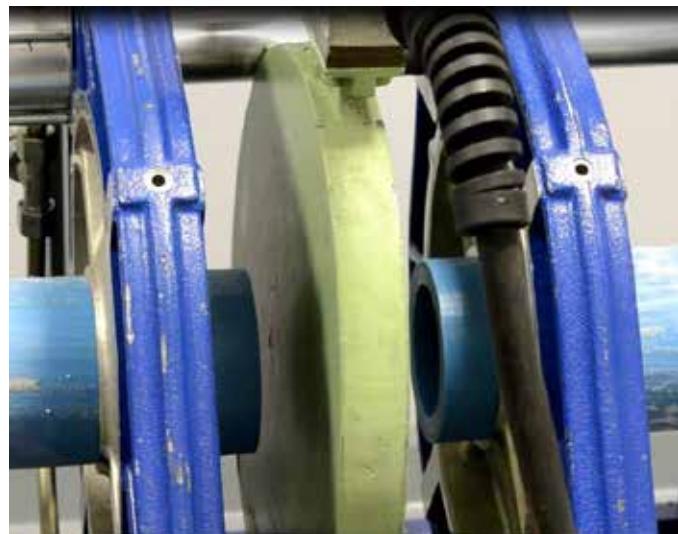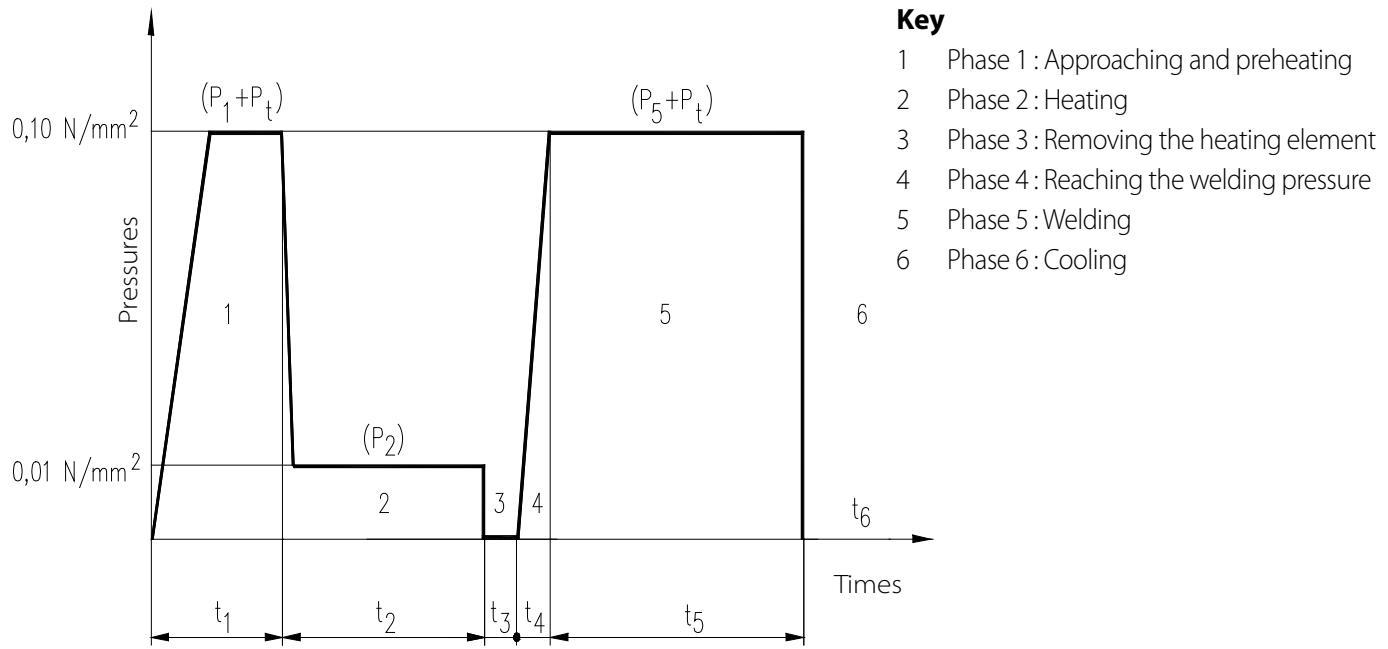

## WELDING PHASES

### Phase 1: Approaching and preheating


Place the heating element on the welding machine, taking care to insert it properly in order to ensure its stability on the supports of the machine base.

Place the edges close to the heating element, apply the pressure ( $P_1 + P_t$ ) for a time  $t_1$  and wait until the bead has reached height  $h$  on both welding edges, as shown in table 2 (page 92).

## Phase 2: Heating

Once the bead has reached height  $h$ , the contact pressure between the edges and the heating element is reduced to the value  $P_2$ .


Keep the edges in contact with the heating element for the time  $t_2$  shown in table 2.

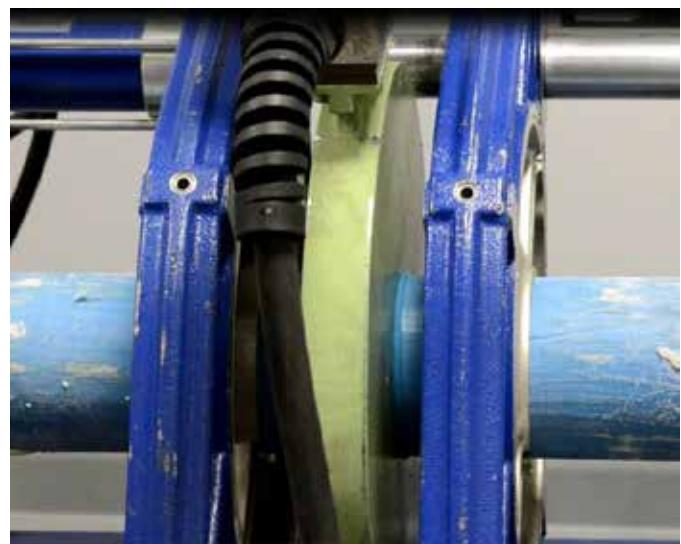

## Phase 3: Removing the heating element

Remove the heating element, making sure not to damage the edges of the two parts to be welded.

The removal must be rapid to avoid excessive cooling of the heated edges. Time  $t_3$ , in seconds, from the removal of the heating element to the contact with the edges (phase 4), however, must be consistent with what is reported in table 2.

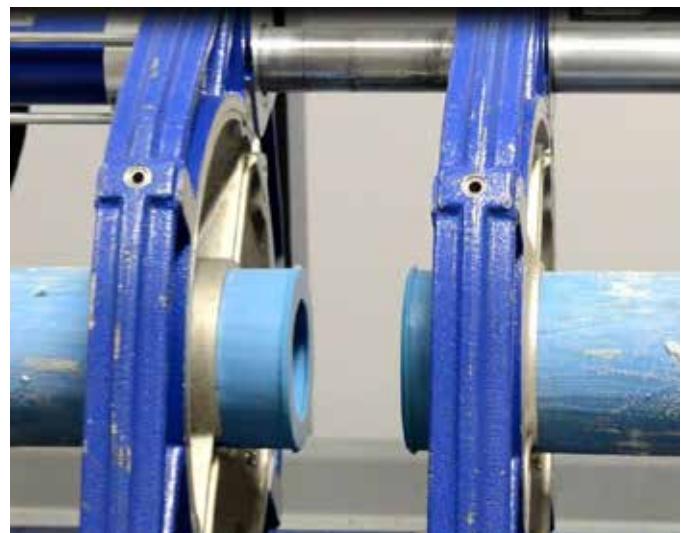


## Phase 4: Reaching the welding pressure

Once the heating element has been removed, bring the edges into contact. Gradually increase pressure until the value ( $P_5 + P_t$ ) (phase 5) is reached and, anyway, so as to prevent excessive leakage of melted material from the edges in contact. Reaching the welding pressure ( $P_5 + P_t$ ) must take the amount of time  $t_4$  shown in table 2.

## Phase 5: Welding

Keep the edges in contact under pressure ( $P_5 + P_t$ ) for a time  $t_5$ , expressed in minutes, as shown in table 2.

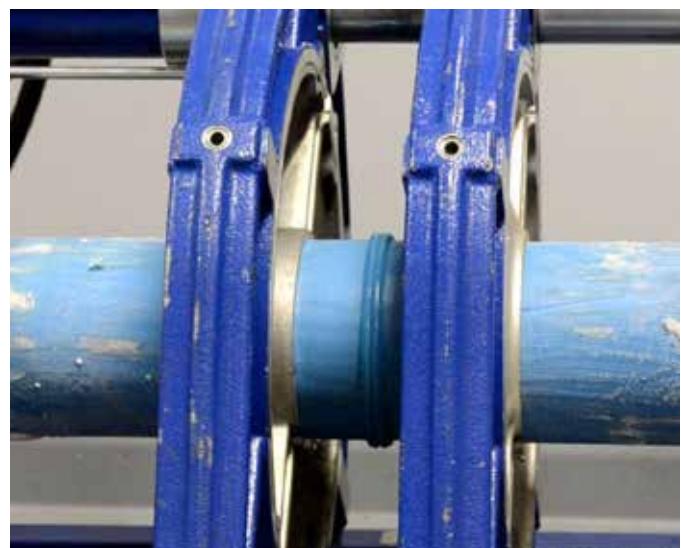



### Phase 6: Cooling

Once the welding time is over (phase 5), the welded joint can be removed from the welding machine, without being subjected to significant stress. Wait until complete cooling to ambient temperature.

**Table 2: Parameters for welding by contact**

Wall thickness $e_n$ (mm)	Approaching and Preheating  Minimum height of the bead at the end of preheating time under pressure $P_1$ of $0,10 \text{ N/mm}^2$	Heating  Pressure $\leq 0,01 \text{ N/mm}^2$	Removing the heating element	Reaching the welding pressure	Welding
					Pressure = $0,10 \text{ N/mm}^2$ $\pm 0,01$
from .... to	h (mm)	Time $t_2$ (s)	Time $t_3$ max (s)	Time $t_4$ max (s)	Time $t_5$ min (min)
2,0 .... 4,5	0,5	from .... to 60 .... 135	from ... to 4 ..... 5	from ... to 5 ..... 6	from ... to 3 ..... 6
4,5 .... 7	0,5	135 .... 175	5 ..... 6	6 ..... 7	6 ..... 12
7 .... 12	1,0	175 .... 245	6 ..... 7	7 ..... 11	12 ..... 20
12 .... 19	1,0	245 .... 330	7 ..... 9	11 ..... 17	20 ..... 30
19 .... 26	1,5	330 .... 400	9 ..... 11	17 ..... 22	30 ..... 40
26 .... 37	2,0	400 .... 485	11 ..... 14	22 ..... 32	40 ..... 55
37 .... 50	2,5	485 .... 560	14 ..... 17	32 ..... 43	55 ..... 70

N.B.: for thickness values other than those listed, interpolate times linearly for each scheduled interval.



# PPR PIPING SYSTEM



# 4

TECHNICAL DATA



## 4.1 CHEMICAL, PHYSICAL AND MECHANICAL PROPERTIES OF PPR

Characteristics	Test method	Values	Unit of measure	
Volumic mass	ISO 1183	0,898	g/cm <sup>3</sup>	
Yield strength	ISO 527	23	N/mm <sup>2</sup>	
Elongation at break	ISO 527	> 50	%	
Modulus of elasticity	ISO 527	850	N/mm <sup>2</sup>	
Melt flow index MFI 190/5	ISO 1133 Procedure 18	0,3	g/10 min	
Heat conductivity ( $\lambda$ )	DIN 52612	0,24	W/mk	
Linear thermal expansion coefficient	VDE 0304	1,5 x 10-4	K <sup>-1</sup>	
Melting range	DIN 53736b2	150 - 154	°C	
Impact strength (Charpy)	+23°C -30°C	ISO 179/1 e A ISO 179/1 e A	no break 50	KJ/m <sup>2</sup> KJ/m <sup>2</sup>
Volumic strength	IEC 93	>10 <sup>15</sup>	Ω cm	
Dielectric strength	IEC 243/1	75	KV/mm	
Fire resistance	DIN 4102	B2		

# 4.2 THE PIPE

**PPR PIPING SYSTEM** pipes are manufactured in accordance with standards UNI EN ISO 15874 and ISO21003 and are divided into:

- MONOLAYER PIPES
- MULTILAYER PIPES

They are sized to meet the needs of different types of installation.

The maximum constant pressure in bar at 20° C for 50 years, is obtained by the relation:

$$PN = \frac{20 \cdot \sigma}{C \cdot (SDR - 1)}$$

where:

- PN = Nominal Pressure (bar)  
 σ = Hoop Stress of PPR (MPa)  
 SDR = Standard Dimension Ratio (External Diameter/Thickness)  
 C = Safety Coefficient

The European Standard **UNI EN ISO 15874** includes the classification of PPR piping systems intended to be used for hot and cold water installations. The **PPR PIPING SYSTEM** by **NUPIGECO** meets these requirements by ensuring a performance as per classes 1, 2 and 4 listed in the table below and classe 5 thanks to PP-RP.

EUROPEAN STANDARD  
UNI EN ISO 15874

Class	T <sub>oper</sub> (°C) <sup>2</sup>	Years to T <sub>oper</sub>	Pressure Bar	T <sub>max</sub> (°C) <sup>2</sup>	Years at T <sub>max</sub>	T <sub>mal</sub> (°C) <sup>2</sup>	Hours at T <sub>mal</sub>	Fields of use
1	60	49	10	80	1	95	100	Hot water (60°C)
2	70	49	8	80	1	95	100	Hot water (70°C)
4	20	2,5						Floor heating and heating at max temperature 70°C
	Followed by							
	40	20	10	70	2,5	100	100	
	Followed by							High temperature heating systems
	60	25						
5	20	14						
	Followed by							High temperature heating systems
	60	25	10	90	1	100	100	
	Followed by							
	80	10						

**Note 1:** if more than one operating temperature is present in only one class, times must be combined.

For example, the operating temperature expected for 50 years for class 2 is 70°C for 49 years combined with 80°C for 1 year and 95°C for 100 hours.

**Note 2:** for values of T<sub>oper</sub> (working temperature), T<sub>max</sub> (maximum working temperature) and T<sub>mal</sub> (malfunctioning temperature) higher than those indicated in the table, these standards are not applicable.



## 4.3 THERMAL EXPANSION

Plastic pipes are subject to thermal expansion, a phenomenon that has to be taken into consideration to prevent any possible damage.

The thermal expansion or contraction of a plastic pipe can be calculated using formula B.1 below and the coefficients of thermal expansion shown in the following table.

**COEFFICIENT OF LINEAR THERMAL EXPANSION FOR PLASTIC PIPING**

Pipe material	$\alpha$ (mm/mK)
PE	0,20
PE-X	0,15
PP	0,15
PB	0,13
PE-RT	0,19

$$\Delta L = \alpha L \Delta T$$

(FORMULA B.1)

Symbol	Description	Value	Unit of measure
$\Delta L$ =	linear thermal expansion	mm	millimeters
$\alpha_f$ =	coefficient of linear thermal expansion of monolayer PPR pipes	0,15	mm/mK millimeters/meter kelvin
$\alpha(FG)$ =	coefficient of linear thermal expansion of PPR pipes with fiber glass	0,035	mm/mK millimeters/meter kelvin
L =	pipe length	m	meters
$\Delta T$ =	difference between the installation temperature and the temperature of the transported fluid	K	degrees Kelvin

We hereby suggest some solutions to compensate the effects of linear expansion according to the different types of installation:


- █ **INSIDE WALL INSTALLATION**
- █ **INSTALLATION ON HORIZONTAL CONTINUOUS SUPPORTS**
- █ **FREE INSTALLATION**

## INSIDE WALL INSTALLATION

- **Non-insulated pipe:** the expansion will spread inside the pipe.
- **Insulated pipe:** the expansion will slightly compress the insulation layer to compensate the elongation.

Inside wall installation has always been the most recommended kind of installation for monolayer PP-R pipes because it avoids direct exposure to UV rays and benefits from a lower linear expansion as the outer layer is completely in contact with a large exchange area:

- the pipe can be walled directly in contact with plaster, lime and cement;
- the expansion does not carry the force required to remove the tiles and/or break the plaster.

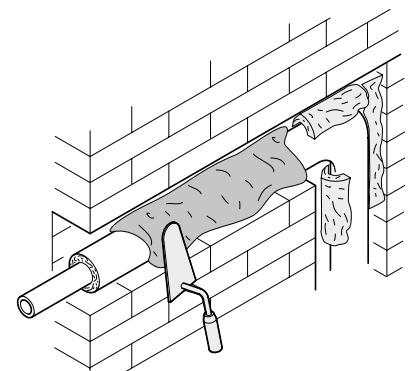


INSIDE WALL INSTALLATION



## LINEAR THERMAL EXPANSION FOR MONOLAYER PPR PIPES




L (m)	$\Delta T = T_{\text{fluid}} - T_{\text{installation}}$							
	10 K	20 K	30 K	40 K	50 K	60 K	70 K	80 K
1	1,5	3,0	4,5	6,0	7,5	9,0	10,5	12,0
2	3,0	6,0	9,0	12,0	15,0	18,0	21,0	24,0
3	4,5	9,0	13,5	18,0	22,5	27,0	31,5	36,0
4	6,0	12,0	18,0	24,0	30,0	36,0	42,0	48,0
8	12,0	24,0	36,0	48,0	60,0	72,0	84,0	96,0
12	18,0	36,0	54,0	72,0	90,0	108,0	126,0	144,0
16	24,0	48,0	72,0	96,0	120,0	144,0	168,0	192,0
20	30,0	60,0	90,0	120,0	150,0	180,0	210,0	240,0
24	36,0	72,0	108,0	144,0	180,0	216,0	252,0	288,0
28	42,0	84,0	126,0	168,0	210,0	252,0	294,0	336,0
32	48,0	96,0	144,0	192,0	240,0	288,0	336,0	384,0
36	54,0	108,0	162,0	216,0	270,0	324,0	378,0	432,0
40	60,0	120,0	180,0	240,0	300,0	360,0	420,0	480,0
44	66,0	132,0	198,0	264,0	330,0	396,0	462,0	528,0
48	72,0	144,0	216,0	288,0	360,0	432,0	504,0	576,0
52	78,0	156,0	234,0	312,0	390,0	468,0	546,0	624,0

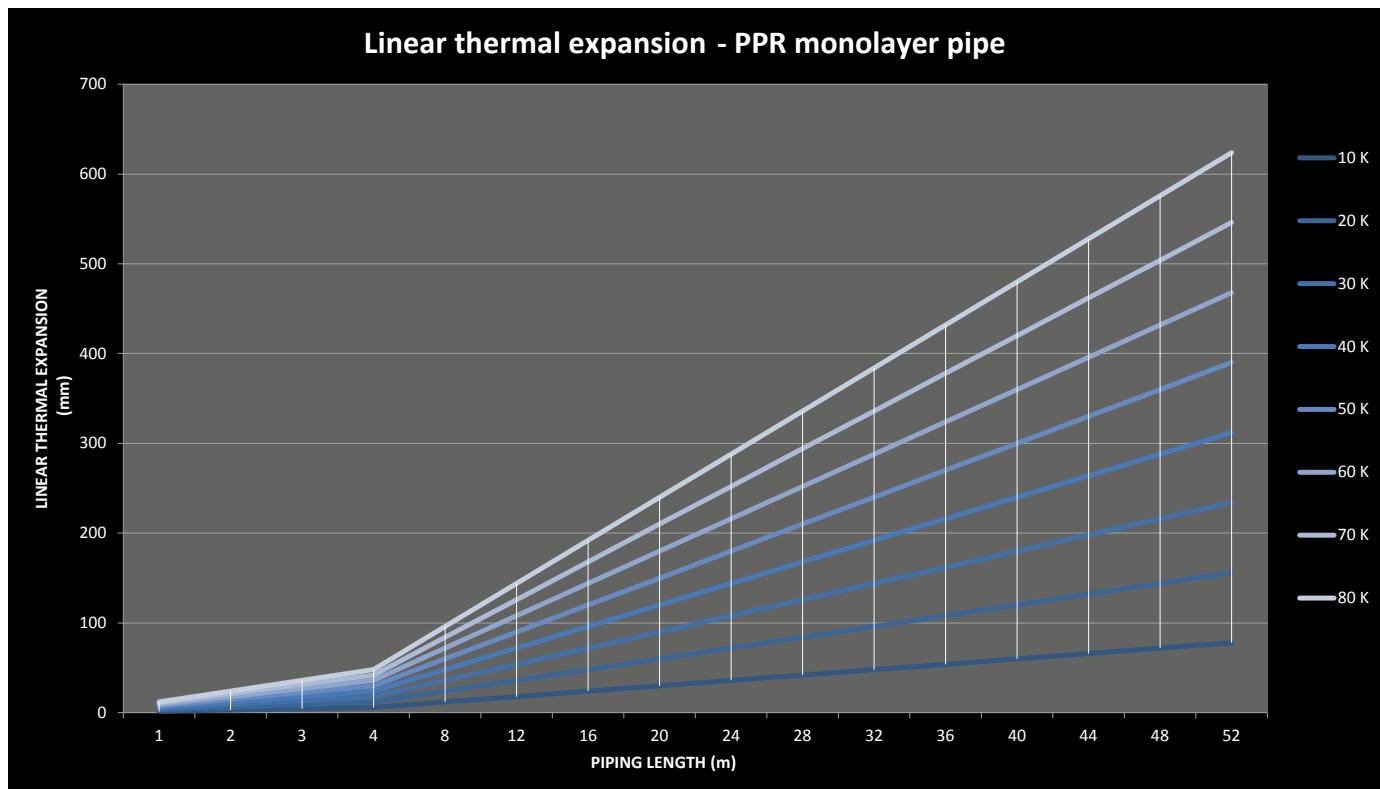

# LINEAR THERMAL EXPANSION FOR MULTILAYER PPR PIPES WITH FIBER GLASS

L (m)	$\Delta T = T_{\text{fluid}} - T_{\text{installation}}$							
	10 K	20 K	30 K	40 K	50 K	60 K	70 K	80 K
1	0,4	0,7	1,1	1,4	1,8	2,1	2,5	2,8
2	0,7	1,4	2,1	2,8	3,5	4,2	4,9	5,6
3	1,1	2,1	3,2	4,2	5,3	6,3	7,4	8,4
4	1,4	2,8	4,2	5,6	7,0	8,4	9,8	11,2
8	2,8	5,6	8,4	11,2	14,0	16,8	19,6	22,4
12	4,2	8,4	12,6	16,8	21,0	25,2	29,4	33,6
16	5,6	11,2	16,8	22,4	28,0	33,6	39,2	44,8
20	7,0	14,0	21,0	28,0	35,0	42,0	49,0	56,0
24	8,4	16,8	25,2	33,6	42,0	50,4	58,8	67,2
28	9,8	19,6	29,4	39,2	49,0	58,8	68,6	78,4
32	11,2	22,4	33,6	44,8	56,0	67,2	78,4	89,6
36	12,6	25,2	37,8	50,4	63,0	75,6	88,2	100,8
40	14,0	28,0	42,0	56,0	70,0	84,0	98,0	112,0
44	15,4	30,8	46,2	61,6	77,0	92,4	107,8	123,2
48	16,8	33,6	50,4	67,2	84,0	100,8	117,6	134,4
52	18,2	36,4	54,6	72,8	91,0	109,2	127,4	145,6

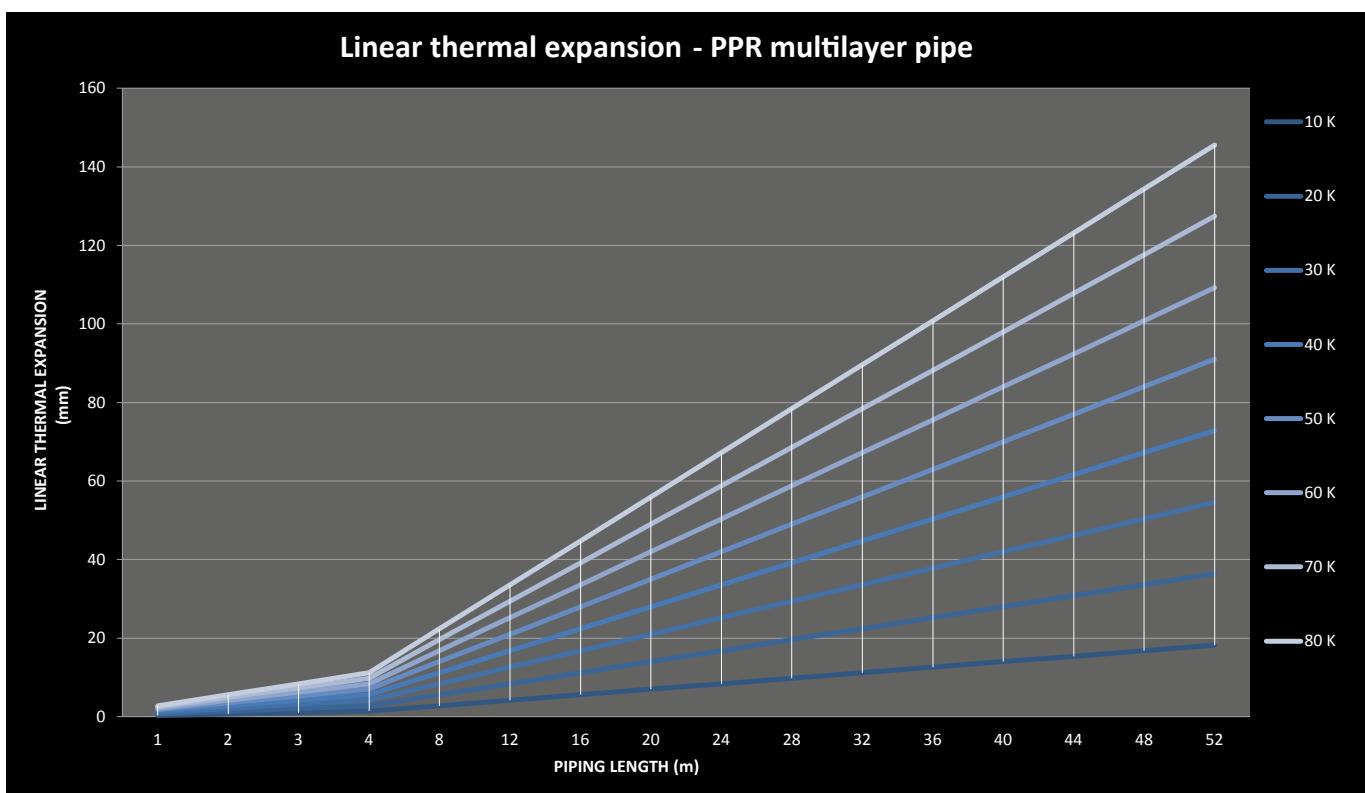




### 4.3.1 INSTALLATIONS WHERE THERMAL EXPANSION IS ALLOWED (UNI EN 806-4)

Pipes can be laid on a continuous horizontal supports (rails), where the elongation is compensated by the pipe snaking. The pipe trail should be designed so as to leave enough space for the elongation or contraction of the pipe. It is advisable to secure the pipe to avoid its vertical movement.

#### POSITIONING OF ANCHOR POINTS

The positioning of anchor points can be used to give direction to and to limit the amount of thermal expansion. Examples are given in Figures B.1, B.2 and B.3. This is also valid for mains in a basement.

FIGURE B.1 - POSITIONING OF ANCHOR POINTS (INSTALLATION WITH BRANCHES)

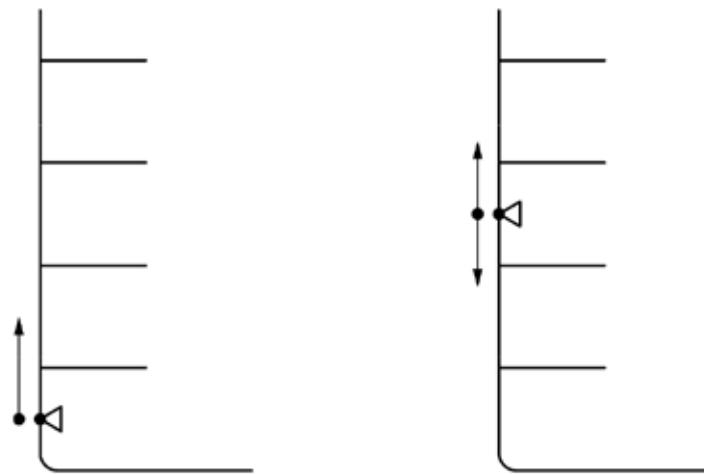

## INSTALLATION OF PIPES ALLOWING EXPANSION BY MEANS OF A FLEXIBLE ARM

The flexible arm should be sufficiently long to prevent any damage.

The brackets should allow clearance to the wall after expansion. This is also applicable in cases where pipes are supported along their length.

A typical installation is shown in Figures B.2 and B.3.

FIGURE B.2 - COMPENSATION OF EXPANSION  $\Delta L$  BY FLEXIBLE ARM

Key

$\Delta L$  Length difference

$L$  Length of pipe section

$L_B$  Length of flexible arm

$\circ$  Anchor point

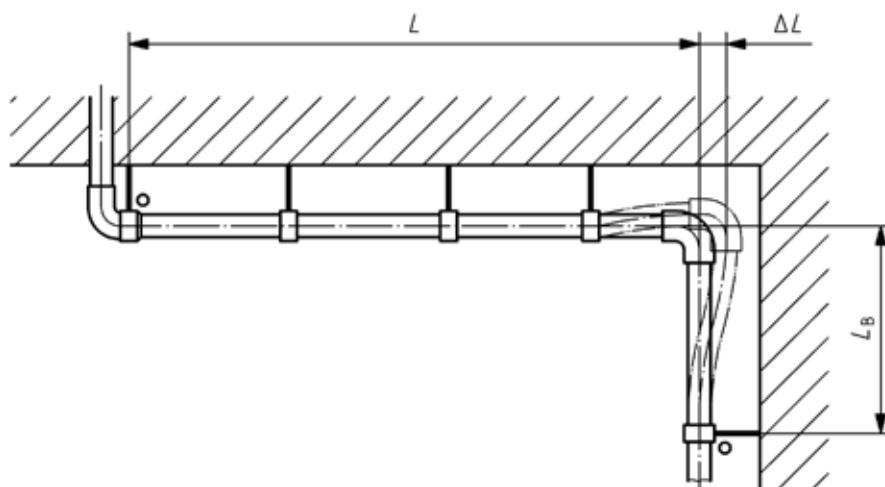


FIGURE B.3 - COMPENSATION OF EXPANSION  $\Delta L$  BY FLEXIBLE ARM


Key

$\Delta L'$  Length difference

$L'$  Length of pipe section

$L_B'$  Length of flexible arm

$\circ$  Anchor point

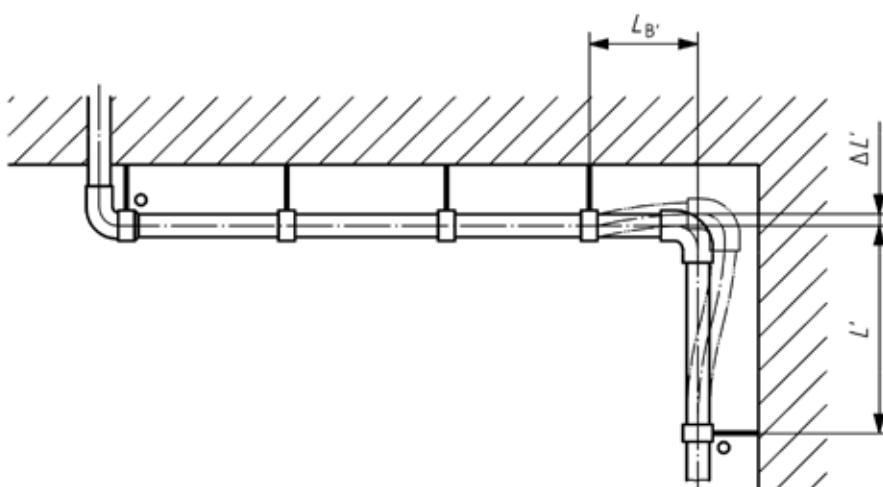



The length of the flexible arm,  $L_B$  can be calculated from the formula B.2 below:

$$L_B = C \times \sqrt{d_e} \times \Delta L$$

where

$L_B$  is the length of the flexible arm, in mm;

$C$  is the material constant in accordance with Table B.4;

$d_e$  is the outside diameter, in mm;

$\Delta L$  is the thermal length variation as determined by formula B.1, in mm.

TABLE B.4 - VALUES OF MATERIAL CONSTANT C

Material	C
PE	27
PE-X	12
PP	20
PB	10
PE-RT	14

## INSTALLATION OF PIPES ALLOWING EXPANSION BY MEANS OF AN EXPANSION LOOP

A typical installation is shown in Figure B.4.

FIGURE B.4 - COMPENSATION OF THE THERMAL EXPANSION BY EXPANSION LOOP

Key

See explanations to formula (B.3).


$L$  Distance between fixed brackets

$l_1$  Length of loop

$l_2$  Width of loop

$\Delta L$  Linear thermal expansion

o Anchor point

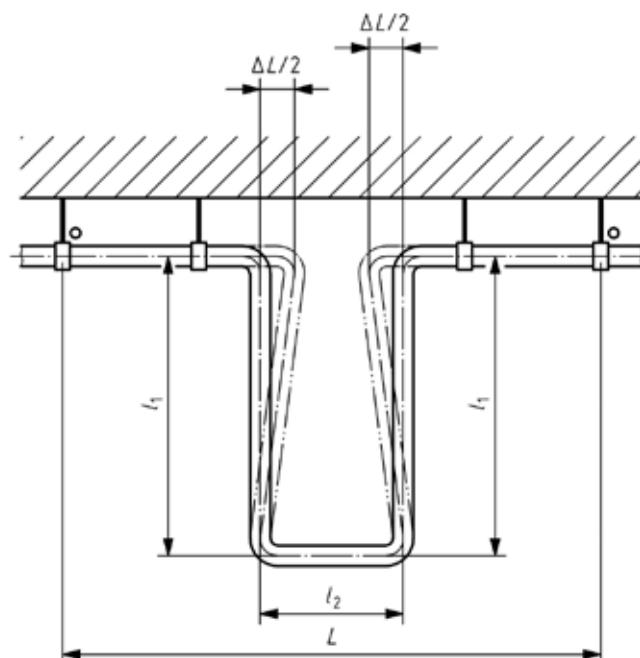

The length of the flexible arm,  $L_B$  can be calculated from the following formula:

$$L_B = C \times \sqrt{d_e \times \frac{2 \times \Delta L}{2}} = 2 \times l_1 + l_2$$

where

$L_B$  is the length of the flexible arm, in mm;

$C$  is the material constant;

$d_e$  is the outside diameter, in mm;

$\Delta L$  is the linear thermal expansion, in mm;

$l_1$  is the length of loop, in mm;

$l_2$  is the width of loop, in mm.

It is preferable to design the loop so that  $l_2 = 0,5 l_1$ .

The expansion loop is also calculated using formula B.3. In this case the flexible arm

$$L_B = l_1 + l_1 + l_2$$

## INSTALLATION OF PIPES ALLOWING EXPANSION AND WITH CONTINUOUS SUPPORT AND GUIDE BRACKETS

A typical installation is shown in Figure B.5.

FIGURE B.5 - CONTINUOUS SUPPORT WITH GUIDE BRACKETS ALLOWING EXPANSION

Key

1 Continuous support

$L_1$  Distance between supporting guide bracket or between supporting guide bracket and anchor point

$L_2$  Distance between bindings

Maximum distances between guide brackets and bindings are given in Tables B.5 and B.6.

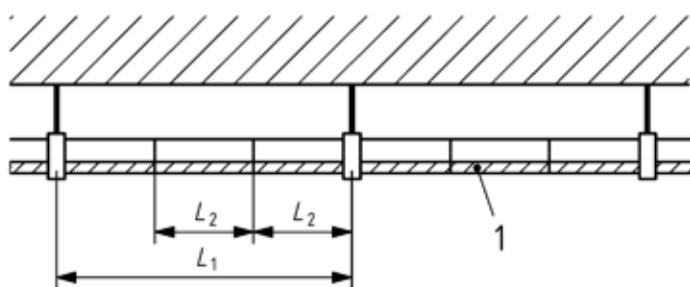




TABLE B.5 - DISTANCE  $L_1$  (APPROXIMATE VALUES)

Pipe outside diameter mm	$L_1$ mm	
	Cold water	Hot water
$\leq 20$	1500	1000
> 20 to $\leq 40$	1500	1200
> 40 to $\leq 75$	1500	1500
> 75 to $\leq 110$	2000	2000
* > 125 to $\leq 160$	2500	2500
* > 160 to $\leq 250$	3000	3000

\* not included in UNI EN806-4

TABLE B.6 - DISTANCE  $L_2$  (APPROXIMATE VALUES)

Pipe outside diameter mm	$L_2$ mm	
	Cold water	Hot water
$\leq 20$	500	200
> 20 to $\leq 25$	500	300
> 25 to $\leq 32$	750	400
> 32 to $\leq 40$	750	600
> 40 to $\leq 75$	750	750
> 75 to $\leq 110$	1000	1000
* > 110 to $\leq 125$	1000	1000
* > 125 to $\leq 250$	1250	1250

\* not included in UNI EN806-4

## INSTALLATION OF PIPES ALLOWING EXPANSION AND WITH GUIDE BRACKETS

Maximum distance between guide brackets are shown in Table B.7.

TABLE B.7 - DISTANCE  $L_1$  (APPROXIMATE VALUES)

Pipe outside diameter mm	$L_1$ mm	
	Cold water	Hot water
$\leq 16$	750	400
> 16 to $\leq 20$	800	500
> 20 to $\leq 25$	850	600
> 25 to $\leq 32$	1000	650
> 32 to $\leq 40$	1100	800
> 40 to $\leq 50$	1250	1000
> 50 to $\leq 63$	1400	1200
> 63 to $\leq 75$	1500	1300
> 75 to $\leq 90$	1650	1450
> 90 to $\leq 110$	1900	1600
* > 125 to $\leq 160$	2100	1850
* > 160 to $\leq 200$	2500	2300
* > 200 to $\leq 250$	2800	2500


\* not included in UNI EN806-4

For vertical pipes  $L_1$  should be multiplied by 1,3.

FIGURE B.6 - GUIDE BRACKETS ALLOWING EXPANSION

Key

$L_1$  Distance between guide brackets or between guide bracket and anchor point

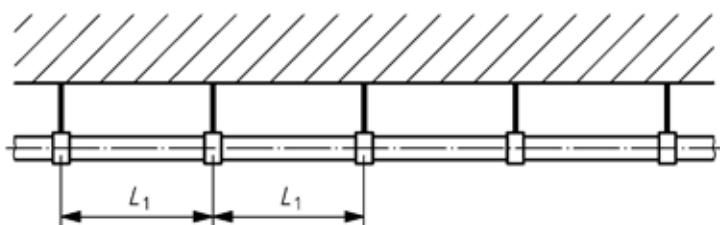

## INSTALLATION OF PIPES ON CONTINUOUS HORIZONTAL SUPPORTS

Pipes may be laid down on continuous horizontal support (i.e. cable path), where the elongation is compensated by "snaking" of the pipe. The course of the pipe should be designed to give enough space for elongation or contraction of the pipe. To avoid vertical movement of the pipe, the pipe should be secured.




## 4.3.2 INSTALLATION OF PIPES NOT ALLOWING EXPANSION

Installation of pipes between anchor points is sometimes required for special situations, in this case the force due to thermal expansion and contraction is transmitted through the supports to the buildings structure. Examples are given in Figures B.7, B.8, B.9 and B.10.

### POSITIONING OF ANCHOR POINTS

The anchor points are positioned so that the thermal variations cannot take place. The maximum allowable distance between anchor points should be below or equal to 6 m.

FIGURE B.7 - POSITIONING OF ANCHOR POINTS AT BRANCHES

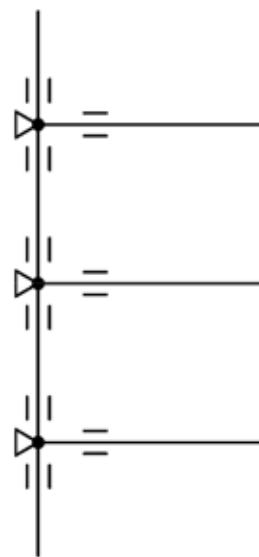


## INSTALLATION BETWEEN ANCHOR POINTS WHERE CONTINUOUS PIPE STIFFENING IS PROVIDED

Maximum distances between different fixings as shown in Figure B.8 should conform to Tables B.5 and B.6.

FIGURE B.8 - CONTINUOUS SUPPORT NOT ALLOWING EXPANSION

Key

- 1 Continuous support
- $L_1$  Distance between guide brackets or between guide bracket and anchor point (see Table B.5)
- $L_2$  Distance between bindings (see Table B.6)
- o Anchor point

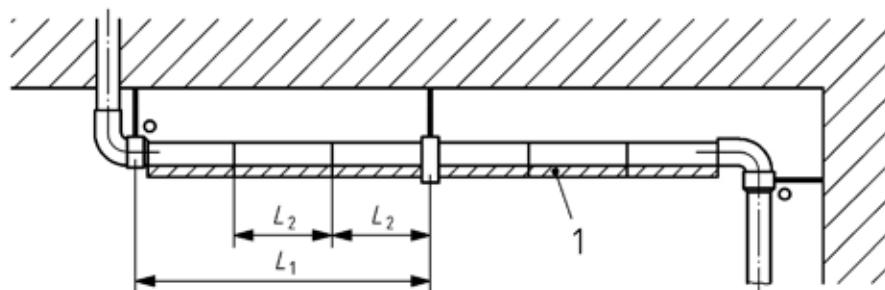

## INSTALLATION BETWEEN ANCHOR POINTS WITH GUIDE BRACKETS

FIGURE B.9 - INSTALLATION BETWEEN ANCHOR POINTS WITH GUIDE BRACKETS

Key

- $L_1$  Distance between guide brackets or between guide bracket and anchor point
- o Anchor point

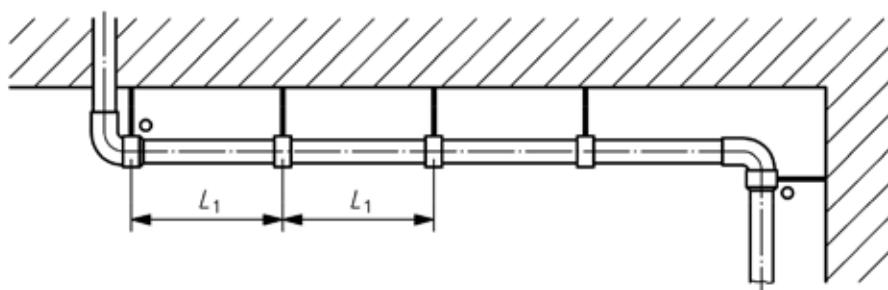


TABLE B.8 - DISTANCE  $L_1$  (APPROXIMATE VALUES)

Pipe outside diameter mm	$L_1$ , mm	
	Cold water	Hot water
$\leq 16$	750	400
$> 16 \text{ to } \leq 20$	800	500
$> 20 \text{ to } \leq 25$	850	600
$> 25 \text{ to } \leq 32$	1000	650
$> 32 \text{ to } \leq 40$	1100	800
$> 40 \text{ to } \leq 50$	1250	1000
$> 50 \text{ to } \leq 63$	1400	1200
$> 63 \text{ to } \leq 75$	1500	1300
$> 75 \text{ to } \leq 90$	1650	1450
$> 90 \text{ to } \leq 110$	1900	1600
* $> 110 \text{ to } \leq 160$	2000	1400
* $> 160 \text{ to } \leq 200$	2300	1800
* $> 200 \text{ to } \leq 250$	2500	2000

\* not included in UNI EN806-4

Maximum distance between anchor points and guide brackets as shown in Figure B.9 should conform to Table B.8.

### INSTALLATION OF PIPES SUPPORTED ONLY AT THE ANCHOR POINTS


In this case, the forces due to thermal expansion and contraction only partially are transmitted through the anchor points to the building structure.

This may be used where the movement caused by thermal expansion as shown in Figure B.10, can be tolerated and/or is visually acceptable.

FIGURE B.10 - PIPES SUPPORTED ONLY BY ANCHOR POINTS

Key

o Anchor point

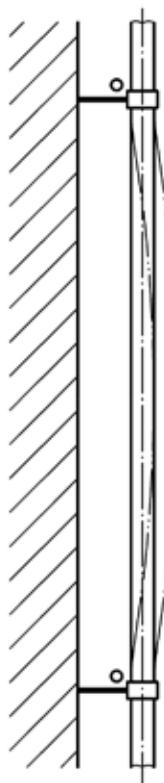

## 4.4 HEAT LOSS

Law 10/91 and DPR 412/93 require that the hot water temperature at the point of use is  $48^\circ\text{C} + 5$  and require the insulation of all piping.

The thickness of the insulation layer depends on its thermal conductivity and on the pipe diameter.

PPR PIPING SYSTEM pipes, both insulated and non-insulated, have very low heat loss and allow to meet the required values as can be seen in the following tables.

### N.B.:


Please contact NUPIGECO Technical Office for heat loss values according to different water speed, pipe SDR, thermal conductivity of the insulation layer and ambient temperature.

NON-INSULATED PIPE						
Water temp. $40^\circ\text{C}$ – Speed 2 m/s						
<b>Ø mm</b>	<b>SDR</b>	<b>Ambient temperature</b>				
		<b>10°C</b>	<b>15°C</b>	<b>20°C</b>		
<b>Heat loss</b>						
<b>°C every 10m of pipe</b>						
<b>20</b>	<b>6</b>	0,25	0,21	0,17		
<b>25</b>	<b>6</b>	0,18	0,15	0,12		
<b>32</b>	<b>6</b>	0,13	0,11	0,09		
<b>40</b>	<b>6</b>	0,09	0,08	0,06		
<b>50</b>	<b>6</b>	0,07	0,06	0,05		
<b>63</b>	<b>6</b>	0,05	0,04	0,03		
<b>75</b>	<b>6</b>	0,04	0,03	0,02		
<b>90</b>	<b>6</b>	0,03	0,02	0,02		
<b>110</b>	<b>6</b>	0,02	0,02	0,02		
<b>125</b>	<b>6</b>	0,02	0,01	0,01		

NON-INSULATED PIPE						
Water temp. $40^\circ\text{C}$ – Speed 2 m/s						
<b>Ø mm</b>	<b>SDR</b>	<b>Ambient temperature</b>				
		<b>10°C</b>	<b>15°C</b>	<b>20°C</b>		
<b>Heat loss</b>						
<b>°C every 10m of pipe</b>						
<b>25</b>	<b>7,4</b>	0,17	0,14	0,11		
<b>32</b>	<b>7,4</b>	0,12	0,10	0,08		
<b>40</b>	<b>7,4</b>	0,09	0,07	0,06		
<b>50</b>	<b>7,4</b>	0,07	0,06	0,05		
<b>63</b>	<b>7,4</b>	0,05	0,04	0,03		
<b>75</b>	<b>7,4</b>	0,04	0,03	0,02		
<b>90</b>	<b>7,4</b>	0,03	0,02	0,02		
<b>110</b>	<b>7,4</b>	0,02	0,02	0,01		
<b>125</b>	<b>7,4</b>	0,02	0,01	0,01		
<b>160</b>	<b>7,4</b>	0,01	0,01	0,00		

INSULATED PIPE							
Water temp. $40^\circ\text{C}$ – Speed 2 m/s							
<b>Ø mm</b>	<b>SDR</b>	<b>Insulation layer</b> 0,038 W/mk	<b>Ambient temperature</b>				
			<b>10°C</b>	<b>15°C</b>	<b>20°C</b>		
<b>Heat loss</b>							
<b>°C every 10m of pipe</b>							
<b>20</b>	<b>6</b>	<b>6</b>	0,10	0,08	0,07		
<b>25</b>	<b>6</b>	<b>9</b>	0,05	0,05	0,04		
<b>32</b>	<b>6</b>	<b>9</b>	0,04	0,03	0,03		
<b>40</b>	<b>6</b>	<b>9</b>	0,03	0,02	0,02		
<b>50</b>	<b>6</b>	<b>12</b>	0,02	0,02	0,01		
<b>63</b>	<b>6</b>	<b>15</b>	0,01	0,01	0,01		
<b>75</b>	<b>6</b>	<b>15</b>	0,01	0,00	0,00		
<b>90</b>	<b>6</b>	<b>17</b>	0,00	0,00	0,00		
<b>110</b>	<b>6</b>	<b>18</b>	0,00	0,00	0,00		
<b>125</b>	<b>6</b>	<b>18</b>	0,00	0,00	0,00		

INSULATED PIPE							
Water temp. $40^\circ\text{C}$ – Speed 2 m/s							
<b>Ø mm</b>	<b>SDR</b>	<b>Insulation layer</b> 0,038 W/mk	<b>Ambient temperature</b>				
			<b>10°C</b>	<b>15°C</b>	<b>20°C</b>		
<b>Heat loss</b>							
<b>°C every 10m of pipe</b>							
<b>25</b>	<b>7,4</b>	<b>9</b>	0,05	0,04	0,03		
<b>32</b>	<b>7,4</b>	<b>9</b>	0,04	0,03	0,02		
<b>40</b>	<b>7,4</b>	<b>9</b>	0,03	0,02	0,02		
<b>50</b>	<b>7,4</b>	<b>12</b>	0,02	0,01	0,01		
<b>63</b>	<b>7,4</b>	<b>15</b>	0,01	0,00	0,00		
<b>75</b>	<b>7,4</b>	<b>15</b>	0,01	0,00	0,00		
<b>90</b>	<b>7,4</b>	<b>17</b>	0,00	0,00	0,00		
<b>110</b>	<b>7,4</b>	<b>18</b>	0,00	0,00	0,00		
<b>125</b>	<b>7,4</b>	<b>18</b>	0,00	0,00	0,00		
<b>160</b>	<b>7,4</b>	<b>18</b>	0,00	0,00	0,00		

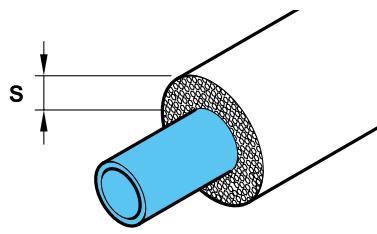

**s** = Thickness of the insulation layer in mm with a conductivity value of 0.038 W/mK

**T<sub>e</sub>** = Outside air temperature in °C

**T<sub>i</sub>** = Water temperature inside the pipes in °C

**60%/80%** = Relative humidity of air

## 4.5 ANTI-CONDENSATION INSULATION IN AIR CONDITIONING SYSTEMS

The tables below indicate the minimum thickness of insulation required for PPR PIPING SYSTEM pipes to avoid that moisture present in the air turns into dew on the pipes in air conditioning systems.

**PIPE Ø 20 x 3,4 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,7	3,9	4,1	4,3	4,6	4,8	5,0	5,3	5,5	
7	3,0	3,3	3,5	3,8	4,0	4,2	4,5	4,7	5,0	60
9	2,4	2,7	2,9	3,2	3,4	3,7	3,9	4,2	4,4	
5	10,5	10,9	11,3	11,7	12,1	12,4	12,8	13,2	13,6	
7	9,5	9,9	10,3	10,7	11,1	11,5	11,9	12,3	12,7	80
9	8,4	8,8	9,2	9,6	10,0	10,5	10,9	11,3	11,7	

**PIPE Ø 63 x 10,5 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,8	3,1	3,4	3,7	4,0	4,2	4,5	4,8	5,1	
7	2,1	2,4	2,7	3,0	3,3	3,6	3,8	4,1	4,4	60
9	1,4	1,7	2,0	2,3	2,6	2,9	3,2	3,5	3,8	
5	11,5	12,0	12,5	13,0	13,5	14,0	14,5	15,0	15,5	
7	10,1	10,6	11,2	11,7	12,2	12,7	13,2	13,8	14,3	80
9	8,7	9,2	9,8	10,3	10,9	11,4	12,0	12,5	13,1	

**PIPE Ø 25 x 4,2 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,6	3,8	4,1	4,3	4,6	4,8	5,1	5,3	5,6	
7	3,0	3,2	3,5	3,7	4,0	4,2	4,5	4,8	5,0	60
9	2,3	2,6	2,9	3,1	3,4	3,7	3,9	4,2	4,4	
5	10,9	11,3	11,7	12,1	12,5	12,9	13,3	13,7	14,1	
7	9,7	10,2	10,6	11,0	11,4	11,9	12,3	12,7	13,1	80
9	8,6	9,0	9,5	9,9	10,3	10,8	11,2	11,7	12,1	

**PIPE 75 x 12,5 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,3	2,6	2,9	3,2	3,5	3,8	4,1	4,4	4,7	
7	1,6	1,9	2,2	2,5	2,8	3,1	3,4	3,7	4,0	60
9	0,9	1,2	1,5	1,8	2,1	2,4	2,7	3,0	3,3	
5	11,1	11,6	12,1	12,6	13,1	13,6	14,1	14,6	15,1	
7	9,7	10,2	10,7	11,2	11,7	12,2	12,7	13,2	13,7	80
9	8,2	8,8	9,4	10,0	10,6	11,2	11,8	12,4	13,0	

**PIPE Ø 32 x 5,4 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,5	3,8	4,0	4,3	4,5	4,8	5,0	5,3	5,5	
7	2,9	3,1	3,4	3,6	3,9	4,2	4,4	4,7	5,0	60
9	2,2	2,5	2,7	3,0	3,3	3,6	3,8	4,1	4,4	
5	11,1	11,6	12,0	12,4	12,9	13,3	13,7	14,1	14,6	
7	10,0	10,4	10,9	11,3	11,8	12,2	12,7	13,1	13,5	80
9	8,7	9,2	9,7	10,1	10,6	11,1	11,6	12,0	12,5	

**PIPE Ø 90 x 15 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	1,8	2,1	2,4	2,7	3,0	3,3	3,6	3,9	4,2	
7	1,1	1,5	1,7	2,0	2,3	2,6	2,9	3,2	3,5	60
9	0,3	0,6	0,9	1,2	1,5	1,8	2,1	2,4	2,7	
5	10,8	11,4	11,9	12,5	13,0	13,6	14,1	14,7	15,2	
7	9,4	10,0	10,5	11,1	11,6	12,2	12,7	13,3	13,8	80
9	7,9	8,5	9,0	9,6	10,1	10,7	11,2	11,8	12,3	

**PIPE Ø 40 x 6,7 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,4	3,6	3,9	4,4	4,7	4,9	4,9	5,2	5,5	
7	2,7	3,0	3,2	3,8	4,1	4,3	4,6	4,9	5,2	60
9	2,0	2,3	2,6	3,1	3,4	3,7	3,7	4,0	4,3	
5	11,3	11,8	12,3	13,2	13,6	14,1	14,1	14,5	15,0	
7	10,1	10,6	11,0	13,0	12,5	12,9	12,9	13,4	13,9	80
9	8,8	9,3	9,8	10,8	11,3	11,8	11,8	12,3	12,8	

**PIPE Ø 110 x 18,4 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	1,3	1,6	1,9	2,2	2,5	2,8	3,1	3,4	3,7	
7	0,5	0,8	1,1	1,4	1,7	2,0	2,3	2,6	2,9	60
9	0,0	0,1	0,4	0,7	1,0	1,3	1,6	1,9	2,2	
5	10,5	11,1	11,6	12,2	12,7	13,3	13,8	14,4	14,9	
7	9,0	9,6	10,1	10,7	11,2	11,8	12,3	12,9	13,4	80
9	7,5	8,1	8,7	9,3	9,9	10,5	11,1	11,7	12,3	

**PIPE Ø 50 x 8,4 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,1	3,4	3,7	4,0	4,2	4,5	4,8	5,0	5,3	
7	2,4	2,7	3,0	3,3	3,6	3,8	4,1	4,4	4,7	60
9	1,7	2,0	2,3	2,6	2,9	3,2	3,5	3,8	4,1	
5	11,5	11,9	12,4	12,9	13,4	13,8	14,3	14,8	15,3	
7	10,1	10,6	11,1	11,6	12,1	12,6	13,1	13,6	14,1	80
9	8,8	9,3	9,8	10,4	10,9	11,4	11,9	12,4	13,0	

**PIPE Ø 125 x 20,8 SDR 6**

T <sub>i</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	0,8	1,1	1,4	1,7	2,0	2,3	2,6	2,9	3,2	
7	0,0	0,3	0,6	0,9	1,2	1,5	1,8	2,1	2,4	60
9	0,0	0,0	0,0	0,2	0,5	0,8	1,1	1,4	1,7	
5	10,2	10,8	11,3	11,9	12,4	13,0	13,5	14,1	14,6	
7	8,6	9,2	9,8	10,4	11,0	11,6	12,2	12,8	13,4	80
9	7,1	7,7	8,3	8,9	9,5	10,1	10,7	11,3	11,9	

**PIPE Ø 20 x 2,8 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,8	4,0	4,3	4,5	4,7	5,0	5,2	5,4	5,6		
7	3,2	3,5	3,7	4,0	4,2	4,5	4,7	5,0	5,2	60	
9	2,6	2,9	3,1	3,4	3,6	3,9	4,1	4,4	4,6		
5	10,6	11,0	11,4	11,8	12,2	12,6	13,0	13,4	13,8		
7	9,6	10,0	10,4	10,8	11,2	11,6	12,0	12,4	12,8	80	
9	8,5	8,9	9,3	9,7	10,1	10,5	10,9	11,3	11,7		

**PIPE Ø 90 x 12,5 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,6	2,9	3,2	3,5	3,8	4,1	4,4	4,7	5		
7	1,9	2,2	2,5	2,8	3,1	3,4	3,7	4	4,3	60	
9	1,1	1,4	1,7	2,1	2,4	2,7	3	3,3	3,6		
5	11,8	12,3	12,9	13,4	13,9	14,5	15	15,6	16,1		
7	10,3	10,9	11,4	12	12,6	13,1	13,7	14,2	14,8	80	
9	8,8	9,4	10	10,6	11,1	11,7	12,3	12,9	13,5		

**PIPE Ø 25 x 3,5 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,8	4,0	4,3	4,5	4,7	5,0	5,2	5,4	5,7		
7	3,2	3,5	3,7	4,0	4,2	4,5	4,7	5,0	5,2	60	
9	2,5	2,8	3,1	3,4	3,6	3,9	4,1	4,4	4,6		
5	10,9	11,3	11,7	12,1	12,5	12,9	13,3	13,7	14,1		
7	9,8	10,3	10,7	11,2	11,6	12,1	12,5	13,0	13,4	80	
9	8,7	9,2	9,6	10,1	10,5	11,0	11,4	11,9	12,3		

**PIPE Ø 110 x 15,2 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,3	2,6	2,9	3,2	3,5	3,8	4,1	4,4	4,6		
7	1,5	1,9	2,2	2,5	2,8	3,1	3,4	3,7	4	60	
9	0,8	1,1	1,4	1,7	2,1	2,4	2,7	3	3,3		
5	11,5	12,2	12,8	13,4	13,9	14,5	15,1	15,6	16,2		
7	10	10,7	11,3	11,9	12,5	13,1	13,7	14,3	14,8	80	
9	8,5	9,2	9,8	10,5	11,1	11,7	12,3	12,9	13,5		

**PIPE Ø 32 x 4,4 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,8	4	4,3	4,5	4,7	5	5,2	5,4	5,7		
7	3,1	3,4	3,6	3,9	4,1	4,4	4,6	4,9	5,1	60	
9	2,4	2,7	3	3,3	3,5	3,8	4	4,3	4,6		
5	11,3	11,8	12,2	12,7	13,1	13,6	14,0	14,5	14,9		
7	10,2	10,7	11,1	11,6	12,0	12,5	12,9	13,4	13,8	80	
9	8,9	9,4	9,9	10,4	10,9	11,4	11,9	12,4	12,9		

**PIPE Ø 125 x 17,1 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,2	2,5	2,8	3,1	3,4	3,7	4,0	4,3	4,5		
7	1,4	1,8	2,1	2,4	2,7	3,0	3,3	3,6	3,9	0,6	
9	0,6	1,0	1,3	1,6	2,0	2,3	2,6	2,8	3,1		
5	11,3	12,0	12,6	13,2	13,7	14,3	15,0	15,5	16,0		
7	9,8	10,5	11,1	11,7	12,3	13,0	13,5	14,0	14,5	0,8	
9	8,3	9,0	9,7	10,3	11,0	11,5	12,0	12,8	13,2		

**PIPE Ø 50 x 6,9 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,5	3,8	4,0	4,3	4,5	4,8	5,1	5,3	5,6		
7	2,7	3,0	3,2	3,5	3,8	4,1	4,3	4,6	4,9	60	
9	2,0	2,3	2,6	2,9	3,2	3,5	3,7	4,0	4,3		
5	11,7	12,2	12,7	13,2	13,7	14,2	14,7	15,2	15,7		
7	10,4	10,9	11,4	11,9	12,4	12,9	13,4	13,9	14,4	80	
9	9,0	9,5	10,1	10,6	11,2	11,7	12,2	12,8	13,3		

**PIPE Ø 200 x 18,2 SDR 11**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	1,7	2,0	2,3	2,6	2,9	3,2	3,5	3,8	4,1		
7	0,9	1,2	1,5	1,8	2,1	2,4	2,7	3,0	3,3	60	
9	0,1	0,4	0,8	1,1	1,4	1,7	2,0	2,3	2,6		
5	11,5	12,2	12,8	13,5	14,1	14,7	15,3	16,0	16,6		
7	9,9	10,6	11,3	11,9	12,5	13,1	13,8	14,5	15,1	80	
9	8,2	8,9	9,6	10,3	11,0	11,7	12,3	13,0	13,6		

**PIPE Ø 63 x 8,7 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	3,2	3,5	3,8	4,0	4,3	4,6	4,9	5,2	5,4		
7	2,5	2,8	3,1	3,4	3,7	4,0	4,2	4,5	4,8	60	
9	1,7	2	2,3	2,6	2,9	3,2	3,5	3,8	4,1		
5	11,8	12,3	12,8	13,3	13,8	14,3	14,8	15,3	15,8		
7	10,4	11,0	11,5	12,1	12,6	13,2	13,7	14,3	14,8	80	
9	9,0	9,6	10,1	10,7	11,2	11,8	12,4	12,9	13,5		

**PIPE Ø 250 x 22,7 SDR 11**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	1,7	2,0	2,3	2,6	2,9	3,2	3,5	3,8	4,1		
7	0,9	1,2	1,5	1,8	2,1	2,4	2,7	3,0	3,3	60	
9	0,1	0,4	0,8	1,1	1,4	1,7	2,0	2,3	2,6		
5	11,5	12,2	12,8	13,5	14,1	14,7	15,3	16,0	16,6		
7	9,9	10,6	11,3	11,9	12,5	13,1	13,8	14,5	15,1	80	
9	8,2	8,9	9,6	10,3	11,0	11,7	12,3	13,0	13,6		

**PIPE Ø 75 x 10,4 SDR 7,4**

T <sub>i</sub>	T <sub>e</sub>	26	27	28	29	30	31	32	33	34	humidity%
5	2,5	2,8	3,1	3,4	3,7	3,9	4,2	4,5	4,8		
7	1,8	2,1	2,4	2,7	3,0	3,3	3,5	3,8	4,1	60	
9	1,0	1,3	1,								



## 4.5.1 MINIMUM INSULATION THICKNESS RECOMMENDED FOR PPR PIPES

According to the current standard in force UNI EN 14114 (Hygrothermal performance of systems, buildings and industrial installations - Calculation of water vapor diffusion - Insulation systems for cold pipes), hot and cold fluid distribution networks in heat systems must be insulated with an insulating layer with thickness values as per the following table depending on:

- the diameter of the non-insulated pipe;
- the usable thermal conductivity (W/mK) of the insulation material at an average temperature of 40°C.

Diameter of the pipe	< 20 mm	from 20 to 39	from 40 to 59	from 60 to 79	from 80 to 99		> 100						
Usable thermal conductivity of the insulation material W/m°C	20	25 32	40 50	63 75	90	110 125 160 20 250	315 355 40 450 50 560 630						
0,030	13	19	26	33	37		40						
0,032	14	21	29	36	40		44						
0,034	15	23	31	39	44		48						
0,036	17	25	34	43	47		52						
0,038	18	28	37	46	51		56						
0,040	20	30	40	50	55		60						
0,042	22	32	43	54	59		64						
0,044	24	35	46	58	63		69						
0,046	26	38	50	62	68		74						
0,048	28	41	54	66	72		79						
0,050	30	44	58	71	77		84						

### NOTES

- For values of usable thermal conductivity of the insulation material other than those indicated in the table, the minimum thickness of the insulation material is obtained by linear interpolation of the data shown in the table.
- Vertical pipe risers shall be placed outside the thermal insulation of the building towards the inside of the building and the minimum thickness of the insulation layer resulting from the table shall be multiplied by 0,5.
- For pipes installed inside structures that do not overlook either outside or on unheated rooms, the thickness values indicated in the table shall be multiplied by 0,3.
- Hot air channels for winter heating placed in unheated spaces should be insulated with an insulation thickness not lower than the insulation thicknesses indicated in the table for pipes with an outside diameter from 20 to 39 mm.

The standard also indicates some installation requirements, in particular:  
all piping shall be uniformly insulated, without chokes or reductions in thickness,  
ensuring the perfect welding of both the joints of the PPR system and the insulation material, insulating also elbows, fittings, flanges, valves and gate valves and everything that could be used as a thermal bridge.

## 4.6 HEAD LOSS

### UNIT HEAD LOSS FOR PPR PIPING SYSTEM PIPES SDR 6 WITH WATER TEMPERATURE AT 10°C

Flow rate		$\varnothing$ 16x2,7	$\varnothing$ 20x3,4	$\varnothing$ 25x4,2	$\varnothing$ 32x5,4	$\varnothing$ 40x6,7	$\varnothing$ 50x8,4	$\varnothing$ 63x10,5
l/s	kg/h							
		70	10 0,22	2 0,14	0,9 0,09	Head loss in mm c.a./m Average speed in m/s		
		140	33 0,44	8 0,29	3 0,18	1 0,11		
0,05		180	52 0,57	13 0,37	4 0,23	2 0,14		
		220	73 0,70	19 0,45	6 0,28	2 0,17		
		290	118 0,92	30 0,59	10 0,37	4 0,23	1,5 0,15	0,5 0,09
0,1		360	164 1,11	42 0,71	15 0,45	6 0,28	2 0,18	0,7 0,11
		430	234 1,36	61 0,88	21 0,55	8 0,34	3 0,22	1,07 0,14
		510		83 1,04	29 0,66	11 0,40	4 0,26	1,44 0,16
		580			104 1,18	37 0,75	14 0,46	5 0,29
		655			129 1,34	45 0,84	18 0,52	6 0,33
0,2		730			156 1,49	55 0,94	22 0,58	7,5 0,37
		830			290 1,65	69 1,07	27 0,66	9 0,42
		900			353 1,83	85 1,20	33 0,74	11 0,47
0,3	1.080				110 1,39	43 0,85	15 0,54	5,3 0,35
	1.280				149 1,65	59 1,01	20 0,64	7,1 0,41
0,4	1.430				270 1,85	71 1,13	24 0,72	8 0,46
	1.605					87 1,27	30 0,81	10 0,52
0,5	1.805					107 1,43	36 0,91	13 0,58
	2.005					135 1,55	44 1,01	15 0,65
0,6	2.155					172 1,70	50 1,08	17 0,69
	2.330					200 1,8	57 1,17	20 0,75
0,7	2.530					225 1,98	66 1,27	23 0,82
	2.705						74 1,36	26 0,87
0,8	2.880						83 1,45	29 0,93
	3.005						89 1,51	31 0,97
0,9	3.255						103 1,63	36 1,05

Flow rate		$\varnothing$ 32x5,4	$\varnothing$ 40x6,7	$\varnothing$ 50x8,4	$\varnothing$ 63x10,5	$\varnothing$ 75x10,5	$\varnothing$ 90x12,5	$\varnothing$ 110x15,2	$\varnothing$ 125x20,8
l/s	kg/h								
1,0	3.600			143 1,8	43 1,16	14 0,73	7,9 0,5	2,8 0,35	
1,2	4.320			198 2,16	59 1,40	19 0,87	9,2 0,61	3,9 0,42	
1,3	4.680				66 1,49	22 0,93	10,6 0,66	4,5 0,46	
1,4	5.040					76 1,62	25 1,01	12,1 0,71	5,1 0,50
1,6	5.760					114 1,85	32 1,16	15,3 0,81	6,4 0,57
1,8	6.480					141 2,08	40 1,32	18,8 0,92	7,9 0,64
2,0	7.200					170 2,31	48 1,46	22,7 1,02	9,5 0,71
2,2	7.920						57 1,60	26,9 1,12	11,3 0,78
2,4	8.640						66 1,74	31,4 1,22	13,1 0,85
2,6	9.360						76 1,88	36,1 1,32	15,1 0,92
2,8	10.080						87 2,02	41,2 1,43	17,3 0,99
3,0	10.800						1113 2,17	46,6 1,53	19,5 1,06
3,5	12.600						149 2,53	61,4 1,78	25,7 1,24
4,0	14.400							77,9 2,04	32,6 1,41
4,5	16.200							96,2 2,29	40,2 1,59
5,0	18.000							116,2 2,55	48,5 1,77
6,0	21.600							161,1 3,06	67,2 2,12
7,0	25.200								88,6 2,48
8,0	28.800								112,7 2,83
9	32.400								139,3 3,18
10	36.000								139,3 3,18
11	39.600								64,8 2,38
12	43.200								77 2,61
13	46.800								90,0 2,85
15	50.400								104,0 3,09
17	54.000								55,6 2,38



## UNIT HEAD LOSS FOR PPR PIPING SYSTEM PIPES SDR 7,4 WITH WATER TEMPERATURE AT 10°C

Flow rate		Ø 25x4,2	Ø 32x4,4	Ø 40x5,5	Ø 50x6,9	Ø 63x8,7	Ø 75x10,4	Ø 90x12,5
I/s	kg/h							
0,10	360	16,9 0,39	5,2 0,24					
0,15	540	33,8 0,59	10,2 0,35					
0,20	720	55,4 0,79	16,7 0,47					
0,25	864	81,4 0,98	24,5 0,59					
0,30	1.080	111,6 1,18	33,6 0,71	11,7 0,45				
0,35	1.260	145,9 1,38	43,9 0,83	15,3 0,53				
0,40	1.440	184,2 1,57	55,3 0,95	19,2 0,61	6,7 0,39			
0,45	1.620	226,3 1,77	67,9 1,06	23,6 0,68	8,3 0,44			
0,50	1.800	272,2 1,96	81,5 1,18	28,3 0,76	9,9 0,49			
0,55	1.980	321,7 2,16	96,3 1,30	33,4 0,83	11,7 0,53			
0,60	2.160		112,2 1,42	38,9 0,91	13,6 0,58			
0,65	2.340		129,0 1,54	44,7 0,98	15,6 0,63	5,2 0,40		
0,70	2.520		147,0 1,66	50,9 1,06	17,8 0,68	6,0 0,43		
0,75	2.700		165,9 1,77	57,4 1,14	20,0 0,73	6,7 0,46		
0,80	2.880		185,9 1,89	64,3 1,21	22,4 0,78	7,5 0,49		
0,85	3.060		206,8 2,01	71,5 1,29	24,9 0,83	8,3 0,52		
0,90	3.240		228,7 2,13	79,1 1,36	27,6 0,87	9,2 0,55		
1,00	3.600			95,2 1,51	33,1 0,97	11,1 0,61	4,9 0,43	
1,20	4.320			131,2 1,82	45,6 1,17	15,2 0,73	6,7 0,52	
1,40	5.040			172,3 2,12	59,9 1,36	20,0 0,86	8,8 0,61	3,7 0,42
1,60	5.760				75,8 1,55	25,2 0,98	11,1 0,69	4,7 0,48
1,80	6.480				93,3 1,75	31,1 1,10	13,6 0,78	5,7 0,54
2,00	7.200				112,5 1,94	2,00 1,22	16,4 0,87	6,9 0,60
2,20	7.920				133,2 2,14	44,3 1,35	19,4 0,95	8,2 0,66
2,40	8.640					51,6 1,47	22,7 1,04	9,5 0,72
2,60	9.360					69,5 1,59	26,1 1,13	11,0 0,78

Flow rate		Ø 50x6,9	Ø 63x8,7	Ø 75x10,4	Ø 90x12,5	Ø 110x15,2	Ø 125x17,1	Ø 160x21,9
I/s	kg/h							
2,80	10.080			67,9 1,71	29,8 1,21	12,5 0,84	4,6 0,56	
3,00	10.800			76,7 1,84	33,6 1,30	14,1 0,90	5,4 0,60	2,9 0,46
3,50	12.600			100,9 2,14	44,2 1,52	18,6 1,05	7,1 0,70	3,8 0,54
4,00	14.400			128,0 2,45	56,0 1,73	23,5 1,21	8,9 0,80	4,8 0,62
4,50	16.200			158,0 2,76	69,1 1,95	29 1,36	11,0 0,90	5,9 0,69
5,00	18.000				83,4 2,17	35 1,51	13,3 1,00	7,1 0,77
5,50	19.800				98,9 2,38	41,5 1,66	15,7 1,11	8,4 0,85
6,00	21.600				115,6 2,60	48,4 1,81	18,4 1,21	9,8 0,93
6,50	23.400					55,9 2,11	20,6 1,29	11,3 1,00
7,00	25.200					63,8 2,11	24,2 1,41	12,9 1,08
7,50	27.000					72,2 2,26	27,3 1,51	14,6 1,16
8,00	28.800					81,0 2,41	30,7 1,61	16,3 1,24
9,00	32.400					100,0 2,71	97,9 1,81	20,2 1,39
10,00	36.000						45,8 2,01	24,4 1,54
11,00	39.600						54,3 2,21	28,9 1,70
12,00	43.200						63,5 2,41	33,8 1,85
13,00	46.800						73,3 2,61	39,0 2,01
14,00	50.400							44,5 2,16
15,00	54.000							50,4 2,32
16,00	57.600							56,6 2,47
17,00	61.200							63,1 2,63
20,00	79.200							
30,00	108.000							
40,00	144.000							
50,00	180.000							
60,00	216.000							

## UNIT HEAD LOSS FOR PPR PIPING SYSTEM PIPES SDR 11 WITH WATER TEMPERATURE AT 10°C

Flow rate		Ø 200x18,2	Ø 250x22,7
I/s	kg/h		
10,00	36.000	1,46 0,48	0,50 0,30
11,00	39.600	1,73 0,52	0,59 0,33
12,00	43.200	2,02 0,57	0,69 0,36
13,00	46.800	2,33 0,62	0,80 0,40
14,00	50.400	2,65 0,67	0,91 0,43
15,00	54.000	3,00 0,71	1,03 0,46
16,00	57.600	3,37 0,76	1,16 0,49
17,00	61.200	3,75 0,81	1,29 0,52
18,00	64.800	4,16 0,86	1,43 0,55
19,00	68.400	4,58 0,90	1,57 0,58
20,00	72.000	5,02 0,95	1,72 0,95
25,00	90.000	7,49 1,19	2,56 0,76
30,00	108.000	10,40 1,43	3,56 0,91
35,00	126.000	13,73 1,66	4,69 1,06
40,00	144.000	17,47 1,90	5,97 1,22
45,00	162.000	21,61 2,14	7,38 1,37
50,00	180.000	26,14 2,38	8,92 1,52
55,00	12.600	31,07 2,62	10,60 1,67
60,00	14.400		12,40 1,82
66,00	16.200		14,74 2,01
70,00	18.000		
75,00	21.600		
80,00	25.200		
90,00	18.000		

## UNIT HEAD LOSS FOR BLUE PPR FIBER GLASS PIPES SDR 11 WITH WATER TEMPERATURE AT 10°C (Ø32 TO 125)

Flow rate		Ø 20x2,8	Ø 25x3,5	Ø 32x2,9	Ø 40x3,7	Ø 50x4,6	Ø 63x5,8	Ø 75x6,8	Ø 90x8,2
l/s	kg/h								
0,10	360	48,4 0,61	17,0 0,39	2,9 0,19					
0,15	540	96,8 0,92	33,8 0,59	6,5 0,30	Head loss in mm c.a./m				
0,20	720	159,0 1,23	55,4 0,79	9,4 0,37	Average speed in m/s				
0,25	864			13,8 0,46					
0,30	1.080	321,6 1,84	111,6 1,18	18,9 0,56	6,7 0,36				
0,35	1.260			24,7 0,65	8,8 0,42				
0,40	1.440	531,8 2,46	184,3 1,57	31,1 0,74	11,1 0,48	3,8 0,31			
0,45	1.620			38,1 0,83	13,6 0,54	4,7 0,34			
0,50	1.800	787,0 3,07	272,3 1,96	45,8 0,93	16,3 0,60	5,6 0,38			
0,55	1.980			54,1 1,02	19,2 0,66	6,6 0,42			
0,60	2.160		375,0 2,36	63,0 1,11	22,3 0,72	7,7 0,46			
0,65	2.340			72,1 1,21	25,7 0,78	8,9 0,50	3,0 0,31		
0,70	2.520		492,0 2,75	82,5 1,30	29,2 0,84	10,1 0,54	3,4 0,34		
0,75	2.700			93,1 1,39	33,0 0,90	11,4 0,36	3,8 0,57		
0,80	2.880		622,7 3,14	104,2 1,48	36,9 0,96	12,7 0,61	4,3 0,39		
0,85	3.060			116,0 1,58	41,0 1,02	14,1 0,65	4,7 0,41		
0,90	3.240				43,3 1,08	15,8 0,69	5,2 0,43		
1,00	3.600				54,5 1,20	18,8 0,76	6,3 0,48	2,7 0,34	
1,20	4.320				75,2 1,44	25,8 0,92	8,6 0,58	3,7 0,41	
1,40	5.040				98,7 1,68	33,9 1,07	11,3 0,67	4,9 0,47	2,1 0,33
1,60	5.760					42,9 1,22	14,3 0,77	6,1 0,54	2,6 0,38
1,80	6.480					52,8 1,38	21,1 0,96	9,1 0,68	3,8 0,47
2,00	7.200					63,6 1,53	21,1 0,96	9,1 0,68	3,8 0,47
2,20	7.920					73,2 1,68	25,0 1,06	10,7 0,74	4,5 0,52
2,40	8.640						29,2 1,16	12,5 0,81	5,3 0,56
2,60	9.360						33,6 1,25	14,4 0,9	6,1 0,6

Flow rate		Ø 50x4,6	Ø 63x5,8	Ø 75x6,8	Ø 90x8,2	Ø 110x10	Ø 125x11,4
l/s	kg/h						
2,80	10.080		38,3 1,35	16,4 0,9	6,9 0,7	2,7 0,4	
3,00	10.800		43,3 1,45	18,5 1,01	7,8 0,71	3,0 0,47	1,6 0,37
3,50	12.600		57,0 1,69	24,4 1,18	10,3 0,82	3,9 0,55	2,1 0,43
4,00	14.400		72,2 1,93	30,9 1,4	13,0 0,9	5,0 0,6	2,7 0,5
4,50	16.200			38,1 1,5	16,0 1,1	6,1 0,7	3,3 0,5
5,00	18.000			46,0 1,69	19,3 1,18	7,4 0,79	4,0 0,61
5,50	19.800			54,5 1,86	22,9 1,29	8,8 0,86	4,8 0,67
6,00	21.600			63,6 2,0	26,7 1,4	10,2 0,9	5,6 0,7
7,00	25.200				35,2 1,6	13,4 1,1	7,3 0,9
8,00	28.800				44,7 1,9	17,1 1,3	9,3 1,0
9,00	32.400					21,1 1,4	11,5 1,1
10,00	36.000					25,4 1,57	13,8 1,22
11,00	39.600					30,1 1,73	16,4 1,34
12,00	43.200					35,2 1,89	19,2 1,46
13,00	46.800					40,7 20,4	22,1 1,58
14,00	50.400						25,3 1,71
15,00	54.000						28,6 1,83
16,00	57.600						32,1 1,95
17,00	61.200						
18,00	64.800						
19,00	68.400						
20,00	72.000						
25,00	90.000						
30,00	108.000						
35,00	126.000						
40,00	144.000						



## UNIT HEAD LOSS FOR BLUE PPR FIBER GLASS PIPES SDR 11 WITH WATER TEMPERATURE AT 10°C (Ø160 TO 400)

Flow rate		$\emptyset$ 160x14,6	$\emptyset$ 200x18,2	$\emptyset$ 250x22,7	$\emptyset$ 315x28,6	$\emptyset$ 400x36,3
l/s	kg/h					
5,00	18.000	1,2 0,37	0,4 0,24	0,1 0,15		
5,50	19.800	1,5 0,41	0,5 0,26	0,2 0,17		
6,00	21.600	1,7 0,4	0,6 0,29	0,2 0,18		
7,00	25.200	2,3 0,5	0,8 0,33	0,2 0,18		
8,00	28.800	2,9 0,6	1,0 0,38	0,3 0,21		
9,00	32.400	3,5 0,7	1,2 0,48	0,4 0,27		
10,00	36.000	4,2 0,74	1,5 0,48	0,5 0,30		
11,00	39.600	5,0 0,82	1,7 0,52	0,6 0,33		
12,00	43.200	5,9 0,89	2,0 0,57	0,7 0,36		
13,00	46.800	6,8 0,97	2,3 0,62	0,8 0,40		
14,00	50.400	7,7 1,04	2,7 0,67	0,9 0,43		
15,00	54.000	8,8 1,12	3,0 0,71	1,0 0,46		
16,00	57.600	9,8 1,19	3,4 0,76	1,2 0,49		
17,00	61.200	11,0 1,27	3,8 0,81	1,3 0,52		
18,00	64.800	12,1 1,34	4,2 0,86	1,4 0,55		
19,00	68.400	13,4 1,41	4,6 0,90	1,6 0,58		
20,00	72.000	14,7 1,49	5,0 0,95	1,7 0,61		
25,00	90.000	21,9 1,86	7,5 1,19	2,6 0,76	0,8 0,48	0,3 0,30
30,00	108.000	30,5 2,23	10,4 1,43	3,6 0,91	1,2 0,57	0,4 0,36
35,00	126.000		13,7 1,66	4,7 1,06	1,5 0,67	0,5 0,42
40,00	144.000		17,5 1,9	6,0 1,22	2,0 0,77	0,6 0,48

# 4.7 FITTING HEAD LOSS (DIN 1988)

## LOCAL RESISTANCE COEFFICIENTS R FOR PPR PIPING SYSTEM FITTINGS

Figure	No.	Graphic symbol	Resistance coefficient r
90° Elbow	90		2,0
Male threaded elbow	90M		2,2
45° Elbow	120		0,6
Tee	130		1,8
Reduced Tee	130R		3,6
Tee union	130		1,3
Reduced Tee	130R		2,6
Tee union	130		4,2
Reduced Tee	130R		9
Tee union	130		2,2
Reduced Tee	130R		5,0
Threaded Tee	130F		0,8
Adapter up to 2 sizes	241		0,55
Adapter from 3 sizes	241		0,85
Coupler	270		0,25
Male threaded union	270M		0,4
Reduced male threaded union	270RM		0,85

The table shows the head loss z with a coefficient r = 1 for water transport at 10°C at different v flow rate values (m/s).

Flow rate v m/s	0,1	0,2	0,3	0,4	0,5	0,6	0,7	0,8	0,9	1,0	1,1	1,2	1,3	1,4	1,5	1,6	1,7	1,8	1,9	2,0	2,1	2,2	2,3	2,4	2,5
Head loss z (mbar)	0,1	0,2	0,5	0,8	1,3	1,8	2,5	3,2	4,1	5,0	6,1	7,2	8,5	9,8	11,3	12,8	14,5	16,2	18,1	20,0	22,1	24,2	26,5	28,8	31,3

Flow rate v m/s	2,6	2,7	2,8	2,9	3,0	3,1	3,2	3,3	3,4	3,5	3,6	3,7	3,8	3,9	4,0	4,1	4,2	4,3	4,4	4,5	4,6	4,7	4,8	4,9	5,0
Head loss z (mbar)	33,8	36,5	39,2	42,1	45	48	51	55	58	61	65	68	72	76	80	84	88	92	97	101	106	110	115	120	125

1 mbar = 10,1 mm c.a.

The local pressure drop z is the result of the formula  $z = 5v^2 \cdot \sum r$  and the total head loss of the system is the sum of the distributed head loss and the total of local head loss z.



## 4.8 SYSTEM DIMENSIONING (UNI9182)

### 4.8.1 HOW TO USE LOAD UNITS

The load unit is the value assumed conventionally according to the flow of a dispensing point, its characteristics and its frequency of use, used for the calculation of the maximum flow in a contemporaneous distribution of water.

1. The values indicated in the column "Cold water" shall be used to calculate the distribution of cold water.
2. The values indicated in the column "Hot water" shall be used to calculate the distributions of hot water.
3. The values indicated in the column "Total hot + cold water" shall be used to calculate the overall values of load units and the corresponding flow rate upstream of the system for the preparation of hot water.

In case of connections to single units, refer to tables D.1 and D.2.

### LOAD UNITS FOR PRIVATE HOUSING

SINGLE UNITS - TABLE D.1

Unit	Supply	Load units		
		Cold water	Hot water	Total hot + cold water
Washbasin	mixer unit	0,75	0,75	1,00
Bidet	mixer unit	0,75	0,75	1,00
Bath tub	mixer unit	1,50	1,50	2,00
Shower	mixer unit	1,50	1,50	2,00
WC bowl	cistern	3,00	-	3,00
WC bowl	jet flush or flow meter	6,00	-	6,00
Kitchen sink	mixer unit	1,50	1,50	2,00
Washing machine	cold water only	2,00	-	2,00
Dishwasher	cold water only	2,00	-	2,00
Washer	mixer unit	1,50	1,50	2,00
Ø 3/8" hydrant	cold water only	1,00	-	1,00
Ø ½" hydrant	cold water only	2,00	-	2,00
Ø ¾" hydrant	cold water only	3,00	-	3,00
Ø 1" hydrant	cold water only	6,00	-	6,00

## LOAD UNITS FOR PUBLIC AND COLLECTIVE BUILDINGS (HOTELS, OFFICES, HOSPITALS ETC.)

SINGLE UNITS - TABLE D.2

Unit	Supply	Load units		
		Cold water	Hot water	Total hot + cold water
Washbasin	mixer unit	1,50	1,50	2,00
Bidet	mixer unit	1,50	1,50	2,00
Bath tub	mixer unit	3,00	3,00	4,00
Shower	mixer unit	3,00	3,00	4,00
WC bowl	cistern	5,00	-	5,00
WC bowl	jet flush or flow meter	10,00	-	10,00
Urinal	urinal tap	0,75	-	0,75
Urinal	jet flush or flow meter	10,00	-	10,00
Sink	mixer unit	2,00	2,00	3,00
Kitchen washtub	mixer unit	3,00	3,00	4,00
Washer	mixer unit	2,00	2,00	3,00
Slop sink	cistern	5,00	-	5,00
Slop sink	jet flush or flow meter	10,00	-	10,00
Washing-through washbasin (for each position)	mixer unit	1,50	1,50	2,00
Feet-pool	mixer unit	1,50	1,50	2,00
Bedpan washer	mixer unit	2,00	2,00	3,00
Medical washbasin	mixer unit	1,50	1,50	2,00
Drinking fountain	spring tap	0,75	-	0,75
Emergency shower	pressure control	3,00	-	3,00
Ø 3/8" hydrant	cold water only	2,00	-	2,00
Ø ½" hydrant	cold water only	4,00	-	4,00
Ø ¾" hydrant	cold water only	6,00	-	6,00
Ø 1" hydrant	cold water only	10,00	-	10,00



## INFORMATION APPENDIX – NOMINAL FLOW AND PRESSURE RATES OF DELIVERY TAPS FOR SANITARY WARE AND OTHER USES

The flow rates indicated in table C.1 are intended as minimum. For correct sizing, to ensure the efficient functioning of the device, use the values indicated by the manufacturer. To maintain water quality under an hygienic point of view, it is necessary to avoid unnecessary over-sizing of the pipes.

Unit	Flow rate l/s *	Minimum pressure kPa
Washbasin	0,10	100
Bidet	0,10	100
WC bowl	0,10	100
WC bowl with jet flush or flow meter	1,00	100
Bath tub	0,30	100
Shower	0,15	100
Kitchen sink	0,15	100
Washing machine	0,15	100
Urinal	0,15	100
Hydrant/garden tap	0,40	100

\* Calculated at a pressure of 3 bar

The maximum allowable speed circuits <sup>1)</sup> are as follows:

- primary distribution, risers, piping distribution at the floor: max 2,0 m/s;
- supply line to the single unit: max 4,0 m/s.

<sup>(1)</sup> Values of speed as per UNI EN 806-3

# DETERMINATION OF THE MAXIMUM SIMULTANEOUS FLOW BY THE METHOD OF LOAD UNITS, HOT AND COLD WATER

## UNITS IN PRIVATE HOMES AND COLLECTIVE BUILDINGS (HOTELS, HOSPITALS, SCHOOLS, BARRACKS, SPORTS CENTRES AND THE LIKE)

TABLE D.3 - WC BOWLS WITH CISTERNS

Load Unit	Flow l/s	Load Unit	Flow l/s	Load Unit	Flow l/s
6	0,30	120	3,65	1.250	15,50
8	0,40	140	3,90	1.500	17,50
10	0,50	160	4,25	1.750	18,80
12	0,60	180	4,60	2.000	20,50
14	0,68	200	4,95	2.250	22,00
16	0,78	225	5,35	2.500	23,50
18	0,85	250	5,75	2.750	24,50
20	0,93	275	6,10	3.000	26,00
25	1,13	300	6,45	3.500	28,00
30	1,30	400	7,80	4.000	30,50
35	1,46	500	9,00	4.500	32,50
40	1,62	600	10,00	5.000	34,50
50	1,90	700	11,00	6.000	38,00
60	2,20	800	11,90	7.000	41,00
70	2,40	900	12,90	8.000	44,00
80	2,65	1.000	13,80	9.000	47,00
90	2,90			10.000	50,00
100	3,15				



TABLE D.4 - WC BOWLS WITH JET FLUSH OR FLOW METER

Load Unit	Flow l/s	Load Unit	Flow l/s	Load Unit	Flow l/s
10	1,70	120	7,15	1.250	21,00
12	1,90	140	7,50	1.500	23,00
14	2,10	160	8,00	1.750	24,50
16	2,27	180	8,50	2.000	26,00
18	2,45	200	9,00	2.250	27,50
20	2,60	225	9,50	2.500	28,50
25	2,95	250	10,00	2.750	29,50
30	3,25	275	10,50	3.000	30,50
35	3,55	300	11,00	3.500	33,00
40	3,80	400	12,70	4.000	35,00
50	4,30	500	14,00	4.500	36,50
60	4,80	600	15,10	5.000	37,50
70	5,25	700	16,30	6.000	40,50
80	5,60	800	17,30	7.000	44,00
90	6,00	900	18,20	8.000	46,00
100	6,35	1.000	19,00	9.000	48,00
				10.000	50,00

## UNITS IN OFFICE BUILDINGS AND THE LIKE

TABLE D.5 - WC BOWLS WITH CISTERNS

Load Unit	Flow l/s	Load Unit	Flow l/s	Load Unit	Flow l/s
6	0,30	120	2,90	1.250	11,30
8	0,40	140	3,20	1.500	12,40
10	0,50	160	3,50	1.750	13,60
12	0,60	180	3,75	2.000	14,50
14	0,67	200	3,95	2.250	15,40
16	0,75	225	4,25	2.500	16,20
18	0,82	250	4,50	2.750	17,00
20	0,89	275	4,80	3.000	18,00
25	1,05	300	5,05	3.500	19,50
30	1,18	400	6,00	4.000	21,00
35	1,35	500	6,90	4.500	22,00
40	1,45	600	7,55	5.000	23,50
50	1,65	700	8,30	6.000	25,50
60	1,90	800	8,80	7.000	27,50
70	2,10	900	9,50	8.000	29,00
80	2,25	1.000	10,00	9.000	30,50
90	2,45			10.000	32,00
100	2,60				

TABLE D.6 - WC BOWLS WITH JET FLUSH OR FLOW METER

Load Unit	Flow l/s	Load Unit	Flow l/s	Load Unit	Flow l/s
10	1,70	120	5,80	1.250	15,50
12	1,87	140	6,20	1.500	16,50
14	2,03	160	6,60	1.750	17,50
16	2,17	180	7,10	2.000	18,50
18	2,32	200	7,45	2.250	19,20
20	2,45	225	7,80	2.500	20,00
25	2,75	250	8,10	2.750	20,70
30	3,00	275	8,40	3.000	21,40
35	3,25	300	8,70	3.500	22,50
40	3,55	400	9,80	4.000	24,00
50	3,90	500	10,80	4.500	25,00
60	4,20	600	11,60	5.000	26,20
70	4,50	700	12,40	6.000	28,00
80	4,80	800	13,00	7.000	29,00
90	5,15	900	13,70	8.000	30,00
100	5,35	1.000	14,20	9.000	31,50
				10.000	32,00



## 4.9 HOT SANITARY WATER SUPPLY

To correctly dimension a central hot sanitary water supply system according to Standard UNI 9182, it is necessary to calculate the maximum simultaneous hourly consumption of **hot water at 40°C** using the following formula:

$$Q_{max} = \left[ \frac{q_1 \times N_1}{d_1} + \frac{q_2 \times N_2}{d_2} + \frac{q_n \times N_n}{d_n} \right] \times f_1 \times f_2 \times f_3$$

where:

**Q<sub>max</sub>** = Simultaneous max. hourly consumption (l/h)

**q<sub>1</sub>, q<sub>2</sub>, q<sub>n</sub>** = Consumption for each reference unit (accommodation unit, apartment, users) (l)

**N<sub>1</sub>, N<sub>2</sub>, N<sub>n</sub>** = Number of reference units corresponding to consumptions q<sub>1</sub>, q<sub>2</sub>...q<sub>n</sub>

**d<sub>1</sub>, d<sub>2</sub>, d<sub>n</sub>** = Duration corresponding to consumption q<sub>1</sub> N<sub>1</sub>, q<sub>2</sub> N<sub>2</sub> ... q<sub>n</sub> N<sub>n</sub> (h) just for houses

**f<sub>1</sub>** = Factor for number of accommodation units

**f<sub>2</sub>** = Factor for number of rooms in each accommodation unit

**f<sub>3</sub>** = Factor for standard of living

**q** = Average daily requirements per person

TABLE E.1 - HOT WATER: DEMAND PER PERSON

Building type	<b>q = Liters per person / day</b>
Houses *	
a) standard house	from 40 to 50
b) average house	from 70 to 80
c) luxury house	from 150 to 200
Hotels and small hotels	
a) rooms with private bathroom including bath tub	from 180 to 200
b) rooms with private bathroom including shower	130
c) rooms with washbasin and bidet	60
Offices	from 15 to 200
Hospitals and health care facilities	from 130 to 150
Sports centres	from 50 to 60
Changing rooms	from 30 to 50

\*The values indicated shall be multiplied by the correction factors indicated in the following tables to take into account the number of homes, the size of each home and the living standard of the user.

**N** = Average daily requirements per use

TABLE E.2 - HOT WATER: DEMAND PER UNIT AT EVERY USE

<b>Unit</b>	<b>N=1</b>
Bath tub 170 cm x 70 cm with hand shower	from 160 to 200
Bath tub 105 cm x 70 cm	from 100 to 120
Shower	from 50 to 60
Washbasin	from 10 to 12
Bidet	from 8 to 10
Kitchen sink	from 15 to 20

**d** = Duration of peak time

TABLE F.1 - DURATION OF THE PERIOD OF PEAK CONSUMPTION OF HOT WATER

<b>Housing type</b>	<b>d = duration of peak time h</b>
Houses a) with up to 4 rooms b) with more than 4 rooms	from 2 to 2,5 3
Hotels and small hotels* a) rooms with private bathroom including bath tub or shower b) rooms with washbasin and bidet	from 2,5 to 3 from 3 to 4
Offices	1
Hospitals and health care facilities	from 3 to 4
Sports centres**	1
Changing rooms**	1

\* Except hotels designed to receive large groups for which the duration can decrease from 1 h to 1,5 h

\*\* The durations indicated are to be referred to the consumption corresponding to the actual number of users



**f1 – Multiplying factor of hot water supply in liters/person-day  
according to the NUMBER OF ACCOMODATION UNITS**

Number of accomodation units	Multiplying factor
1	1,15
2	0,86
3	0,73
4	0,65
5	0,60
6	0,56
7	0,53
8	0,50
9	0,48
10	0,47
11	0,46
12	0,35
13	0,44
14	0,44
15	0,43
16	0,43
17	0,42
18	0,42
19	0,41
20	0,41
21	0,40
22	0,40
23	0,39
24	0,39
25	0,38
from 26 to 30	0,36
from 31 to 35	0,35
from 36 to 40	0,34
from 41 to 45	0,33
from 51 to 60	0,31
from 61 to 70	0,30
from 71 to 80	0,29
from 81 to 90	0,29
from 91 to 100	0,28
from 101 to 125	0,27
from 126 to 150	0,26
from 151 to 200	0,25
from 201 to 300	0,24
from 301 to 400	0,23

**f2 – Multiplying factor of hot water supply in liters/person-day  
according to the NUMBER OF ROOMS**

Number of rooms	Multiplying factor
1	0,8
2	0,9
from 3 to 4	1
from 5 to 6	1,1
from 7 to 8	1,2
from 9 to 10	1,3
from 10 to 12	1,4
more than 12	1,5

**f3 – Multiplying factor of hot water supply in liters/person-day  
according to the STANDARD OF LIVING**

Standard of living	Multiplying factor
Low	0,8
Moderate	0,9
Standard	1,0
Good	1,1
High	1,2

Calculation of the maximum simultaneous flow rate according to the load unit method, cold water and hot water (WC bowls with cisterns - to be considered only for cold water) for private housing and collective building units.

## **PPR PIPING SYSTEM RISERS WITH SDR 6 PIPES (MAX VELOCITY CONSIDERED 2,5 M/S)**

UC Load unit	Maximum simultaneous flow rate l/s	PPR PIPING SYSTEM pipe SDR 6
6	0,30	20
8	0,40	25
10	0,50	32
12	0,60	
14	0,68	
16	0,78	
18	0,85	
20	0,93	
25	1,13	40
30	1,30	
35	1,46	
40	1,62	50
50	1,90	
60	2,20	
70	2,40	
80	2,65	63
90	2,90	
100	3,15	
120	3,65	
140	3,90	
160	4,25	75
180	4,60	
200	4,95	
225	5,35	
250	5,75	90
275	6,10	
300	6,45	
400	7,8	
500	9,00	110
600	10,00	
700	11,00	
800	11,90	
900	12,90	
1000	13,80	125

## **PPR PIPING SYSTEM RISERS WITH SDR 7.4 PIPES (MAX VELOCITY CONSIDERED 2,5 M/S)**

UC Load unit	Maximum simultaneous flow rate l/s	PPR PIPING SYSTEM pipe SDR 7,4
6	0,30	20
8	0,40	25
10	0,50	
12	0,60	
14	0,68	
16	0,78	32
18	0,85	
20	0,93	
25	1,13	
30	1,30	40
35	1,46	
40	1,62	
50	1,90	50
60	2,20	
70	2,40	
80	2,65	
90	2,90	
100	3,15	63
120	3,65	
140	3,90	
160	4,25	
180	4,60	75
200	4,95	
225	5,35	
250	5,75	
275	6,10	90
300	6,45	
400	7,80	
500	9,00	
600	10,00	110
700	11,00	
800	11,90	
900	12,90	
1000	13,80	125
1500	17,50	
1750	18,80	
2000	20,50	
2250	22,00	160
2500	23,50	
3000	26,00	


This table shows that a Ø 90 SDR 7.4 pipe can simultaneously supply 250 load units ( $250 / 7 = 35$  apartments with bathroom and kitchen).



## 4.10 SYSTEM TESTING

The testing of the water supply system is carried out through **tests and checks during the installation** (for the parts that are no longer accessible once the work is completed) and **tests and final checks** for the implementation of contractual obligations.

**The cold hydraulic test pressure prescribed by European standards CEN TR 12108 and EN 806-4 (Procedure C) is carried out according to the following procedure.**

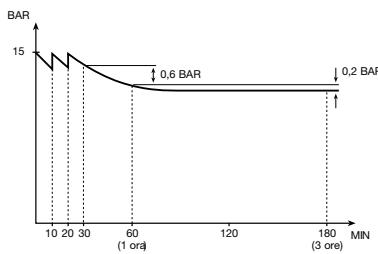

**N.B.:**

Testing pressure shall be reduced if radiators, taps or valves are present.

- 1 Fill the system slowly to vent it (do not fully tighten the highest plugs that will be closed when the water will come out with a continuous jet).
- 2 Bring the pressure up to 15 bar and repeat the process 2 more times every 10 minutes.
- 3 Measure the pressure after the first 30 minutes.
- 4 Read the pressure after another 30 minutes (1 hour). If the difference is less than 0,6 bar, there is no pressure drop and the test can be continued with the same pressure for 2 more hours.
- 5 In these last 2 hours the pressure must not drop more than 0,2 bar.
- 6 The results of this test shall be recorded.

### IT IS ALSO IMPORTANT TO PERFORM:

- Cold water supply test with cold water bleed from all utilities to check the flow rate and pressure.
- Hot water supply test with hot water bleed from all utilities to check the flow rate and pressure.
- Noise level check in accordance with the regulations in force.

# 4.11 CHEMICAL COMPATIBILITY OF PPR

This chart shows the chemical resistance of polypropylene resin under static conditions and not under pressure.

**Note:** the user is advised to carry out his/her own tests to determine the suitability of polypropylene in a particular environment

## A = Negligible effect

The material should be suitable for all applications where these environmental conditions exist.

## B = Limited absorption or attack

The material should be suitable for most applications but the user is advised to carry out his/her own tests to determine the suitability of polypropylene in a particular environment.

## C = Extensive absorption and/or rapid permeation

The material should be suitable for applications where only intermittent service is involved, or where the swelling produced has no detrimental effect on the part. The user should carry out his/her own tests to determine the suitability of polypropylene in a particular environment.

## D = Extensive attack

The specimen dissolves or disintegrates. Polypropylene is not recommended.

Environment	Conc. %	Temp.			
		20°C	60°C	100°C	
Acetic acid (glacial)	97	A	B (80°C)	-	
Acetic acid	50	A	A (80°C)	-	
Acetic acid	40	A	-	-	
Acetic acid	10	A	A	-	
Acetone	100	A	A	-	
Acetophenone	100	B	B	-	
Acriflavine (2% solution in H <sub>2</sub> O)	2	A	A	(80°C)	
Acrylic emulsions		A	A	-	
Aluminum chloride		A	A	-	
Aluminum fluoride		A	A	-	
Aluminum sulfate		A	A	-	
Alums (all types)		A	A	-	
Ammonia (aqueous)	30	A	-	-	
Ammonia gas (dry)		A	A	-	
Ammonium carbonate	Satd.	A	A	-	
Ammonium chloride	Satd.	A	A	-	
Ammonium fluoride	20	A	A	-	
Ammonium hydroxide	10	A	A	-	
Ammonium metaphosphate	Satd.	A	A	-	
Ammonium nitrate	Satd.	A	A	-	
Ammonium persulfate	Satd.	A	A	-	
Ammonium sulfate	Satd.	A	A	-	
Ammonium sulfide	Satd.	A	A	-	
Ammonium thiocyanate	Satd.	A	A	-	
Amyl acetate	100	B	C	-	
Amyl alcohol	100	A	B	-	
Amyl chloride	100	C	C	-	
Aniline	100	A	A	-	
Anisole	100	B	B	-	
Antimony chloride		A	A	-	
Aviation fuel (115/145 octane)	100	B	C	-	
Aviation turbine fuel	100	B	C	-	
Barium carbonate					
Barium chloride					
Barium hydroxide					
Barium sulfate					
Barium sulfide					
Beer					
Benzene					
Benzoic acid					
Benzyl alcohol					
Bismuth carbonate					
Borax					
Boric acid					
Brine					
Bromine liquid					
Bromine water					
Butyl acetate					
Butyl alcohol					
Calcium carbonate					
Calcium chlorate					
Calcium chloride					
Calcium hydroxide					
Calcium hypochlorite bleach					
Calcium nitrate					
Calcium phosphate					
Calcium sulfate					
Calcium sulfite					
Carbon dioxide (dry)					
Carbon dioxide (wet)					
Carbon disulfide					
Carbon monoxide					
Carbon tetrachloride					
Carbonic acid					
Castor oil					

(a) May produce cracking in material under stress



Environment	Conc. %	Temp.		
		20°C	60°C	100°C
Cetyl alcohol	100	A	-	-
Chlorine (gas)	100	D	D	-
Chlorobenzene	100	C	C	-
Chloroform	100	C	D	D
Chlorosulfonic acid	100	D	D	D
Chrome alum		A	A	-
Chromic acid	80(a)	A	-	-
Chromic acid	50(a)	A	A	-
Chromic acid	10(a)	A	A	-
Chromic/sulfuric acid		D	D	-
Cider		A	A	-
Citric acid	10	A	A	-
Copper chloride	Satd.	A	A	-
Copper cyanide	Satd.	A	A	-
Copper fluoride	Satd.	A	A	-
Copper nitrate	Satd.	A	A	-
Copper sulfate	Satd.	A	A	-
Cottonseed oil		A	A	-
Cuprous chloride	Satd.	A	A	-
Cyclohexanol	100	A	B	-
Cyclohexanone	100	B	C	-
Decalin	100	C	C	C
Detergents	2	A	A	A
Developers (photographic)		A	A	-
Dibutyl phthalate	100	A	B	D
Dichloroethylene	100	A	-	-
Diethanolamine	100	A	A	-
Diisooctyl phthalate	100	A	A	-
Emulsifiers		A	A	-
Ethanolamine	100	A	A	-
Ethyl acetate	100	B	B	-
Ethyl alcohol	96	A	A (80°C)	-
Ethyl chloride	100	C	C	-
Ethylene dichloride	100	B	-	-
Ethylene glycol		A	A	-
Ethylene oxide	100		-	-
Ethyl ether	100	B	-	-
Fatty acids (C <sub>6</sub> )	100	A	A	-
Ferric chloride	Satd.	A	A	-
Ferric nitrate	Satd.	A	A	-
Ferric sulfate	Satd.	A	A	-
Ferrous chloride	Satd.	A	A	-
Ferrous sulfate	Satd.	A	A	-
Fluorosilicic acid		A	A	-
Formaldehyde	40	A	A	-
Formic acid	100	A	-	-
Formic acid	10	A	A	-
Fructose		A	A	-
Fruit juices		A	A	-
Furfural	100	C	C	-
Gas liquor		C	-	-
Gasoline	100	B	C	C
Gearbox oil	100	A	B	-
Gelatin		A	A	-

(a) May produce cracking in material under stress

Environment	Conc. %	Temp.		
		20°C	60°C	100°C
Glucose	20	A	A	-
Glycerin	100	A	A	A
Glycol		A	A	-
Hexane	100	A	B	-
Hydrobromic acid	50(a)	A	A	-
Hydrobromic acid	30(a)	A	B	D
Hydrobromic acid	20	A	A (80°C)	-
Hydrobromic acid	10	A	A (80°C)	B
Hydrobromic acid	2	A	A	A
50-50 HCl-HNO <sub>3</sub>	(a)	B	D (80°C)	-
Hydrofluoric acid	40	A	-	-
Hydrofluoric acid	60(a)	A	A (40°C)	-
Hydrogen chloride gas (dry)	100	A	A	-
Hydrogen peroxide	30	A	-	D
Hydrogen peroxide	10	A	B	-
Hydrogen peroxide	3	A	-	-
Hydrogen sulfide		A	A	-
Hydroquinone		A	A	-
Inks		A	A	-
Iodine tincture		A	-	-
Isooctane	100	C	C	-
Isopropyl alcohol	100	A	A	-
Ketones		A	-	-
Lactic acid	20	A	A	-
Lanolin	100	A	A	-
Lead acetate	Satd.	A	A	-
Linseed oil	100	A	A	-
Lubricating oil	100	A	B	-
Magenta dye (aqueous solution)	2	A	Some staining	-
Magnesium carbonate	Satd.	A	A	-
Magnesium chloride	Satd.	A	A	-
Magnesium hydroxide	Satd.	A	A	-
Magnesium nitrate	Satd.	A	A	-
Magnesium sulfate	Satd.	A	A	-
Magnesium sulfite	Satd.	A	A	-
Meat juices		A	A	-
Mercuric chloride	40	A	A	-
Mercuric cyanide	Satd.	A	A	-
Mercurous nitrate	Satd.	A	A	-
Mercury	100	A	A	-
Methyl alcohol	100	A	A	-
Methylene chloride	100	A	-	-
Methyl ethyl ketone	100	A	B	-
Milk and its products		A	A	A
Mineral oil	100	A	B	-
Molasses		A	A	-
Motor oil	100	A	B	-
Naphthalene	100	A	A	A
Nickel chloride	Satd.	A	A	-

Environment	Conc. %	Temp.			
		20°C	60°C	100°C	
Nickel nitrate	Satd.	A	A	-	
Nickel sulfate	Satd.	A	A	-	
Nitric acid	fuming	D	D	D	
Nitric acid	70(a)	C	D	-	
Nitric acid	60	A	D (80°C)	-	
Nitric acid	10	A	A	A	
50-50 HNO <sub>3</sub> -HCl	(a)	B	D (80°C)	-	
50-50 HNO <sub>3</sub> -H <sub>2</sub> SO <sub>4</sub>	(a)	C	D (80°C)	-	
Nitrobenzene	100	A	A	-	
Oleic acid		A	B	-	
Oleum	-	-	-	D	
Olive oil	100	A	A	-	
Oxalic acid (aqueous)	50	A	B	-	
Paraffin	100	A	B	-	
Paraffin wax	100	A	A	-	
Petrol	100	B	C	-	
Petroleum ether (boiling point 100°-140°C)	100	C	C	-	
Phenol	100	A	A	-	
Phosphoric acid	95	A	A	-	
Plating solutions, brass		A	A	-	
Plating solutions, cadmium		A	A	-	
Plating solutions, chromium		A	A	-	
Plating solutions, copper		A	A	-	
Plating solutions, gold		A	A	-	
Plating solutions, indium		A	A	-	
Plating solutions, lead		A	A	-	
Plating solutions, nickel		A	A	-	
Plating solutions, rhodium		A	A	-	
Plating solutions, silver		A	A	-	
Plating solutions, tin		A	A	-	
Plating solutions, zinc		A	A	-	
Potassium bicarbonate	Satd.	A	A	-	
Potassium borate	1	A	A	-	
Potassium bromate	10	A	A	-	
Potassium bromide	Satd.	A	A	-	
Potassium carbonate	Satd.	A	A	-	
Potassium chlorate	Satd.	A	A	-	
Potassium chloride	Satd.	A	A	-	
Potassium chromate	40	A	A	-	
Potassium cyanide	Satd.	A	A	-	
Potassium dichromate	40	A	A	-	
Potassium ferri-/ferrocyanide		A	A	-	
Potassium fluoride		A	A	-	
Potassium hydroxide	50	A	A	-	
Potassium hydroxide	10	A	A	A	
Potassium nitrate	Satd.	A	A	-	
Potassium perborate	Satd.	A	A	-	
Potassium perchlorate	10	A	A	-	
Potassium permanganate	20	A	A	-	
Potassium sulfate		A	A	-	
Potassium sulfide		A	A	-	
Potassium sulfite		A	A	-	
Propyl alcohol	100	A	A	-	
Pyridine	100	A	-	-	
(a) May produce cracking in material under stress					
Environment	Conc. %	Temp.			
		20°C	60°C	100°C	
Silicone oil	100	A	A	-	
Soap solution (concentrated)			A	A	-
Sodium acetate			A	A	-
Sodium bicarbonate	Satd.	A	A	-	
Sodium bisulfate	Satd.	A	A	-	
Sodium bisulfite	Satd.	A	A	-	
Sodium borate			A	A	-
Sodium bromide oil solution			A	A	-
Sodium carbonate	Satd.	A	A	-	
Sodium chlorate	Satd.	A	A	-	
Sodium chloride	Satd.	A	A	A	
Sodium chlorite	2	A	A (80°C)	-	
Sodium chlorite	5	A (80°C)	A	-	
Sodium chlorite	10	A (80°C)	A	-	
Sodium chlorite	20	A (80°C)	A	-	
Sodium cyanide	Satd.	A	A	-	
Sodium dichromate	Satd.	A	A	-	
Sodium ferricyanide	Satd.	A	A	-	
Sodium ferrocyanide	Satd.	A	A	-	
Sodium fluoride	Satd.	A	A	-	
Sodium hydroxide	50	A	A	-	
Sodium hydroxide	10	A	A	A	
Sodium hypochlorite	20	A	B	B	
Sodium nitrate		A	A	-	
Sodium nitrite		A	A	-	
Sodium silicate		A	A	-	
Sodium sulfate	Satd.	A	A	-	
Sodium sulfide	25	A	A	-	
Sodium sulfite	Satd.	A	A	-	
Stannic chloride	Satd.	A	A	-	
Stannous chloride	Satd.	A	A	-	
Starch		A	A	-	
Sugars and syrups		A	A	-	
Sulfamic acid		A (80°C)	A	-	
Sulfates of Calcium and magnesium		A	A	-	
Sulfates of potassium and sodium	Satd.	A	A	-	
Sulfur		A	A	-	
Sulfuric acid	98(a)	C	-	D	
Sulfuric acid	60	A	B (80°C)	-	
Sulfuric acid	50	A	B	-	
Sulfuric acid	10	A	A	A	
50-50 H <sub>2</sub> SO <sub>4</sub> /HNO <sub>3</sub>	(a)	C	D (80°C)	-	
Tallow		A	A	-	
Tannic acid	10	A	A	-	
Tartaric acid		A	A	-	
Tetrahydrofuran	100	C	C	C	
Tetralin	100	C	C	C	
Toluene	100	C	C	-	
Transformer oil	100	A	C	-	
Trichloroacetic acid	10	A	A	-	
Trichloroethylene	100	A (80°C)	A	-	
Turpentine	100	C	C	C	

(a) May produce cracking in material under stress



Environment	Conc. %	Temp.		
		20°C	60°C	100°C
Urea		A	A	-
Urine		A	A	-
Water (distilled, soft, hard and vapor)		A	A	A
Wet chlorine gas		-	D (70°C)	-
Whiskey		A	A	A
White Paraffin	100	A	B (80°C)	-
White spirit	100	B	C	-
Wines		A	A	-
Xylene	100	C	C	C
Yeast		A	A	-
Zinc chloride	Satd.	A	A	-
Zinc oxide		A	A	-
Zinc sulfate	Satd.	A	A	-

## 4.11.1 CHEMICAL COMPATIBILITY OF PLASTICS AND METALS

### For all non-metals

R = Resistant  
 A = Excellent – no effect  
 B = Good – minor effect  
 C = Fair – moderate effect  
 U = Unsatisfactory  
 X = Conflicting data  
 - = No data available

\* No corrosion rate reported

### For metals

E <2 mil Penetration/Year  
 G <20 mil Penetration/Year  
 S <50 mil Penetration/Year  
 U >50 mil Penetration/Year (1 mil = .001 inch)  
 A = Excellent – no effect \*  
 B = Good – minor effect \*  
 C = Fair – moderate effect \*

	Plastics										Elastomer					Metals													
	ABS	Acetal (Delrin)	CPVC	FEP	Nylon 6, 66	HDPE	Polypropylene	PTFE (Teflon®)	PVC Type I	PVC Type II	PVDF (Kynar)	EPDM	Kel-F	Neoprene	Nitrile Buna-N	Polyurethane	Silicone	Tygon®	Viton-A	Ceramic	Silica	304 Stainless	316 Stainless	Carbon Steel	Hastelloy-C	Aluminum	Brass	Copper	
Acetaldehyde	U	A	U	R	U	U	A	A	U	U	X	A	A	C	U	U	A	U	U	-	R	E	E	G	E	G	U	U	
Acetamide	-	A	-	R	R	R	A	A	U	-	C	A	A	B	A	U	B	U	B	-	-	G	G	-	-	G	-	-	
Acetate Solvent	U	-	U	R	R	R	B	A	U	U	A	A	A	C	U	-	A	U	U	-	-	E	E	G	E	E	S	G	
Acetic Acid 10%	X	X	C	R	U	R	B	A	U	-	C	A	A	C	C	-	C	U	R	A	R	E	E	U	E	G	U	G	
Acetic Acid, Glacial	U	U	U	R	U	R	A	A	U	U	B	U	A	X	X	U	B	U	U	A	R	E	E	U	E	E	U	U	
Acetone	U	A	U	R	R	R	A	A	U	U	U	A	A	A	U	U	B	U	U	A	R	E	E	G	E	E	G	E	
Acetonitrile	U	-	-	R	R	-	R	R	-	-	R	R	-	-	-	-	-	-	-	-	-	G	G	G	-	E	G	G	
Acetophenone	U	-	-	R	R	U	R	R	U	U	R	R	-	U	U	-	-	U	-	-	G	G	G	G	G	G	G	G	
Acetyl Chloride	U	-	U	R	U	U	U	A	U	U	R	R	U	-	U	U	U	-	-	R	-	G	G	G	-	U	U	U	
Acetylene	R	-	R	R	R	-	R	R	R	R	R	R	R	-	R	R	-	-	R	-	-	E	E	G	G	E	U	U	U
Acrylonitrile	U	-	X	R	R	R	A	A	X	U	A	X	-	C	U	-	U	-	U	-	-	G	G	G	G	E	G	G	
Adipic Acid	R	-	A	R	-	R	B	A	R	R	A	R	A	A	B	X	-	U	-	X	-	-	G	G	G	E	G	-	G
Aldrin (1 oz./gal.)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	E	E	G	-	E	-	-	
Allyl Alcohol	U	-	R	R	R	R	R	R	R	R	R	R	R	-	R	R	R	-	-	R	-	E	E	G	G	G	G	E	
Allyl Chloride	U	-	U	R	-	R	R	R	U	U	R	U	U	U	-	U	U	U	-	-	R	G	E	U	-	U	-	-	
Ammonium Acetate	-	-	A	R	A	-	A	A	R	R	R	R	R	A	-	A	B	-	-	A	-	-	G	G	-	-	G	U	U
Ammonium Oxalate 10%	-	-	-	R	-	-	R	R	R	R	-	-	-	R	-	-	-	-	-	-	-	G	G	U	E	E	-	U	
Amyl Acetate	U	B	U	R	R	R	X	A	U	U	A	A	A	A	U	U	U	U	U	A	R	E	E	G	E	E	E		
Amyl Alcohol	R	A	A	R	A	R	B	A	R	U	A	A	A	A	A	B	U	U	A	B	A	R	G	G	G	G	G	G	
Amyl Chloride	U	-	U	R	U	U	U	R	U	U	U	R	R	R	R	-	U	U	-	-	R	-	G	G	U	E	U	G	G
Aniline	U	A	X	R	X	R	X	A	U	U	A	A	A	X	A	U	U	U	C	B	A	R	E	E	G	G	G	U	U
Aniline Hydrochloride	U	-	U	R	U	U	X	A	X	A	A	A	B	-	U	U	-	U	U	A	-	R	U	U	U	U	U	U	G
Antifreeze	B	U	A	-	U	-	U	-	A	-	-	-	A	-	C	A	-	C	B	A	-	-	-	A	-	-	A	-	-
Aroclor 1248	-	-	-	R	A	U	U	A	-	-	-	-	B	A	U	X	-	B	-	A	-	-	G	G	G	E	E	E	
Asphalt	-	B	X	R	A	R	B	A	A	-	A	A	U	A	U	X	-	U	-	A	-	-	G	G	G	-	E	E	E
Benzaldehyde	X	A	U	R	A	U	X	A	U	U	A	A	A	A	U	U	U	U	U	U	A	R	G	G	U	G	G	G	G
Benzene	U	A	U	R	A	U	X	A	U	U	A	A	A	U	B	U	U	U	C	A	A	R	G	G	G	E	G	G	G
Benzo Sulfonic Acid 10%	R	-	R	R	U	R	R	R	R	R	R	R	R	U	-	R	U	U	-	R	-	R	G	G	U	G	-	-	
Benzyl Alcohol	U	A	X	R	B	U	A	A	U	U	A	A	A	B	A	X	X	U	-	U	A	A	R	E	E	G	G	G	E
Benzoic Acid	R	B	A	R	X	B	R	A	R	R	A	R	R	U	A	B	U	U	B	A	A	R	G	G	U	E	G	G	G
Benzol	U	A	U	R	X	U	U	A	U	U	A	A	A	U	A	U	U	U	C	A	A	R	G	G	G	E	G	G	G
Benzonitrile	-	-	-	R	R	A	-	A	-	-	-	-	A	-	-	A	-	-	A	-	-	U	U	-	C	-	-	-	
Benzyl Chloride	U	A	U	R	R	-	C	R	R	-	R	U	-	U	U	-	U	-	A	-	-	G	G	U	-	U	U	U	
Bromobenzene	-	-	-	R	-	-	U	R	-	-	R	U	U	U	U	U	U	-	-	R	-	-	-	-	-	-	-	-	-
Butadiene	U	A	A	R	R	U	U	A	R	U	A	X	A	X	A	B	X	U	U	-	B	-	-	G	G	G	G	G	G



	Plastics										Elastomer					Metals												
	ABS	Acetal (Delrin)	CPVC	FEP	Nylon 6, 66	HDPE	Polypropylene	PTFE (Teflon®)	PVC Type I	PVC Type II	PVDF (Kynar)	EPDM	Kel-F	Neoprene	Nitrile Buna-N	Polyurethane	Silicone	Tygon®	Viton-A	Ceramic	Silica	304 Stainless	316 Stainless	Carbon Steel	Hastelloy-C	Aluminum	Brass	Copper
Butane	B	A	C	R	R	U	U	A	R	R	A	U	A	A	A	R	U	C	A	-	-	G	G	E	G	G	G	G
Butyl Alcohol	U	A	A	R	B	B	R	A	R	U	A	A	A	A	X	-	B	B	A	-	R	E	E	G	G	E	G	G
n-Butyl Amine	-	X	U	R	R	U	U	A	U	U	X	-	U	U	R	-	B	U	U	-	-	-	G	G	G	G	-	-
Butyl Ether	-	U	U	R	A	-	-	A	R	-	A	U	A	U	B	-	U	A	U	-	-	E	E	-	E	-	-	
Butyl Phenol	U	-	U	R	-	-	U	R	U	U	R	-	-	U	-	-	-	-	U	-	-	G	E	-	G	G	-	
Butyl Phthalate	-	-	U	R	R	-	R	R	R	-	R	B	A	D	U	-	A	-	C	-	-	G	G	-	G	U	G	G
Butylacetate	U	A	X	R	A	R	X	A	U	U	B	B	A	X	U	-	U	U	U	-	R	G	G	G	G	E	G	G
Butyric Acid	U	A	U	R	U	U	R	R	U	U	A	B	A	U	U	-	U	U	B	-	R	G	G	U	E	G	G	G
Carbon Tetrachloride	U	B	U	R	X	U	U	R	U	U	R	U	A	U	U	U	U	B	A	A	R	E	E	G	E	U	G	E
Carbonic Acid	R	B	A	R	R	R	A	A	R	R	A	B	A	X	X	R	A	-	A	A	-	G	G	G	E	E	G	G
Chloroacetic Acid	U	U	U	R	U	U	C	A	R	R	A	B	A	U	U	U	U	A	U	-	U	U	U	E	U	U	U	
Chlorobenzene	U	X	U	R	R	U	U	B	U	U	A	U	A	U	U	-	U	A	A	A	R	G	G	G	E	G	G	
Chlorobromomethane	-	-	-	C	-	A	A	U	-	-	B	-	U	U	-	U	-	A	A	-	-	-	-	-	-	-	B	-
Chlordanne (1/4 lb./gal.)	U	-	-	-	-	-	R	-	-	-	U	-	C	B	-	U	-	A	-	-	G	G	G	-	-	-	-	
Chloroethane	U	A	U	R	R	R	X	A	U	U	A	X	A	U	U	-	U	-	B	-	-	G	G	G	-	-	-	G
Chloroform	U	A	U	R	R	U	X	A	U	U	A	U	B	U	U	U	U	B	A	A	R	E	E	U	G	G	G	
Chloronaphthalene	U	-	-	-	-	-	R	-	-	-	-	-	U	U	-	-	-	-	-	-	-	G	-	E	U	-	-	
Chlorophenol 5% (aq.)	-	R	U	R	U	-	-	R	U	U	R	-	-	-	-	-	-	-	-	-	G	G	S	E	-	-		
Citric Acid	U	B	B	R	R	A	A	A	R	-	A	A	A	A	A	-	A	-	A	A	R	E	E	U	E	E	-	
Cresol	U	U	U	R	U	U	U	R	X	U	R	U	A	U	U	U	U	U	X	-	R	E	G	G	G	G	-	
Cresylic Acid 50%	U	U	U	R	U	R	X	R	R	R	R	X	-	U	U	U	U	-	A	-	-	G	G	G	G	G	-	
Crude Oil	R	R	R	R	R	U	R	U	U	U	U	U	U	-	U	R	R	-	R	-	-	E	E	G	E	E	G	G
Cyclohexane	R	A	U	R	R	R	U	A	X	-	R	U	A	U	B	R	U	U	A	-	-	G	G	G	G	G	G	
Cyclohexanone	U	A	U	R	R	U	U	A	U	U	R	B	U	U	-	U	U	U	U	A	-	G	G	U	G	G	G	
DDT 5%	-	-	U	-	-	-	-	U	U	-	-	-	-	-	-	-	-	-	-	-	-	E	E	G	-	E	-	
Detergents (general)	B	A	A	R	R	R	A	A	R	R	A	A	B	A	-	A	A	A	A	A	-	E	G	G	E	G	G	E
Diacetone Alcohol	-	A	U	R	R	R	R	A	R	-	A	A	B	U	U	-	U	B	U	-	-	G	G	G	E	E	E	E
Dibutyl Phthalate	U	-	U	R	R	U	R	R	U	U	U	R	-	U	U	U	-	U	-	-	G	G	G	G	G	G	G	
Dichlorobenzene	U	-	U	R	X	U	C	A	U	U	A	U	-	U	U	-	U	-	C	-	-	G	-	E	G	-		
Dichloroethane	U	A	U	R	R	R	X	A	U	U	A	U	A	U	U	-	U	C	A	R	G	G	G	G	G	-		
Dichloroethylene	U	-	-	R	-	R	R	U	U	R	-	U	-	U	U	-	R	-	R	-	-	G	G	-	G	G	-	
Dichlorofluoromethane	-	-	-	R	-	-	R	U	U	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Diesel Fuel	-	A	A	R	R	R	A	A	R	-	A	U	A	B	A	-	U	-	A	-	-	E	E	G	G	E	E	
Diethanolamine	-	-	-	R	R	-	R	R	U	U	U	-	R	-	-	-	-	-	-	-	-	E	E	E	E	E	-	
Diethyl Amine	U	B	U	R	R	U	A	X	U	-	X	B	A	A	C	-	B	C	A	-	-	G	G	U	-	G	-	
Diethyl Ether	U	R	U	R	R	U	R	R	A	U	U	U	C	U	U	-	U	-	U	-	-	G	G	G	G	G	G	
Diethyl Phthalate	-	-	-	-	-	R	-	R	-	R	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Diethylene Glycol	B	A	A	R	R	R	A	A	X	-	A	A	A	A	-	B	C	A	-	-	E	E	E	G	G	-		
Dimethyl Aniline	U	U	U	R	R	-	X	A	U	U	A	B	A	U	U	-	U	U	U	-	-	B	B	-	B	A	-	
Dimethyl Ether	-	-	-	R	-	-	R	-	-	R	-	-	-	U	R	-	-	-	R	-	-	G	G	-	G	-	G	G
Dimethyl Formamide	U	X	U	R	R	R	A	X	U	U	U	X	A	X	U	-	C	U	X	-	-	G	U	-	E	-	-	
Dimethyl Phthalate	U	-	-	R	R	-	R	R	U	U	R	-	U	U	-	R	-	R	-	-	E	E	E	-	E	-		
Dimethyl Sulfoxide	-	R	U	R	R	R	R	R	U	-	U	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Dinitrotoluene	-	-	-	-	-	-	R	-	-	R	-	U	-	U	U	-	U	-	X	-	-	G	G	-	-	-	-	
Diocyl Phthalate	U	-	U	R	R	U	U	R	U	U	R	R	-	U	U	U	-	R	-	-	G	G	G	-	E	-		
Dioxane	U	R	-	R	R	U	R	R	U	-	U	U	-	U	U	-	U	-	U	-	-	G	G	G	G	G	G	
Diphenyl	-	-	-	R	R	-	U	A	U	-	-	U	-	B	U	R	U	-	A	-	-	G	G	G	G	G	G	
Diphenyl Oxide	-	U	-	-	-	-	U	A	U	-	B	U	-	U	A	-	C	U	A	-	B	A	-	B	B	-	A	
Esters (general)	-	-	U	R	R	-	-	R	U	U	R	-	-	-	-	-	-	-	-	-	-	G	-	-	-	-	-	

	Plastics										Elastomer					Metals												
	ABS	Acetal (Delrin)	CPVC	FEP	Nylon 6, 66	HDPE	Polypropylene	PTFE (Teflon®)	PVC Type I	PVC Type II	PVDF (Kynar)	EPDM	Kel-F	Neoprene	Nitrile Buna-N	Polyurethane	Silicone	Tygon®	Viton-A	Ceramic	Silica	304 Stainless	316 Stainless	Carbon Steel	Hastelloy-C	Aluminum	Brass	Copper
Ethane	-	A	A	-	U	-	U	A	A	-	A	U	-	B	A	-	U	A	A	-	-	A	A	-	-	-	-	A
Ethanolamine	-	U	U	R	R	-	X	A	U	-	X	B	U	B	B	-	B	-	U	A	-	E	E	G	G	G	-	-
Ethers (general)	U	A	U	-	R	U	U	A	U	U	R	C	B	U	X	-	U	C	X	-	R	E	E	G	G	G	G	G
Ethyl Acetate	U	A	U	R	R	R	A	A	U	U	X	B	A	U	U	U	B	U	U	A	R	G	G	G	G	-	G	G
Ethyl Alcohol	B	A	B	R	R	R	A	A	R	R	R	A	B	A	C	U	B	C	A	A	R	G	G	G	E	E	G	G
Ethyl Benzene	-	R	-	R	-	U	U	R	U	U	R	U	-	U	U	-	-	-	R	-	-	S	G	U	E	G	-	-
Ethyl Benzoate	U	-	U	-	-	U	B	A	U	-	U	-	-	U	U	-	U	U	A	-	-	-	-	-	-	-	-	-
Ethyl Chloride	U	R	U	R	R	U	U	R	U	U	R	R	-	U	R	U	-	-	B	-	R	E	E	G	G	-	-	G
Ethyl Ether	U	A	U	R	R	U	U	A	U	U	R	U	A	U	X	U	U	-	U	-	R	G	G	G	G	G	G	G
Ethyl Sulfate	-	-	-	-	-	-	A	-	-	-	-	-	A	-	A	-	-	A	-	-	U	U	-	-	-	-	B	
Ethylene Bromide	U	-	U	R	R	U	U	A	U	U	A	X	B	X	U	-	U	U	A	-	-	E	E	-	E	-	-	-
Ethylene Chloride	U	A	U	R	R	R	X	A	U	U	A	X	A	U	U	-	U	-	B	-	-	G	G	G	-	-	G	
Ethylene Chlorohydrin	U	U	U	R	U	U	X	A	U	U	A	B	-	X	U	U	C	U	A	-	-	G	G	G	G	G	G	
Ethylene Diamine	U	X	U	R	U	-	R	A	U	U	B	A	U	X	A	-	A	-	B	-	-	G	G	G	U	U	U	
Ethylene Dibromide	-	-	-	R	-	-	R	R	-	-	R	-	-	-	-	-	-	-	-	-	-	-	G	-	G	-	G	
Ethylene Glycol	A	B	A	R	R	R	A	A	R	R	A	A	A	A	A	R	A	B	R	A	-	G	G	G	E	E	G	G
Ethylene Oxide	U	U	X	R	R	R	U	A	U	U	A	X	C	U	U	U	U	-	U	-	R	G	G	G	E	E	U	-
Formaldehyde 100%	B	A	A	-	U	-	C	A	A	-	A	A	A	C	C	-	B	B	U	-	-	C	A	-	A	A	-	A
Formaldehyde 37%	A	A	A	R	R	R	A	A	R	R	A	A	A	B	X	U	-	-	R	-	R	E	E	U	G	G	E	G
Formic Acid 5%	-	U	R	R	U	R	R	R	R	-	R	R	-	R	R	U	-	-	R	-	-	G	E	-	E	U	S	E
Fuel Oils	U	A	-	R	R	R	A	B	R	R	B	U	A	B	X	R	U	A	A	-	-	G	G	G	G	G	G	G
Gasoline (high-aromatic)	U	B	A	-	-	-	A	B	A	-	A	U	A	A	A	A	A	-	A	A	-	A	A	-	A	U	-	-
Gasoline (leaded)	U	A	U	R	R	U	X	A	R	-	A	U	A	B	A	R	U	C	A	A	-	G	G	G	E	G	G	G
Gasoline (unleaded)	U	A	X	R	R	U	X	A	R	-	A	U	A	B	A	R	U	C	A	-	-	G	G	G	E	G	G	G
Glycolic Acid	B	A	A	R	-	R	A	A	R	R	B	A	B	A	A	-	A	A	A	-	-	G	G	U	G	G	-	-
Heptane	X	A	A	R	R	R	R	C	A	R	A	U	A	B	A	U	U	B	A	-	-	G	G	G	E	G	G	G
Hexachloroethane	-	-	-	-	-	-	R	-	-	-	-	-	-	-	-	-	-	-	-	-	-	G	G	-	G	G	S	G
Hexamine	-	-	-	R	-	-	R	-	-	-	-	-	-	-	-	-	-	-	-	-	-	E	E	-	E	E	G	-
Hexane	U	A	B	R	R	U	B	A	R	R	A	U	A	B	A	R	U	U	A	-	-	E	E	G	E	G	G	-
Hexyl Alcohol	-	A	-	A	-	-	A	A	A	-	-	C	-	A	A	-	B	A	C	-	-	A	A	-	A	A	-	-
Hydraulic Oil (petro.)	-	B	-	-	A	-	U	A	A	-	A	U	-	A	-	A	A	-	B	A	-	A	A	-	A	A	A	A
Hydraulic Oil (synthetic)	-	-	-	-	A	-	U	A	A	-	A	A	-	A	A	U	-	B	A	A	-	A	A	-	A	A	A	A
Hydrazine	-	B	U	-	-	U	C	C	-	-	A	A	-	B	B	-	B	-	A	-	-	A	A	-	-	-	-	A
Hydrogen Peroxide (dilute)	R	R	U	R	R	R	R	R	R	R	R	R	R	-	U	R	-	-	R	-	-	G	G	U	E	E	U	U
Hydroquinone	X	A	A	R	U	-	A	A	R	R	R	U	-	A	X	-	-	B	-	-	G	G	G	G	G	G	-	
Hydroxyacetic Acid 70%	-	A	A	-	-	-	A	U	-	A	A	A	A	-	A	A	A	-	A	-	-	-	-	-	-	-	-	-
Iodoform	-	-	R	-	-	R	C	-	-	C	A	-	A	U	-	-	C	R	-	R	E	E	U	U	G	-	G	
Isobutyl Alcohol	B	A	-	A	-	A	A	A	A	-	A	A	-	A	B	-	A	A	A	-	-	-	-	-	-	-	-	-
Isooctane	-	-	-	A	B	A	A	A	A	-	A	U	A	B	A	-	U	A	A	-	-	A	A	-	A	A	-	A
Isopropyl Acetate	U	U	U	R	R	R	B	A	U	U	X	B	-	U	U	-	U	-	U	-	-	E	G	E	G	G	-	-
Isopropyl Alcohol	R	A	C	R	U	R	A	A	R	R	R	A	-	B	B	U	A	A	A	A	-	G	G	G	G	G	G	G
Isopropyl Ether	-	U	R	R	R	-	X	A	R	R	X	U	A	U	B	R	U	A	U	-	-	E	G	-	-	-	G	G
Isotane	-	-	-	U	-	U	-	A	-	A	-	-	U	A	-	-	-	-	A	-	-	-	-	-	U	-	-	U
Jet Fuel JP-4, JP-5	-	A	R	R	R	-	A	A	R	R	A	U	A	U	A	U	U	A	A	-	-	G	G	G	E	E	-	-
Kerosene	X	A	R	R	R	R	R	A	R	R	A	U	A	U	A	U	U	U	A	A	-	G	G	G	G	G	G	G
Lacquer Thinners	A	U	-	-	A	-	U	A	U	-	-	U	-	U	U	-	U	U	U	-	-	-	G	-	-	G	-	-
Lacquers	A	U	-	-	A	-	U	A	U	-	-	U	-	U	U	-	U	U	U	-	-	E	E	-	-	-	-	-
Lactic Acid	U	B	A	R	R	-	B	A	R	R	B	A	A	A	X	-	A	A	A	A	-	G	G	U	G	G	G	G
Lead Acetate	B	B	A	R	R	R	A	A	R	R	A	A	A	B	-	A	B	U	A	A	-	G	G	U	G	U	U	G



	Plastics										Elastomer					Metals												
	ABS	Acetal (Delrin)	CPVC	FEP	Nylon 6, 66	HDPE	Polypropylene	PTFE (Teflon®)	PVC Type I	PVC Type II	PVDF (Kynar)	EPDM	Kel-F	Neoprene	Nitrile Buna-N	Polyurethane	Silicone	Tygon®	Viton-A	Ceramic	Silica	304 Stainless	316 Stainless	Carbon Steel	Hastelloy-C	Aluminum	Brass	Copper
Linoleic Acid	A	B	A	R	U	U	B	A	R	R	A	U	-	U	B	-	B	A	B	-	-	G	G	U	G	G	U	U
Maleic Acid	R	A	A	R	X	R	R	A	R	R	A	X	-	U	U	-	-	C	A	-	R	G	G	U	G	-	G	-
Malic Acid	R	A	R	R	X	R	A	A	R	R	A	U	-	X	A	-	B	A	A	-	-	E	E	U	G	G	-	U
Melamine	-	A	A	-	A	-	A	A	U	-	-	A	-	U	C	-	C	U	A	-	-	-	U	-	-	-	-	-
Methane	-	A	-	R	R	-	A	A	R	R	A	X	-	B	A	-	U	-	A	-	-	E	E	G	E	E	E	G
Methyl Acetate	U	X	U	R	R	R	X	A	U	U	B	X	A	X	U	-	U	A	U	-	-	G	G	S	E	G	-	-
Methyl Acetone	-	U	-	-	A	-	-	A	U	-	U	A	-	U	U	-	-	A	U	-	-	A	A	-	-	A	A	-
Methyl Acylate	-	B	-	-	-	-	U	-	-	B	B	B	-	B	U	-	U	-	U	-	-	A	-	-	-	-	-	-
Methyl Alcohol	U	A	A	R	R	R	A	A	R	R	A	A	A	A	A	U	A	A	U	A	R	G	G	G	E	G	G	G
Methyl Alcohol 10%	U	A	A	-	B	B	A	A	-	A	A	A	A	A	A	-	A	A	A	A	-	-	-	-	-	-	-	-
Methyl Amide	U	U	-	-	-	-	A	A	U	-	C	A	A	-	B	-	-	U	U	-	-	A	A	-	-	A	U*	-
Methyl Bromide	U	U	U	R	U	R	X	A	U	U	A	U	-	U	B	-	-	A	-	-	-	G	G	G	-	U	-	-
Methyl Butyl Ketone	-	U	-	-	U	U	U	-	-	U	A	-	U	U	-	U	-	U	-	-	A	A	-	-	-	-	-	
Methyl Chloride	U	B	U	R	R	U	U	A	U	U	A	U	A	U	U	U	U	U	A	-	-	E	E	U	G	U	E	G
Methyl Chloroform	U	-	U	R	-	-	U	R	U	U	R	U	U	U	U	U	U	U	R	-	-	-	-	-	-	-	-	-
Methyl Dichloride	-	U	-	-	C	-	U	-	-	U	U	U	-	-	U	-	-	A	-	-	-	-	-	-	-	-	-	-
Methyl Ethyl Ketone	U	U	U	R	R	U	B	A	U	U	U	A	A	U	U	U	U	U	A	-	-	G	G	G	G	G	G	G
Methyl Isopropyl Ketone	-	-	-	-	A	-	-	A	U	-	-	C	-	U	U	-	C	-	U	-	-	A	A	-	A	-	A	A
Methyl Methacrylate	-	U	R	R	-	-	X	R	R	U	B	U	-	U	U	-	C	-	U	-	-	G	G	U	-	G	-	-
Methyl Pentanone	U	-	U	R	R	R	R	A	U	U	X	B	A	U	U	-	U	U	-	-	G	G	G	G	G	G	G	G
Methylene Chloride	U	B	U	R	U	U	B	A	U	U	B	X	A	U	U	U	-	U	B	-	R	G	G	G	E	E	G	G
Monochloroacetic Acid	-	U	-	-	U	U	-	A	-	B	C	B	A	U	-	-	C	-	U	-	-	A	A	-	A	U*	B	U*
Monoethanolamine	-	U	-	R	R	-	B	A	U	U	B	B	-	X	B	-	B	-	X	-	-	E	E	G	G	G	G	G
Motor Oil	C	B	A	R	R	U	U	A	R	R	B	U	A	B	A	-	-	A	R	A	-	G	G	G	-	-	G	G
Naphthalene	U	X	U	R	R	U	R	A	U	U	A	U	A	U	U	R	U	C	A	A	-	E	E	G	G	G	G	G
Nitrobenzene	U	X	U	R	R	U	B	A	U	U	A	U	A	U	U	U	U	U	B	-	R	G	G	G	G	E	G	G
Nitromethane	U	A	U	R	U	-	R	A	R	R	A	B	A	U	U	-	U	B	U	-	-	G	G	G	-	G	-	-
Nitrophenol	-	-	-	-	-	-	R	-	-	-	-	-	-	-	-	-	-	-	-	-	-	G	G	-	-	G	-	G
Octane	-	-	-	R	-	R	R	R	U	U	R	U	R	R	R	-	R	-	R	-	-	G	G	-	G	G	G	G
Octyl Alcohol	A	A	B	-	A	-	-	-	-	-	B	-	B	B	-	B	-	B	-	-	A	A	-	C	A	-	A	
Oleic Acid	X	A	A	R	R	U	B	A	R	R	A	B	B	X	B	R	U	C	B	A	-	E	E	G	G	S	G	G
Oxalic Acid 5%	R	U	R	R	U	R	R	R	R	R	R	R	-	R	U	-	-	R	-	-	U	G	U	G	G	S	G	G
Palmitic Acid 10%	A	A	A	R	R	R	B	A	R	R	A	B	-	U	A	R	U	B	A	-	-	G	-	-	G	G	G	G
Pentachlorophenol	-	-	-	-	-	-	R	-	-	-	-	-	-	-	-	-	-	-	R	-	-	E	-	-	-	-	-	-
Pentane	-	B	-	-	A	-	U	A	A	-	A	U	-	B	A	-	U	A	A	-	-	C	C	-	A	B	-	-
Petroleum	B	B	A	R	-	U	B	A	R	-	A	U	-	B	A	-	U	-	A	-	-	G	G	-	G	G	G	G
Phenol 10%	U	X	A	R	U	R	B	A	U	U	A	B	B	U	U	U	C	A	A	-	G	G	G	G	E	G	G	G
Phthalic Acid	B	C	X	R	R	-	A	A	U	U	A	A	-	A	U	-	B	-	A	-	-	G	E	S	G	G	G	G
Phthalic Anhydride	B	C	U	R	-	-	U	A	U	-	A	A	-	A	U	-	-	B	A	-	-	E	E	G	E	E	G	-
Picric Acid	X	A	U	R	U	U	A	A	U	U	A	A	-	A	X	-	B	-	A	-	R	G	G	U	G	E	U	U
Propyl Alcohol	X	A	A	R	U	R	A	A	R	R	A	A	A	A	A	-	A	A	A	A	-	E	E	G	E	G	G	G
Propylene	B	-	-	-	-	-	A	B	-	-	U	-	U	U	-	U	B	A	-	-	B	A	-	-	A	-	A	
Propylene Glycol	B	B	X	R	R	R	A	A	U	U	A	A	-	C	A	-	A	-	A	A	-	G	G	G	G	G	G	G
Propylene Oxide	-	-	-	R	-	R	R	R	U	U	U	R	-	U	U	-	-	U	-	-	E	E	-	-	-	-	-	-
Pyridine	-	B	U	R	R	R	A	A	U	U	U	X	A	U	U	-	U	U	U	A	-	G	G	G	E	G	G	G
Sodium Acetate	B	B	A	R	R	R	A	A	R	R	A	A	A	B	B	-	U	-	U	A	-	G	G	U	G	E	G	G
Sodium Benzoate	A	-	A	R	R	R	A	A	R	R	A	A	-	A	B	-	-	B	A	-	-	-	-	G	G	-	E	
Sodium Hypochlorite 20%	R	U	R	R	U	R	R	R	R	R	R	R	R	A	U	U	-	B	C	A	-	U	U	U	U	G	G	S
Stearic Acid	U	A	B	R	R	R	A	A	R	R	A	X	-	B	B	R	B	B	A	-	R	G	E	S	E	G	S	G

	Plastics										Elastomer				Metals													
	ABS	Acetal (Delrin)	CPVC	FEP	Nylon 6, 66	HDPE	Polypropylene	PTFE (Teflon®)	PVC Type I	PVC Type II	PVDF (Kynar)	EPDM	Kel-F	Neoprene	Nitrile Buna-N	Polyurethane	Silicone	Tygon®	Viton-A	Ceramic	Silica	304 Stainless	316 Stainless	Carbon Steel	Hastelloy-C	Aluminum	Brass	Copper
<b>Styrene</b>	-	A	U	-	A	U	-	A	U	-	-	U	-	U	U	-	U	-	B	-	-	A	A	-	U*	A	A	B
<b>Tartaric Acid</b>	-	B	A	-	B	-	A	A	A	-	B	B	A	A	A	-	A	B	A	A	-	C	C	-	B	B	U*	A
<b>Tetrachloroacetic Acid</b>	R	-	R	R	R	R	R	R	R	R	R	U	-	R	R	-	-	R	-	-	E	E	-	G	G	S	U	
<b>Tetrachloroethane</b>	-	A	X	R	R	-	C	A	U	U	A	U	A	U	U	-	U	-	A	-	R	E	E	E	E	G	-	S
<b>Tetrachloroethylene</b>	U	A	U	R	R	U	U	A	U	U	R	U	A	U	U	-	U	-	A	-	-	E	E	G	G	G	G	G
<b>Tetrachlorophenol</b>	-	-	-	-	-	R	R	-	-	R	R	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<b>Tetraethyl Lead</b>	U	-	R	R	-	U	R	R	R	R	R	U	-	U	-	-	-	R	-	-	G	G	G	-	G	G	-	
<b>Tetrahydrofuran</b>	U	A	U	R	R	U	C	A	U	U	B	U	A	U	U	-	U	-	X	A	-	E	G	E	E	U	-	-
<b>Toluene</b>	U	X	U	R	R	U	C	A	U	U	A	U	B	U	X	U	U	U	C	A	-	E	E	E	E	E	E	E
<b>Toxaphene-Xylene 10-90%</b>	-	-	U	R	-	-	R	R	U	-	-	-	-	-	-	-	-	-	-	-	G	G	S	-	S	-	-	
<b>Trichloroacetic Acid</b>	-	-	R	R	U	R	A	A	R	-	B	B	A	U	R	-	U	C	C	A	-	U	U	U	G	U	G	G
<b>Trichlorobenzene</b>	-	-	-	-	-	-	R	U	-	-	-	-	U	U	U	-	U	-	R	-	-	-	E	-	-	-	-	
<b>Trichloroethane</b>	-	A	-	-	-	C	A	C	-	A	-	U	A	U	U	-	U	-	A	-	-	-	-	-	-	-	-	
<b>Trichloroethylene</b>	U	U	U	R	R	U	C	A	U	U	B	U	A	U	U	U	U	-	X	A	-	G	G	E	E	G	G	
<b>Trichlorofluoromethane</b>	-	-	-	-	-	-	U	-	-	-	-	-	U	U	-	-	-	-	-	-	-	G	-	-	G	-	-	
<b>Trichloropropane</b>	U	A	-	-	-	-	A	-	-	-	-	-	A	A	U	-	-	U	A	-	-	A	A	-	A	U*	-	A
<b>Triethanolamine</b>	R	U	R	R	R	U	R	R	U	U	R	R	R	-	R	U	U	-	R	-	-	G	G	G	G	U	E	
<b>Triethylamine</b>	U	U	A	R	R	-	U	A	R	R	A	A	A	A	C	-	-	A	X	B	-	G	G	-	-	-	-	
<b>Trimethylpropane</b>	U	-	R	R	-	-	U	R	R	R	R	-	-	-	R	R	-	-	-	-	-	-	-	-	-	-	-	
<b>Turpentine</b>	U	A	A	R	R	U	X	A	X	U	A	U	A	U	R	U	U	B	A	A	-	E	E	G	G	S	G	
<b>Vinyl Acetate</b>	U	-	U	R	-	U	B	A	U	U	A	B	-	X	X	-	U	U	A	B	-	E	E	G	E	E	G	
<b>Vinyl Chloride</b>	U	-	U	-	A	-	-	A	U	-	B	C	-	U	U	-	-	U	A	A	-	B	A	-	A	B	-	B
<b>White Liquor (pulp mill)</b>	X	U	R	R	R	-	R	R	R	R	R	R	-	R	-	R	R	-	R	-	-	G	G	S	G	G	-	
<b>White Water (paper mill)</b>	R	B	-	-	R	-	R	-	R	-	-	-	-	A	-	-	-	A	-	-	A	A	-	-	-	-	-	
<b>Xylene</b>	U	A	U	R	R	U	B	A	U	U	A	U	A	U	U	U	U	U	X	A	-	G	G	E	G	G	G	

This table should only be used as a guide since it is difficult to duplicate operating conditions. To fully guarantee the suitability of a particular material, chemical resistance tests should be conducted under actual operating conditions.

No data was found on the following environmentally important chemicals:

Acenaphthene*	Chloromethylene	Fluoranthene*
Acenaphthalene*	Chlorophenylphenylether	Fluorene*
Acrolein	Chrysene*	Heptachlor**
Anthracene*	DDD**	Hexachlorobenzene
Benzidine	DDE**	Hexachlorobutadiene
Benzo(a)anthracene*	Dichlorobenzidine	Hexachlorocyclohexane
Benzo(b)fluoranthene*	Dichlorobromomethane	Indeno(1,2,3-c,d)pyrene*
Benzo(g,h,i)perylene*	Dichlorophenol	Isophorone
Benzo(a)pyrene*	Dichlorophenoxyacetic Acid	2-Methylnaphthalene
Bromophenylphenylether	Dichloropropane	Parachlorometa Cresol
Butylbenzylphthalate	Dichloropropylene	Phenanthrene*
Chlorodibromomethane	Dieldrin**	Phenylenepyrene
Chloroethoxymethane	Dinitrophenol	Pyrene*
Chloroethyllether	Diphenylhydrazine	Trichlorophenol
Chloroethylvinylether	Endosulfan	Trichlorophenoxyacetic Acid
Chloroisopropylether	Endrin**	

\* Component of cresote and coal tar. At room temperature and below, these compounds are solid in pure form.

\*\* Pesticides

# **PPR**

# **PIPING**

# **SYSTEM**



5

**NIRON®**  
BLUE PPR PIPE

SISTEMA  
**NIRON® FG**

**NIRON® Fiber**

**NIRON® Clima**

Polysystem  
**NIRON®**  
GREEN PPR PIPE

Polysystem  
**NIRON® FG**

**NIRON®**  
PURPLE PPR PIPE

**NIRON®**  
PREISOLATO

**NIRON®**  
WHITE BLUE PPR PIPE

**NIRON®**  
DARK PPR PIPE

**NIRON®**  
PLATINUM PPR PIPE

PRODUCT CATALOGUE

# KEY

**Code:** Nupigeco item code

**Ø:** External diameter

**Pack:** Minimum quantity per pack  
(packaging can change without any notice due to company needs)

**Q.ty /pallet:** Quantity per pallet

**Weight Kg/p - Kg/m:** Item weight - Kg

**Volume m<sup>3</sup>/p:** Item volume

 Suitable for water

 Suitable for sewage



N.B.: All dimensions have to be considered in millimeters with 5% tolerance if not otherwise mentioned.

CHARACTERISTICS	RANGE NAME	PIPE STRUCTURE	PRODUCT IDENTIFICATION COLOUR	DESCRIPTION	SDR	S	OD RANGE
PLUMBING & HYDRONIC INSTALLATIONS	NIRON	FULL	BLUE	PPR PIPE	6	2,5	16 and 40 ÷ 125
	NIRON	FULL	BLUE	PPR PIPE	7,4	3,2	25 ÷ 250
	NIRON	FULL	BLUE	PPR PIPE	11	5	32 ÷ 630
	NIRON	FULL	BLUE	PP-RP PIPE	9	4	32 ÷ 400
	NIRON	FG	BLUE	PPR FIBER GLASS PIPE	7,4	3,2	20 ÷ 400
	NIRON	FIBER	BLUE	PP-RP FIBER GLASS PIPE	9	4	32 ÷ 400
	NIRON	CLIMA 11	BLUE	PPR FIBER GLASS PIPE	11	5	32 ÷ 400
	NIRON	FIBER	BLUE	PP-RP FIBER GLASS PIPE	17	8	160 ÷ 400
PLUMBING & HYDRONIC INSTALLATIONS	NIRON POLYSYSTEM	FULL	GREEN	PPR PIPE	6	2,5	16 ÷ 125
	NIRON POLYSYSTEM	FULL	GREEN	PPR PIPE	7,4	3,2	25 ÷ 250
	NIRON POLYSYSTEM	FG	GREEN	PPR FIBER GLASS PIPE	7,4	3,2	20 ÷ 400
RAIN WATER	NIRON	FULL	PURPLE	PPR PIPE	7,4	3,2	20 ÷ 25
	NIRON	FULL	PURPLE	PPR PIPE	11	5	32 ÷ 160
PRE-INSULATION (*)	NIRON	FG	CARBON BLACK	PREINSULATED PPR FIBER GLASS PIPE	7,4	3,2	32 ÷ 315
	NIRON	CLIMA	CARBON BLACK	PREINSULATED PPR FIBER GLASS PIPE	11	5	32 ÷ 315
	NIRON	OB - FG	CARBON BLACK	PREINSULATED OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
OXYGEN BARRIER (*)	NIRON	OB - FG	WHITE BLUE	OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
	NIRON	OB - CLIMA	WHITE BLUE	OXYGEN BARRIER PPR PIPE	11	5	32, 40, 50, 63, 90, 110
	NIRON	OB - FULL	WHITE BLUE	OXYGEN BARRIER PPR PIPE	7,4	3,2	32, 40, 50, 63, 90, 110
UV RAY PROTECTION (*)	NIRON	FG	DARK	PPR FIBER GLASS PIPE UV RAY BARRIER	7,4	3,2	20 ÷ 400
	NIRON	FIBER	DARK	PP-RP FIBER GLASS PIPE UV RAY BARRIER	9	4	32 ÷ 400
	NIRON	CLIMA 11	DARK	PPR FIBER GLASS PIPE UV RAY BARRIER	11	5	32 ÷ 400
	NIRON	FIBER	DARK	PP-RP FIBER GLASS PIPE UV RAY BARRIER	17	8	160 ÷ 400
CHEMICAL RESISTANCE (*)	NIRON	MULTILAYER	BLUE	PPR PIPE FOR POTABLE WATER CHEMICAL BARRIER	7,4	3,2	32 ÷ 110
RESISTANCE (*)	NIRON	MULTILAYER	BLUE	PPR PIPE FOR NON-POTABLE WATER CHEMICAL BARRIER	7,4	3,2	32 ÷ 110

	HVACR							
Drinking water		Swimming pools	Chemical fluids	Recycled water	Compressed air	Heating	Geothermal applications	Ship building industry


(\*) upon request - key on page 12

Available in stock until diameter 250mm. Delivery timing for bigger diameters to be agreed when ordering.



## 5.1 POLYPROPYLENE PIPES

### 5.1.1 NIRON PIPE FOR PLUMBING & HYDRONIC APPLICATIONS

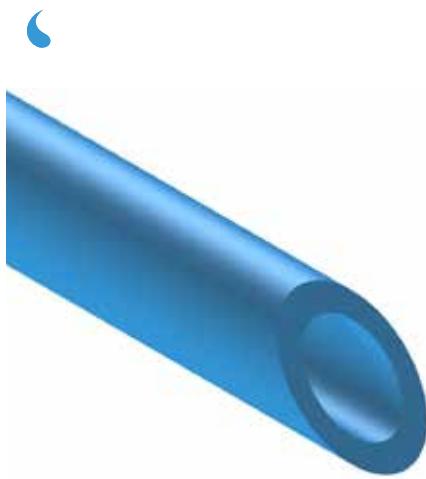

#### NIRON FULL BLUE PPR PIPE

Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **SDR 6 - S 2,5**

Colour: **Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F 2389 - UNI EN ISO 15494 - ISO 4065**

Range: **ø16 and from ø40 to ø125mm**

Packaging: **Bar length 4m**

Operating conditions: **25 bar/20°C**

Applications:



**FIG.11A**

#### SDR 6 • S 2,5

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRR16	16	100	4.600	0,11	0,09	16	2,7	10,60
03TNIRR40	40	40	800	0,66	0,56	40	6,7	26,60
03TNIRR50	50	20	560	1,03	0,87	50	8,4	33,20
03TNIRR63	63	16	352	1,62	1,38	63	10,5	42,00
03TNIRR75	75	12	240	2,29	1,96	75	12,5	50,00
03TNIRR90	90	8	160	3,30	2,83	90	15,0	60,00
03TNIRR110	110	8	112	4,92	4,21	110	18,4	73,20
03TNIRR125	125	4	80	6,30	5,46	125	20,8	83,40

#### NIRON FULL BLUE PP-RP PIPE

Pipe series: **SDR 7,4 - S 3,2**

Range: **From ø20 to ø32mm**

Operating conditions: **25 bar/20°C**

#### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRR20*	20	100	3.000	0,15	0,16	20	2,8	14,40
03TNIRR25*	25	100	2.000	0,23	0,25	25	3,5	18,00
03TNIRR32*	32	60	1.320	0,37	0,42	32	4,4	23,20



## NIRON FULL BLUE PPR PIPE



Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F 2389 - UNI EN ISO 15494 - ISO 4065**

Range: **From ø25 to ø250mm**

Packaging: **Bar length 4m**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 11B**

### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRR2516	<b>25</b>	100	2.000	0,23	0,25	25	3,5	18,00
03TNIRR3216	<b>32</b>	60	1.320	0,37	0,42	32	4,4	23,20
03TNIRR4016	<b>40</b>	40	800	0,57	0,66	40	5,5	29,00
03TNIRR5016	<b>50</b>	20	560	0,88	1,03	50	6,9	36,20
03TNIRR6316	<b>63</b>	16	352	1,39	1,63	63	8,7	45,60
03TNIRR7516	<b>75</b>	12	240	1,98	2,31	75	10,4	54,20
03TNIRR9016	<b>90</b>	8	160	2,83	3,32	90	12,5	65,00
03TNIRR11016	<b>110</b>	8	112	4,25	4,97	110	15,2	79,60
03TNIRR12516	<b>125</b>	4	80	5,41	6,47	125	17,1	90,80
03TNIRR16016	<b>160</b>	4	48	8,79	10,60	160	21,9	116,20
03TNIRR20016	<b>200</b>	4	48	13,70	16,55	200	27,4	145,20
03TNIRR25016	<b>250</b>	4	48	21,25	25,89	250	34,2	181,60



## NIRON FULL BLUE PPR PIPE

Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **SDR 11 - S5**

Colour: **Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F 2389 - UNI EN ISO 15494 - ISO 4065**

Range: **From ø32 to ø630mm**

Packaging: **Bar length 4m**

Operating conditions: **12 bar/20°C**

Applications:



**FIG. 11C**

### SDR 11 • S 5

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRR3210	32	60	1.320	0,26	0,54	32	2,9	26,20
03TNIRR4010	40	40	800	0,40	0,83	40	3,7	32,60
03TNIRR5010	50	20	560	0,63	1,31	50	4,6	40,80
03TNIRR6310	63	16	352	0,99	2,07	63	5,8	51,40
03TNIRR7510	75	12	240	1,37	2,96	75	6,8	61,40
03TNIRR9010	90	8	160	1,99	4,25	90	8,2	73,60
03TNIRR11010	110	8	112	2,96	6,36	110	10,0	90,00
03TNIRR12510	125	4	80	3,84	8,20	125	11,4	102,20
03TNIRR16010	160	4	48	6,22	13,43	160	14,6	130,80
03TNIRR20010	200	4	32	9,76	21,01	200	18,2	163,60
03TNIRR25010	250	4	32	15,00	32,86	250	22,7	204,60
03TNIRR31510	315	4	32	23,70	52,17	315	28,6	257,80
03TNIRR35510	355	4	32	30,00	66,29	355	32,2	290,60
03TNIRR40010 <sup>(2)</sup>	400	4	32	38,20	84,14	400	36,3	327,40
03TNIRR45010 <sup>(1)(2)</sup>	450	4	32	48,10	106,42	450	40,9	368,20
03TNIRR50010 <sup>(1)(2)(3)</sup>	500	4	32	59,10	131,44	500	45,4	409,20
03TNIRR56010 <sup>(1)(2)(3)</sup>	560	4	32	74,00	164,95	560	50,8	458,40
03TNIRR63010 <sup>(1)(2)(3)</sup>	630	4	32	93,50	208,69	630	57,2	515,60

<sup>(1)</sup> Diameter not included in the standard UNI EN ISO 15874 + Amendment • <sup>(2)</sup> Not present in the standard ASTM F2389 • <sup>(3)</sup> Not present in the standard DIN 8077-8078



## NIRON FULL BLUE PP-RP PIPE



Pipe structure: ***Monolayer pipe***

Material: ***PP-RP***

Pipe series: ***SDR 9 - S 4***

Colour: ***Blue***


Standards: ***UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F 2389 - ISO 4065***

Range: ***From ø32 to ø400mm***

Packaging: ***Bar length 4m***

Operating conditions: ***20 bar/20°C***

Applications:



**FIG. 11D**


### SDR 9 • S 4

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRR329* <sup>(2)</sup>	32	60	1.320	0,31	0,48	32	3,6	24,80
03TNIRR409* <sup>(2)</sup>	40	40	800	0,48	0,75	40	4,5	31,00
03TNIRR509* <sup>(2)</sup>	50	20	560	0,74	1,18	50	5,6	38,80
03TNIRR639* <sup>(2)</sup>	63	16	352	1,17	1,87	63	7,1	48,80
03TNIRR759* <sup>(2)</sup>	75	12	240	1,65	2,66	75	8,4	58,20
03TNIRR909* <sup>(2)</sup>	90	8	160	2,38	3,82	90	10,1	69,80
03TNIRR1109* <sup>(2)</sup>	110	8	112	3,54	5,73	110	12,3	85,40
03TNIRR1259* <sup>(2)</sup>	125	4	80	4,58	7,39	125	14,0	97,00
03TNIRR1609* <sup>(2)</sup>	160	4	48	7,46	12,11	160	17,9	124,20
03TNIRR2009* <sup>(2)</sup>	200	4	32	11,57	18,91	200	22,4	155,20
03TNIRR2509* <sup>(2)</sup>	250	4	32	17,96	29,61	250	27,9	194,20
03TNIRR3159* <sup>(2)</sup>	315	4	32	28,36	46,97	315	35,2	244,60
03TNIRR3559* <sup>(2)</sup>	355	4	32	35,95	59,62	355	39,7	275,60
03TNIRR4009* <sup>(2)(3)</sup>	400	4	32	45,50	75,73	400	44,7	310,60

<sup>(2)</sup> Not present in the standard ASTM F2389 • <sup>(3)</sup> Not present in the standard DIN 8077-8078



## NIRON FG BLUE PPR FIBER GLASS PIPE

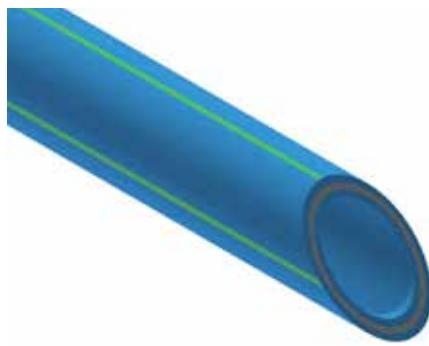

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø20 to ø400mm**

Packaging: **Bar length 4m**


Notes: **From ø160mm 5,8 or 11,6 m bars upon request**

**Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 11E**

### SDR 7,4 • S 3,2

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRFG2074	A	20	100	3.000	0,16	0,16	20	2,8	14,40
03TNIRFG2574	A	25	100	2.000	0,25	0,25	25	3,5	18,00
03TNIRFG3274	A	32	60	1.320	0,39	0,42	32	4,4	23,20
03TNIRFG4074	A	40	40	800	0,59	0,66	40	5,5	29,00
03TNIRFG5074	A	50	20	560	0,91	1,03	50	6,9	36,20
03TNIRFG6374	A	63	16	352	1,45	1,63	63	8,6	45,80
03TNIRFG7574	A	75	12	240	2,06	2,31	75	10,3	54,40
03TNIRFG9074	A	90	8	160	2,94	3,32	90	12,3	65,40
03TNIRFG11074	A	110	8	112	4,36	4,97	110	15,1	79,80
03TNIRFG12574	A	125	4	80	5,61	6,47	125	17,1	90,80
03TNIRFG16074	A	160	4	48	9,09	10,60	160	21,9	116,20
03TNIRFG20074	B	200	4	32	14,23	16,55	200	27,4	145,20
03TNIRFG25074	B	250	4	32	22,08	25,89	250	34,2	181,60
03TNIRFG31574	B	315	4	32	34,89	39,39	315	43,1	229,80
03TNIRFG35574	B	355	4	32	44,16	51,45	355	48,5	259,00
03TNIRFG40074	B	400	4	32	56,00	65,38	400	54,7	290,60



## NIRON FIBER BLUE PP-RP FIBER GLASS PIPE



Pipe structure: **Multilayer pipe**

Material: **PP-RP - Fiber glass**

Pipe series: **SDR 9 - S 4**

Colour: **Blue with dark blue stripes**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø400mm**

Packaging: **Bar length 4m**


Notes: **From ø160mm 5,8 or 11,6m bars upon request**

**Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 11F**

### SDR 9 • S 4

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRCL329	A	32	60	1.320	0,33	0,48	32	3,6	24,80
03TNIRCL409	A	40	40	800	0,51	0,75	40	4,5	31,00
03TNIRCL509	A	50	20	560	0,78	1,03	50	5,6	38,80
03TNIRCL639	A	63	16	352	1,24	1,87	63	7,1	48,80
03TNIRCL759	A	75	12	240	1,74	2,66	75	8,4	58,20
03TNIRCL909	A	90	8	160	2,51	3,82	90	10,1	69,80
03TNIRCL1109	A	110	8	112	3,73	5,73	110	12,3	85,40
03TNIRCL1259	A	125	4	80	4,82	7,39	125	14,0	97,00
03TNIRCL1609	A	160	4	48	7,83	12,11	160	17,9	124,20
03TNIRCL2009	B	200	4	32	12,00	18,91	200	22,4	155,20
03TNIRCL2509	B	250	4	32	18,70	29,61	250	27,9	194,20
03TNIRCL3159	B	315	4	32	29,50	46,97	315	35,2	244,60
03TNIRCL3559	B	355	4	32	37,40	59,62	355	39,7	275,60
03TNIRCL4009	B	400	4	32	47,30	75,73	400	44,7	310,60



## NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE



Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø400mm**

Packaging: **Bar length 4m**


Notes: **From ø160mm 5,8 or 11,6 m bars upon request**

**Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **12 bar/20°C**

Applications:



**FIG. 11G**

### SDR 11 • S 5

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRCL3211	A	32	60	1.320	0,28	0,54	32	2,9	26,20
03TNIRCL4011	A	40	40	800	0,43	0,83	40	3,7	32,60
03TNIRCL5011	A	50	20	560	0,67	1,31	50	4,6	40,80
03TNIRCL6311	A	63	16	352	1,04	2,07	63	5,8	51,40
03TNIRCL7511	A	75	12	240	1,44	2,96	75	6,8	61,40
03TNIRCL9011	A	90	8	160	2,08	4,25	90	8,2	73,60
03TNIRCL11011	A	110	8	112	3,10	6,36	110	10,0	90,00
03TNIRCL12511	A	125	4	80	4,02	8,20	125	11,4	102,20
03TNIRCL16011	A	160	4	48	6,50	13,43	160	14,6	130,80
03TNIRCL20011	B	200	4	32	10,09	21,01	200	18,2	163,60
03TNIRCL25011	B	250	4	32	15,01	32,86	250	22,7	204,60
03TNIRCL31511	B	315	4	32	24,67	52,17	315	28,6	257,80
03TNIRCL35511	B	355	4	32	31,20	66,29	355	32,2	290,60
03TNIRCL40011	B	400	4	32	39,51	84,14	400	36,3	327,40



## NIRON FIBER BLUE PP-RP FIBER GLASS PIPE



Pipe structure: **Multilayer pipe**

Material: **PP-RP - Fiber glass**

Pipe series: **SDR 17 - S 8**

Colour: **Blue with dark blue stripes**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø160 to ø400mm**

Packaging: **Bar length 4m**


Notes: **5,8 or 11,6 m bars upon request**

**Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **10 bar/20°C**

Applications:

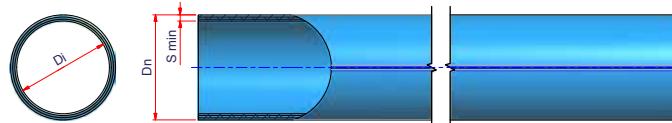


**FIG. 11H**

### SDR 17 • S 8

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRCL16017	A	160	4	48	4,65	15,61	160	9,5	141,00
03TNIRCL20017	B	200	4	32	6,90	24,37	200	11,9	176,20
03TNIRCL25017	B	250	4	32	10,68	38,13	250	14,9	220,40
03TNIRCL31517	B	315	4	32	16,91	60,49	315	18,7	277,60
03TNIRCL35517	B	355	4	32	21,39	76,81	355	21,1	312,80
03TNIRCL40017	B	400	4	32	27,07	97,60	400	23,7	352,60



## 5.1.2 NIRON-POLYSYSTEM PIPE FOR PLUMBING & HYDRONIC APPLICATIONS

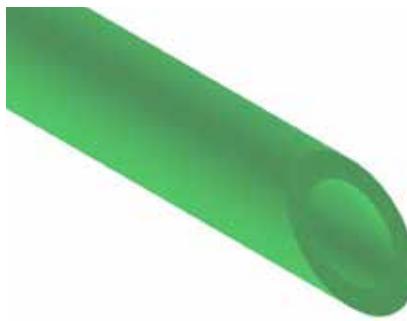

### NIRON-POLYSYSTEM FULL GREEN PPR PIPE

Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **SDR 6 - S 2,5**

Colour: **Green**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389  
UNI EN ISO 15494 - ISO 4065**

Range: **ø16 and from ø40 to ø125mm**

Packaging: **Bar length 4m**

Operating conditions: **25 bar/20°C**

Applications:



**FIG. 12A**

#### SDR 6 • S 2,5

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
16V6001	16	100	4.600	0,11	0,09	16	2,7	10,60
16V6005	40	40	800	0,66	0,56	40	6,7	26,60
16V6006	50	20	560	1,03	0,87	50	8,4	33,20
16V6007	63	16	352	1,62	1,38	63	10,5	42,00
16V6008	75	12	240	2,29	1,96	75	12,5	50,00
16V6009	90	8	160	3,30	2,83	90	15,0	60,00
16V6010	110	8	112	4,92	4,21	110	18,4	73,20
16V6011	125	4	80	6,30	5,46	125	20,8	83,40

### NIRON-POLYSYSTEM FULL GREEN PP-RP PIPE

Pipe series: **SDR 7,4 - S 3,2**

Range: **From ø20 to ø32mm**

Operating conditions: **25 bar/20°C**

#### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
16V6002*	20	100	3.000	0,15	0,16	20	2,8	14,40
16V6003*	25	100	2.000	0,23	0,25	25	3,5	18,00
16V6004*	32	60	1.320	0,37	0,42	32	4,4	23,20



## NIRON-POLYSYSTEM FULL GREEN PPR PIPE



Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Green**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389  
UNI EN ISO 15494 - ISO 4065**


Range: **From ø25 to ø250mm**

Packaging: **Bar length 4m**

Notes: **5,8 or 11,6m bars upon request**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 12B**

### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
16V6003/16	25	100	2.000	0,23	0,25	25	3,5	18,00
16V6004/16	32	60	1.320	0,37	0,42	32	4,4	23,20
16V6005/16	40	40	800	0,57	0,66	40	5,5	29,00
16V6006/16	50	20	560	0,88	1,03	50	6,9	36,20
16V6007/16	63	16	352	1,38	1,63	63	8,7	45,60
16V6008/16	75	12	240	1,96	2,31	75	10,3	54,40
16V6009/16	90	8	160	2,81	3,32	90	12,3	65,40
16V6010/16	110	8	112	4,22	4,97	110	15,1	79,80
16V6011/16	125	4	80	5,41	6,47	125	17,1	90,80
16V6012/16	160	4	48	8,79	10,60	160	21,9	116,20
16V6013/16	200	4	32	13,70	16,55	200	27,4	145,20
16V6014/16	250	4	32	21,25	25,89	250	34,2	181,60



## NIRON POLYSYSTEM FG GREEN PPR FIBER GLASS PIPE



Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Green with deep green stripes**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389  
ISO 4065**

Range: **From ø20 to ø400mm**

Packaging: **Bar length 4m**


Notes: **From ø160mm 5,8 or 11,6 m bars upon request**

**Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 12C**

### SDR 7,4 • S 3,2

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
16VFG6002	A	20	100	3.000	0,16	0,16	20	2,8	14,40
16VFG6003	A	25	100	2.000	0,24	0,25	25	3,5	18,00
16VFG6004	A	32	60	1.320	0,39	0,42	32	4,4	23,20
16VFG6005	A	40	40	800	0,59	0,66	40	5,5	29,00
16VFG6006	A	50	20	560	0,91	1,03	50	6,9	36,20
16VFG6007	A	63	16	352	1,45	1,63	63	8,6	45,60
16VFG6008	A	75	12	240	2,06	2,31	75	10,3	54,20
16VFG6009	A	90	8	160	2,94	3,32	90	12,3	65,00
16VFG6010	A	110	8	112	4,36	4,97	110	15,1	79,60
16VFG6011	A	125	4	80	5,61	6,47	125	17,1	90,80
16VFG6012	A	160	4	48	9,09	10,60	160	21,9	116,20
16VFG6013	B	200	4	32	14,23	16,55	200	27,4	145,20
16VFG6014	B	250	4	32	22,08	25,89	250	34,2	181,60
16VFG6015	B	315	4	32	34,89	39,39	315	43,1	229,80
16VFG6016	B	355	4	32	44,16	51,45	355	48,5	259,00
16VFG6017	B	400	4	32	56,00	65,38	400	54,7	290,60



## 5.1.3 NIRON RAIN WATER PIPE



### NIRON FULL PURPLE PPR PIPE

Pipe structure: **Monolayer pipe**

Material: **PPR**

Pipe series: **From ø20 to ø25mm SDR 7,4 - S 3,2**

**From ø32 to ø160mm SDR 11 - S 5**

Colour: **Purple**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389  
ISO 4065**

Range: **From ø20 to ø 160mm**

Packaging: **Bar length 4m**

Operating conditions: **SDR 7,4 ---> 20 bar/20°C  
SDR 11 ---> 12 bar/20°C**

Applications:




**FIG. 13A**

Code	SDR	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRV20	7,4	20	100	3.000	0,15	0,16	20	2,8	14,40
03TNIRV25	7,4	25	100	2.000	0,23	0,25	25	3,5	18,00
03TNIRV32	11	32	60	1.320	0,26	0,54	32	2,9	26,20
03TNIRV40	11	40	40	800	0,40	0,83	40	3,7	32,60
03TNIRV50	11	50	20	560	0,63	1,31	50	4,6	40,80
03TNIRV63	11	63	16	352	0,99	2,07	63	5,8	51,40
03TNIRV75	11	75	12	240	1,37	2,96	75	6,8	61,40
03TNIRV90	11	90	8	160	1,99	4,25	90	8,2	73,60
03TNIRV110	11	110	8	112	2,96	6,36	110	10,0	90,00
03TNIRV125	11	125	4	80	3,84	8,20	125	11,4	102,20
03TNIRV160	11	160	4	48	6,22	13,43	160	14,6	130,80



## 5.1.4 NIRON PREINSULATED PIPE

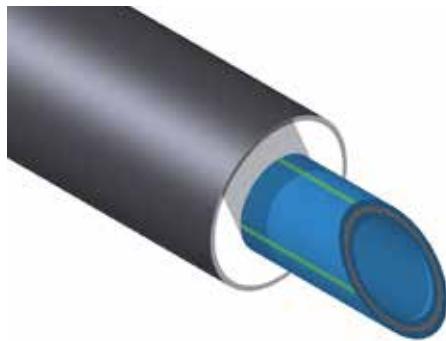

### NIRON FG PREINSULATED PPR FIBER GLASS PIPE

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - PUR - HDPE**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes - Black cover**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078  
CSA B 137.11 - ASTM F 2389 - ISO 4065**

Range: **From ø32 to ø315mm**

Packaging: **Bar length 5,8m until ø50mm  
From ø63 to ø315mm bar length 5,8 and 11,6m**

Operating conditions: **20 bar/20°C**

Applications:

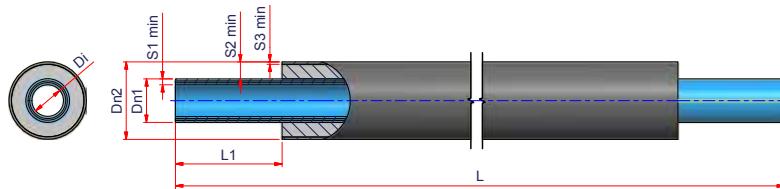



FIG. 14A

### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn1	Dn2	S1 min	S2 min	S3 min	Di	L1	L
03TNIRCBFG3274	32	60	1.320	1,51	0,42	32	90	4,4	26	3,0	23,20	220	5.800
03TNIRCBFG4074	40	40	800	1,91	0,66	40	110	5,5	32	3,0	29,00	220	5.800
03TNIRCBFG5074	50	20	560	2,09	1,03	50	110	6,9	27	3,0	36,20	220	5.800
03TNIRCBFG6374	63	16	352	2,71	1,63	63	125	8,6	28	3,0	45,80	220	5.800-11.600
03TNIRCBFG7574	75	12	240	3,37	2,31	75	140	10,3	29,5	3,0	54,40	220	5.800-11.600
03TNIRCBFG9074	90	8	160	5,28	3,32	90	160	12,3	32	3,0	65,40	220	5.800-11.600
03TNIRCBFG11074	110	8	112	6,46	4,97	110	200	15,1	41,8	3,2	79,80	220	5.800-11.600
03TNIRCBFG12574	125	4	80	9,84	6,47	125	225	17,1	46,6	3,4	90,80	220	5.800-11.600
03TNIRCBFG16074	160	4	48	13,94	10,60	160	250	21,9	41,4	3,6	116,20	220	5.800-11.600
03TNIRCBFG20074	200	4	32	21,94	16,55	200	315	27,4	53,4	4,1	145,20	220	5.800-11.600
03TNIRCBFG25074	250	4	32	34,60	25,89	250	400	34,2	70,2	4,8	181,60	220	5.800-11.600
03TNIRCBFG31574	315	4	32	45,33	39,39	315	450	42,6	62,3	5,2	229,80	220	5.800-11.600



## NIRON CLIMA PREINSULATED PPR FIBER GLASS PIPE

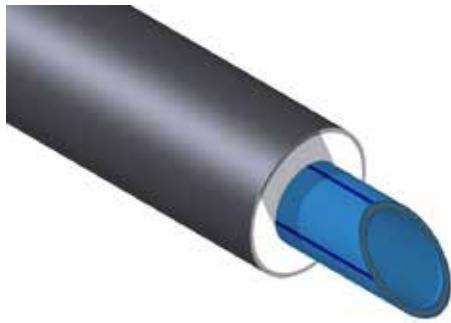

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - PUR - HDPE**

Pipe series: **SDR 11 - S5**

Colour: **Blue with dark blue stripes - Black cover**


Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078  
CSA B 137.11 - ASTM F 2389 - ISO 4065**

Range: **From ø32 to ø315mm**

Packaging: **Bar length 5,8m until ø50mm  
From ø63 to ø315mm bar length 5,8 and 11,6m**

Operating conditions: **12 bar/20°C**

Applications:

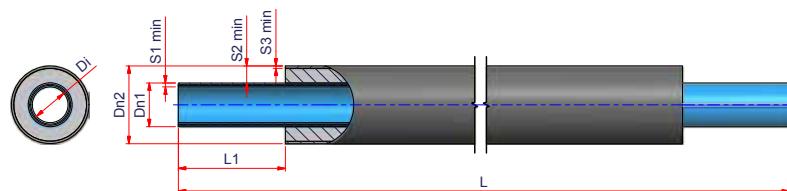


**FIG. 14B**

### SDR 11 • S5

Code	Ø	Pack.	Qty pallet	Weight kg/m	Litres l/m	Dn1	Dn2	S1 min	S2 min	S3 min	Di	L1	L
03TNIRCBCL3211	32	60	1.320	1,39	0,54	32	90	2,9	26	3,0	26,20	220	5.800
03TNIRCBCL4011	40	40	800	1,91	0,83	40	110	3,7	32	3,0	32,60	220	5.800
03TNIRCBCL5011	50	20	560	2,09	1,31	50	110	4,6	27	3,0	40,80	220	5.800
03TNIRCBCL6311	63	16	352	2,71	2,07	63	125	5,8	28	3,0	51,40	220	5.800-11.600
03TNIRCBCL7511	75	12	240	3,37	2,96	75	140	6,8	29,5	3,0	61,40	220	5.800-11.600
03TNIRCBCL9011	90	8	160	4,38	4,25	90	160	8,2	32	3,0	73,60	220	5.800-11.600
03TNIRCBCL11011	110	8	112	6,46	6,36	110	200	10,0	41,8	3,2	90,00	220	5.800-11.600
03TNIRCBCL12511	125	4	80	8,20	8,20	125	225	11,4	46,5	3,4	102,20	220	5.800-11.600
03TNIRCBCL16011	160	4	48	11,28	13,43	160	250	14,6	41,4	3,6	130,80	220	5.800-11.600
03TNIRCBCL20011	200	4	32	17,70	21,01	200	315	18,2	53,4	4,1	163,60	220	5.800-11.600
03TNIRCBCL25011	250	4	32	27,48	32,86	250	400	22,7	70,2	4,8	204,60	220	5.800-11.600
03TNIRCBCL31511	315	4	32	35,11	52,17	315	450	28,6	62,3	5,2	257,80	220	5.800-11.600



## NIRON OB-FG PREINSULATED OXYGEN BARRIER PPR PIPE

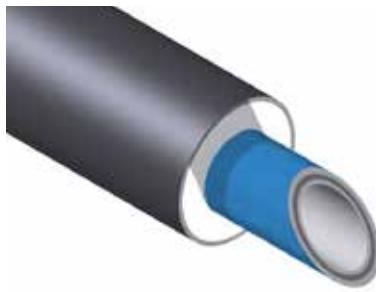

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue - Black cover**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø110mm**

Packaging: **Bar length 5,8m until ø50mm**  
**For ø90, ø110 and ø125mm bar length 5,8 and 11,6m**

Operating conditions: **20 bar/20°C**

Applications:

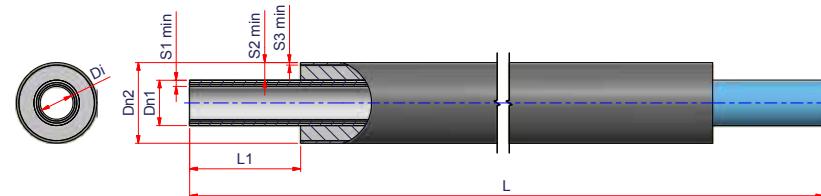

**FIG. 14C**


### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn1	Dn2	S1 min	S2 min	S3 min	Di	L1	L
03TNIRCBWBFG3274	32	60	1.320	1,51	0,42	32	90	4,4 + 0,1 OB (*)	26	3,0	23,20	220	5.800
03TNIRCBWBFG4074	40	40	800	2,09	0,66	40	110	5,5 + 0,1 OB (*)	32	3,0	29,00	220	5.800
03TNIRCBWBFG5074	50	20	560	2,36	1,03	50	110	6,9 + 0,1 OB (*)	27	3,0	36,20	220	5.800
03TNIRCBWBFG6374	63	16	352	3,15	1,63	63	125	8,6 + 0,1 OB (*)	28	3,0	45,80	220	5.800-11.600
03TNIRCBWBFG9074	90	8	160	4,92	3,32	90	160	12,3 + 0,1 OB (*)	32	3,0	65,40	220	5.800-11.600
03TNIRCBWBFG11074	110	8	112	7,79	4,97	110	200	15,1 + 0,1 OB (*)	41,8	3,2	79,80	220	5.800-11.600

(\*) Oxygen Barrier



## 5.1.5 NIRON OXYGEN BARRIER PIPE

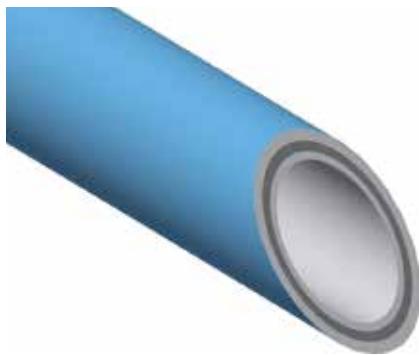

### NIRON OB-FG WHITE-BLUE OXYGEN BARRIER PPR PIPE

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass- Oxygen barrier**

Pipe series: **SDR 7,4 - S3,2**

Colour: **White - Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø110mm**

Packaging: **Bar length 4m**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 15A**


#### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRWBFG3274	32	60	1.320	0,40	0,42	32	4,4 + 0,1 OB (*)	23,20
03TNIRWBFG4074	40	40	800	0,61	0,66	40	5,5 + 0,1 OB (*)	29,00
03TNIRWBFG5074	50	20	560	0,94	1,03	50	6,9 + 0,1 OB (*)	36,20
03TNIRWBFG6374	63	16	352	1,48	1,63	63	8,6 + 0,1 OB (*)	45,80
03TNIRWBFG9074	90	8	160	2,99	3,32	90	12,3 + 0,1 OB (*)	65,40
03TNIRWBFG11074	110	8	112	4,43	4,97	110	15,1 + 0,1 OB (*)	79,80

(\*) Oxygen Barrier



## NIRON OB-CLIMA WHITE-BLUE OXYGEN BARRIER PPR PIPE

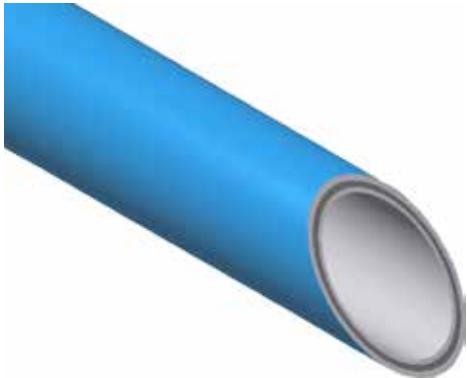

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 11 - S5**

Colour: **White - Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø110mm**

Packaging: **Bar length 4m**

Operating conditions: **12 bar/20°C**

Applications:



**FIG. 15B**


### SDR 11 • S 5

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRWBCL3211	32	60	1.320	0,30	0,54	32	2,9 + 0,1 OB (*)	26,20
03TNIRWBCL4011	40	40	800	0,46	0,83	40	3,7 + 0,1 OB (*)	32,60
03TNIRWBCL5011	50	20	560	0,71	1,31	50	4,6 + 0,1 OB (*)	40,80
03TNIRWBCL6311	63	16	352	1,11	2,07	63	5,8 + 0,1 OB (*)	51,40
03TNIRWBCL9011	90	8	160	2,22	4,25	90	8,2 + 0,1 OB (*)	73,60
03TNIRWBCL11011	110	8	112	3,15	6,36	110	10,0 + 0,1 OB (*)	90,00

(\*) Oxygen Barrier



## NIRON OB MULTILAYER WHITE-BLUE OXYGEN BARRIER PPR PIPE

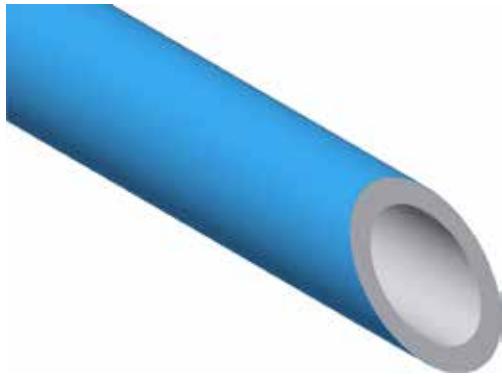

Pipe structure: **Multilayer pipe**

Material: **PPR - Oxygen barrier**

Pipe series: **SDR 7,4 - S3,2**

Colour: **White - Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **ø32, ø40, ø50, ø63, ø90, ø110mm**

Packaging: **Bar length 4m**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 15C**

### SDR 7,4 • S 3,2


Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRWBM3274	32	60	1.320	0,39	0,39	32	4,4 + 0,1 OB (*)	23,20
03TNIRWBM4074	40	40	800	0,59	0,59	40	5,5 + 0,1 OB (*)	29,00
03TNIRWBM5074	50	20	560	0,91	0,91	50	6,9 + 0,1 OB (*)	36,20
03TNIRWBM6374	63	16	352	1,42	1,42	63	8,7 + 0,1 OB (*)	45,80
03TNIRWBM9074	90	8	160	2,88	2,88	90	12,5 + 0,1 OB (*)	65,40
03TNIRWBM11074	110	8	112	4,31	4,31	110	15,2 + 0,1 OB (*)	79,80

(\*) Oxygen Barrier



## 5.1.6 NIRON UV RAY PROTECTION PIPE

### NIRON FG DARK PPR FIBER GLASS PIPE UV RAY BARRIER

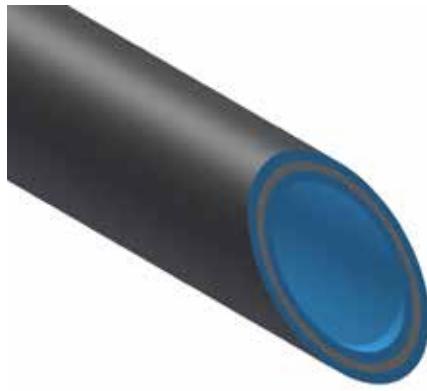

Pipe structure: **Multilayer pipe with UV ray protection**

Material: **PPR - Fiber glass - HDPE**

Pipe series: **SDR 7,4 - S3,2**

Colour: **Black - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø20 to ø400 mm**


Packaging: **Bar length 4m until ø125mm - from ø160mm 5,8m bar length**

Notes: **Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 16A**

#### SDR 7,4 • S3,2

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRDAFG2074	A	20	100	3.000	0,17	0,16	20	2,8 + 0,1 HDPE (*)	14,20
03TNIRDAFG2574	A	25	100	2.000	0,25	0,25	25	3,5 + 0,1 HDPE (*)	17,80
03TNIRDAFG3274	A	32	60	1.320	0,40	0,42	32	4,4 + 0,1 HDPE (*)	23,00
03TNIRDAFG4074	A	40	40	800	0,61	0,66	40	5,5 + 0,1 HDPE (*)	28,80
03TNIRDAFG5074	A	50	20	560	0,93	1,03	50	6,9 + 0,1 HDPE (*)	36,00
03TNIRDAFG6374	A	63	16	352	1,48	1,63	63	8,6 + 0,1 HDPE (*)	45,60
03TNIRDAFG7574	A	75	12	240	2,09	2,31	75	10,3 + 0,1 HDPE (*)	54,20
03TNIRDAFG9074	A	90	8	160	2,98	3,32	90	12,3 + 0,1 HDPE (*)	64,20
03TNIRDAFG11074	A	110	8	112	4,41	4,97	110	15,1 + 0,1 HDPE (*)	79,60
03TNIRDAFG12574	A	125	4	80	5,66	6,47	125	17,1 + 0,1 HDPE (*)	90,60
03TNIRDAFG16074	A	160	4	48	9,16	10,60	160	21,9 + 0,1 HDPE (*)	116,00
03TNIRDAFG20074	B	200	4	32	14,33	16,55	200	27,4 + 0,1 HDPE (*)	145,00
03TNIRDAFG25074	B	250	4	32	22,20	25,89	250	34,2 + 0,1 HDPE (*)	181,40
03TNIRDAFG31574	B	315	4	32	35,04	39,39	315	43,1 + 0,1 HDPE (*)	228,60
03TNIRDAFG35574	B	355	4	32	44,33	51,45	355	48,5 + 0,1 HDPE (*)	257,80
03TNIRDAFG40074	B	400	4	32	56,20	65,38	400	54,7 + 0,1 HDPE (*)	290,40

(\*) High Density Polyethylene



‘

## NIRON FIBER DARK PP-RP FIBER GLASS PIPE UV RAY BARRIER



Pipe structure: **Multilayer pipe with UV ray protection**

Material: **PP-RP - Fiber glass - HDPE**

Pipe series: **SDR 9 - S 4**

Colour: **Black - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø400mm**


Packaging: **Bar length 4m until ø125mm - from ø160mm 5,8m bar length**

Notes: **Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **20 bar/20°C**

Applications:




**FIG. 16B**

### SDR 9 • S 4

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRDACL329	A	32	60	1.320	0,34	0,48	32	3,6 + 0,1 HDPE (*)	24,60
03TNIRDACL409	A	40	40	800	0,53	0,75	40	4,5 + 0,1 HDPE (*)	30,80
03TNIRDACL509	A	50	20	560	0,80	1,03	50	5,6 + 0,1 HDPE (*)	38,60
03TNIRDACL639	A	63	16	352	1,27	1,87	63	7,1 + 0,1 HDPE (*)	48,60
03TNIRDACL759	A	75	12	240	1,77	2,66	75	8,4 + 0,1 HDPE (*)	58,00
03TNIRDACL909	A	90	8	160	2,55	3,82	90	10,1 + 0,1 HDPE (*)	69,60
03TNIRDACL1109	A	110	8	112	3,78	5,73	110	12,3 + 0,1 HDPE (*)	85,20
03TNIRDACL1259	A	125	4	80	4,88	7,39	125	14,0 + 0,1 HDPE (*)	96,80
03TNIRDACL1609	A	160	4	48	7,90	12,11	160	17,9 + 0,1 HDPE (*)	124,00
03TNIRDACL2009	B	200	4	32	12,10	18,91	200	22,4 + 0,1 HDPE (*)	155,00
03TNIRDACL2509	B	250	4	32	18,80	29,61	250	27,9 + 0,1 HDPE (*)	194,00
03TNIRDACL3159	B	315	4	32	29,60	46,97	315	35,2 + 0,1 HDPE (*)	244,40
03TNIRDACL3559	B	355	4	32	37,60	59,62	355	39,7 + 0,1 HDPE (*)	275,40
03TNIRDACL4009	B	400	4	32	47,50	75,73	400	44,7 + 0,1 HDPE (*)	310,40

(\*) High Density Polyethylene

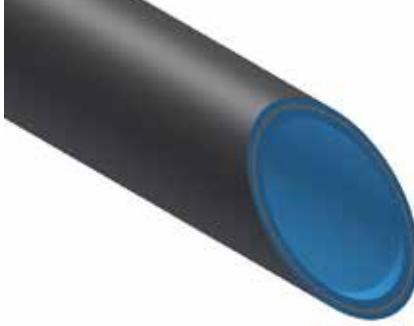

## NIRON CLIMA11 DARK PPR FIBER GLASS PIPE UV RAY BARRIER

Pipe structure: **Multilayer pipe with UV ray protection**

Material: **PPR - Fiber glass - HDPE**

Pipe series: **SDR 11 - S 5**

Colour: **Black - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø400mm**


Packaging: **Bar length 4m until ø125mm - from ø160mm 5,8m bar length**

Notes: **Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **12 bar/20°C**

Applications:



**FIG. 16C**

### SDR 11 • S 5

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRDACL3211	A	32	60	1.320	0,30	0,54	32	2,9 + 0,1 HDPE (*)	26,00
03TNIRDACL4011	A	40	40	800	0,45	0,83	40	3,7 + 0,1 HDPE (*)	32,40
03TNIRDACL5011	A	50	20	560	0,69	1,31	50	4,6 + 0,1 HDPE (*)	40,60
03TNIRDACL6311	A	63	16	352	1,07	2,07	63	5,8 + 0,1 HDPE (*)	51,20
03TNIRDACL7511	A	75	12	240	1,48	2,96	75	6,8 + 0,1 HDPE (*)	61,20
03TNIRDACL9011	A	90	8	160	2,12	4,25	90	8,2 + 0,1 HDPE (*)	93,40
03TNIRDACL11011	A	110	8	112	3,15	6,36	110	10,0 + 0,1 HDPE (*)	88,80
03TNIRDACL12511	A	125	4	80	4,08	8,20	125	11,4 + 0,1 HDPE (*)	102,00
03TNIRDACL16011	A	160	4	48	6,58	13,43	160	14,6 + 0,1 HDPE (*)	130,60
03TNIRDACL20011	B	200	4	32	10,19	21,01	200	18,2 + 0,1 HDPE (*)	163,40
03TNIRDACL25011	B	250	4	32	15,13	32,86	250	22,7 + 0,1 HDPE (*)	204,40
03TNIRDACL31511	B	315	4	32	24,82	52,17	315	28,6 + 0,1 HDPE (*)	257,60
03TNIRDACL35511	B	355	4	32	31,37	66,29	355	32,3 + 0,1 HDPE (*)	290,20
03TNIRDACL40011	B	400	4	32	39,71	84,14	400	36,3 + 0,1 HDPE (*)	327,20

(\*) High Density Polyethylene



## NIRON FIBER DARK PP-RP FIBER GLASS PIPE UV RAY BARRIER



Pipe structure: **Multilayer pipe with UV ray protection**

Material: **PP-RP - Fiber glass - HDPE**

Pipe series: **SDR 17 - S 8**

Colour: **Black - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø160 to ø400mm**


Packaging: **Bar length 5,8m**

Notes: **Type A - Multilayer pipe**

**Type B - Monolayer pipe 6% fiber reinforced**

Operating conditions: **10 bar/20°C**

Applications:



**FIG. 16D**

### SDR 17 • S 8

Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRDACL16017	A	160	4	48	4,73	15,61	160	9,5 + 0,1 HDPE (*)	140,80
03TNIRDACL20017	B	200	4	32	7,01	24,37	200	11,9 + 0,1 HDPE (*)	176,00
03TNIRDACL25017	B	250	4	32	10,81	38,13	250	14,8 + 0,1 HDPE (*)	220,20
03TNIRDACL31517	B	315	4	32	17,08	60,49	315	18,7 + 0,1 HDPE (*)	277,40
03TNIRDACL35517	B	355	4	32	21,58	76,81	355	21,1 + 0,1 HDPE (*)	312,60
03TNIRDACL40017	B	400	4	32	27,28	97,60	400	23,7 + 0,1 HDPE (*)	352,40

(\*) High Density Polyethylene



## 5.1.7 NIRON CHEMICAL RESISTANCE PIPE



### NIRON MULTILAYER PLATINUM POTABLE PPR PIPE CHEMICAL BARRIER

Pipe structure: **Multilayer pipe with chemical barrier**

Material: **PPR - Chemical barrier**

Pipe series: **SDR 7,4 - S3,2**

Colour: **Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø110mm**

Packaging: **Bar length 4m**

Operating conditions: **20 bar/20°C**

Applications:




**FIG. 17A**

#### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNRPLP3274-	<b>32</b>	60	1.320	0,37	0,42	<b>32</b>	4,4 + 0,1 CB (*)	23,00
03TNRPLP4074-	<b>40</b>	40	800	0,57	0,66	<b>40</b>	5,5 + 0,1 CB (*)	28,80
03TNRPLP5074-	<b>50</b>	20	560	0,88	1,03	<b>50</b>	6,9 + 0,1 CB (*)	36,00
03TNRPLP6374-	<b>63</b>	16	352	1,39	2,31	<b>63</b>	8,7 + 0,1 CB (*)	45,40
03TNRPLP9074-	<b>90</b>	8	160	2,83	3,32	<b>90</b>	12,5 + 0,1 CB (*)	64,80
03TNRPLP11074-	<b>110</b>	8	112	4,25	4,97	<b>110</b>	15,2 + 0,1 CB (*)	79,40

• Available only upon request

(\*) Chemical barrier

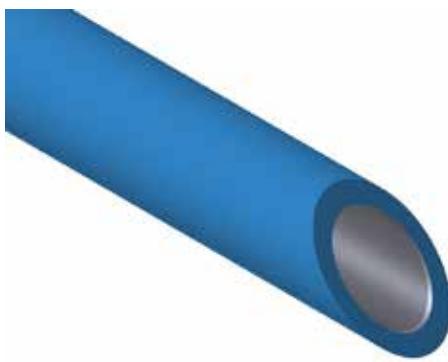

## NIRON MULTILAYER PLATINUM NON-POTABLE PPR PIPE CHEMICAL BARRIER

Pipe structure: **Multilayer pipe with chemical barrier**

Material: **PPR - Chemical barrier**

Pipe series: **SDR 7,4 - S3,2**

Colour: **Blue**


Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11 - ASTM F 2389**

Range: **From ø32 to ø110mm**

Packaging: **Bar length 4m**

Operating conditions: **20 bar/20°C**

Applications:



**FIG. 17B**

### SDR 7,4 • S 3,2

Code	Ø	Pack.	Q.ty pallet	Weight kg/m	Litres l/m	Dn	S min	Di
03TNIRPLNP3274-	<b>32</b>	60	1.320	0,37	0,42	<b>32</b>	4,4 + 0,1 CB (*)	23,00
03TNIRPLNP4074-	<b>40</b>	40	800	0,57	0,66	<b>40</b>	5,5 + 0,1 CB (*)	28,80
03TNIRPLNP5074-	<b>50</b>	20	560	0,88	1,03	<b>50</b>	6,9 + 0,1 CB (*)	36,00
03TNIRPLNP6374-	<b>63</b>	16	352	1,39	2,31	<b>63</b>	8,7 + 0,1 CB (*)	45,40
03TNIRPLNP9074-	<b>90</b>	8	160	2,83	3,32	<b>90</b>	12,5 + 0,1 CB (*)	64,80
03TNIRPLNP11074-	<b>110</b>	8	112	4,25	4,97	<b>110</b>	15,2 + 0,1 CB (*)	79,40

• Available only upon request

(\*) Chemical barrier



## 5.2 POLYFUSION & ELECTROFUSION FITTINGS

### 5.2.1 POLYFUSION FITTINGS




#### 90° LARGE RADIUS BEND

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  $\varnothing 20 \div \varnothing 25 \text{ mm}$



**FIG. 211**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D	L1	L	H
03NCLR20	16V6312	20	70	6.720	0,022	0,0001	20	28	16	55	55
03NCLR25	16V6313	25	50	4.800	0,034	0,0002	25	34	16	65	65


#### CROSSOVER PIPE



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  $\varnothing 20 \div \varnothing 32 \text{ mm}$

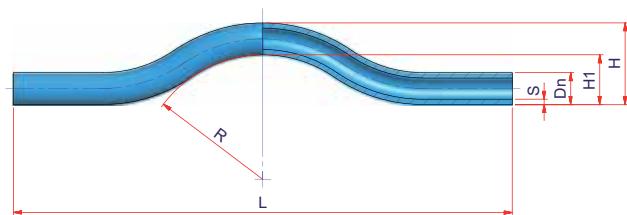

**FIG. 212**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	S	R	L	H1	H
03NSOR20	16V6012	20	50	2.600	0,078	0,0003	20	3,4	100	390	39	59
03NSOR25	16V6013	25	35	1.820	0,120	0,0005	25	4,2	97,5	390	39	64
03NSOR32	16V6014	32	20	1.040	0,185	0,0009	32	5,4	94	390	39	71



## COMPACT CROSSOVER F/F




Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

Notes: **Supplied in two pieces to be welded**

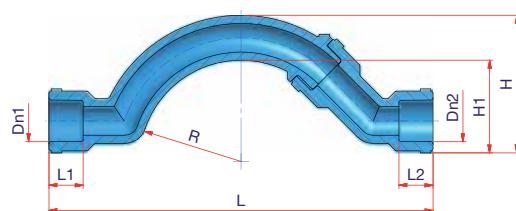

**FIG. 212A**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn1	Dn2	R	L1	L2	L	H1	H
03NSOFF20	16V6015	20	60	2.880	0,047	0,0003	20	20	47,5	16	16	180	43	64
03NSOFF25	16V6015A	25	30	1.440	0,088	0,0006	25	25	45,5	17	17	182	41	66

## COMPACT CROSSOVER M/F




Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

Notes: **Supplied in two pieces to be welded**

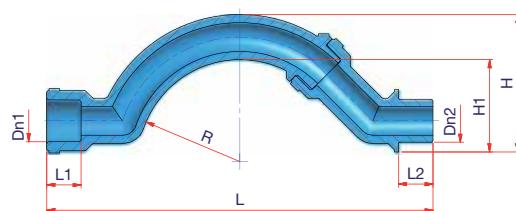


**FIG. 212B**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn1	Dn2	R	L1	L2	L	H1	H
03NSOFM20	16V6025	20	60	2.880	0,045	0,0003	20	20	47,5	16	16	180	43	64
03NSOFM25	16V6025A	25	30	1.440	0,090	0,0006	25	25	45,5	17	17	182	41	66




(A)



## 90° ELBOW

(B)

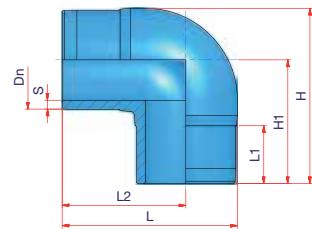

(C)

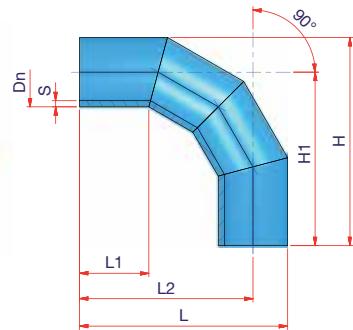
Material: **PPR**Standards: **DIN 16962 - UNI EN ISO 15874**Range: **ø16 ÷ ø630 mm**Notes: **Type B - Male/Male (SDR11) fitting for butt welding or electric socket welding****Type C - Segmented fitting**

FIG. 213


NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	S	D1	D	L1	L2	L	H1	H
03NG16	16V6201	A	16	150	13.200	0,013	0,0001	16	-	15	24	13	24	36	24	36
03NG20	16V6202	A	20	200	9.600	0,020	0,0001	20	-	16,5	29	16	27	41,5	27	41,5
03NG25	16V6203	A	25	100	4.800	0,033	0,0002	25	-	23,5	35,5	16	31	49	31	49
03NG32	16V6204	A	32	50	2.400	0,063	0,0003	32	-	30	46	20	37	60	37	60
03NG40	16V6205	A	40	40	1.920	0,103	0,0004	40	-	36	56	22	43	71	43	71
03NG50	16V6206	A	50	20	960	0,188	0,0008	50	-	46	70	25	51	86	51	86
03NG63	16V6207	A	63	10	480	0,340	0,0017	63	-	59	88	29	62	106	62	106
03NG75	-	A	75	6	288	0,508	0,0028	75	-	70	101	33	73	123,5	73	123,5
03NG90	-	A	90	4	192	0,638	0,0042	90	-	86	113	37	82,5	139	82,5	139
03NG110	-	A	110	2	96	1,475	0,0084	110	-	100	146	43	100	173	100	173
03NG125	-	A	125	24	96	2,170	0,0090	125	-	113	165	47,5	125	207,5	125	207,5
03NG160 <sup>(1)</sup>	-	B	160	55	55	3,018	0,0165	160	14,6	-	-	101	207	287	213	293,5
03NG200 <sup>(1)</sup>	-	B	200	30	30	5,500	0,0300	200	18,2	-	-	116	250	350	255	355
03NG250 <sup>(1)</sup>	-	C	250	1	1	20,000	-	250	22,7	-	-	250	625	750	625	750
03NG315 <sup>(1)</sup>	-	C	315	1	1	-	-	315	28,6	-	-	300	773	930,5	773	930,5
03NG355 <sup>(1)</sup>	-	C	355	1	1	-	-	355	32,2	-	-	300	833	1.010,5	833	1.010,5
03NG400 <sup>(1)</sup>	-	C	400	1	1	-	-	400	36,3	-	-	300	900	1.100	900	1.100
03NG450 <sup>(1)(2)</sup>	-	C	450	1	1	-	-	450	40,9	-	-	300	975	1.200	975	1.200
03NG500 <sup>(1)(2)</sup>	-	C	500	1	1	-	-	500	45,4	-	-	350	1.100	1.350	1.100	1.350
03NG560 <sup>(1)(2)</sup>	-	C	560	1	1	-	-	560	50,8	-	-	350	1.190	1.470	1.190	1.470
03NG630 <sup>(1)(2)</sup>	-	C	630	1	1	-	-	630	57,2	-	-	350	1.295	1.610	1.295	1.610

<sup>(1)</sup> Diameter not included in the standard UNI EN ISO 15874 + Amendment • <sup>(2)</sup> Diameter not included in the standard DIN 16962



‘

## 90° ELBOW - SDR 17

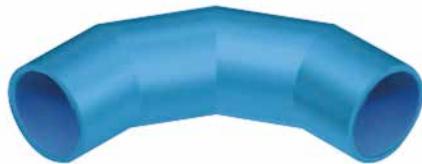


Material: **PPR**

Standards: **DIN 16962**

Range: **ø160 ÷ ø400 mm**

Notes: **Segmented fitting**

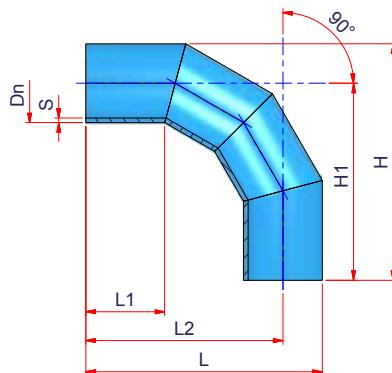


**FIG. 213A**

NIRON Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	S	L1	L2	L	H1	H
03NGD160	160	1	1	-	-	160	9,5	150	390	470	390	470
03NGD200	200	1	1	-	-	200	11,9	150	450	550	450	550
03NGD250	250	1	1	-	-	250	14,8	250	625	750	625	750
03NGD315	315	1	1	-	-	315	18,7	300	773	930,5	773	930,5
03NGD355	355	1	1	-	-	355	21,1	300	833	1.010,5	833	1.010,5
03NGD400	400	1	1	-	-	400	23,7	300	900	1.100	900	1.100



(A)




## FEMALE THREADED 90° ELBOW

Material: **PPR - Brass**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16x1/2" ÷ ø63x2" mm**

(B)

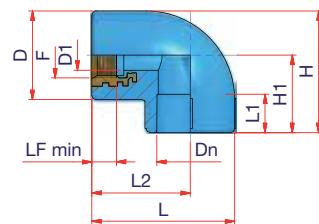

(C)

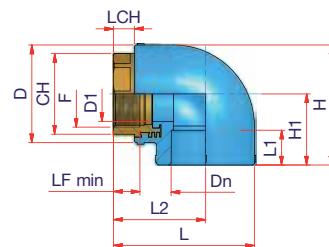

**FIG. 213B**

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	D1	D	F	LF min	L1	L2	L	H1	H	CH	LCH
03NGF1612	16V6831	A	16 x 1/2"	50	4.400	0,075	0,0002	16	14	37	1/2"	11,5	13	39	53,5	27,5	46	-	-
03NGF2012	16V6832	B	20 x 1/2"	60	5.280	0,073	0,0001	20	14	37	1/2"	11,5	16	39	53,5	27,5	46	-	-
03NGF2512	16V6834	A	25 x 1/2"	50	4.400	0,082	0,0002	25	14	37	1/2"	11,5	17	39	56,5	30,5	49	-	-
03NGF2534	16V6835	A	25 x 3/4"	40	3.520	0,112	0,0002	25	18,5	42	3/4"	13,2	17	39	56,5	30,5	51,5	-	-
03NGF3212	16V6838	B	32 x 1/2"	30	2.640	0,098	0,0003	32	18,5	42	3/4"	13,2	18	46	67	36	57	-	-
03NGF3234	16V6837	B	32 x 3/4"	35	3.080	0,121	0,0002	32	24	54	1"	18	20	46	67	47	74	-	-
03NGF321	16V6836	B	32 x 1"	20	1.760	0,193	0,0004	32	14	42	1/2"	11,5	18	46	67	36	57	-	-
03NGF401	-	B	40 x 1"	18	1.584	0,222	0,0005	40	24	57	1"	18	20	52	79	43	72	-	-
03NGF50114	-	C	50 x 1 1/4"	10	960	0,400	0,0010	50	39,5	70	1 1/2"	19	25	66	101	51	86	55	15
03NGF50112	-	C	50 x 1 1/2"	10	880	0,500	0,0009	50	33	70	1 1/4"	21,4	25	66	101	51	86	46	15
03NGF63112	-	C	63 x 1 1/2"	4	384	0,750	0,0024	63	39,5	88	1 1/2"	19	29	77	121	62	106	55	15
03NGF632	-	C	63 x 2"	4	352	0,750	0,0021	63	50	88	2"	23,7	29	82	126	62	106	65	20




## MALE THREADED 90° ELBOW



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16x1/2" ÷ ø32x1" mm**

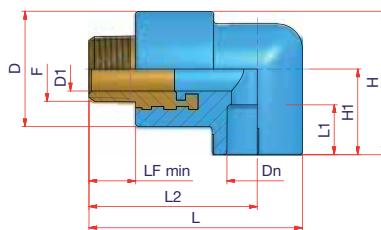

**FIG. 213C**

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	D	F	LF min	L1	L2	L	H1	H
03NGM1612	16V6840	16 x 1/2"	50	4.800	0,109	0,0002	16	14	37	1/2"	13,2	13	54	68,5	27,5	46
03NGM2012	16V6841	20 x 1/2"	50	4.400	0,108	0,0002	20	14	37	1/2"	13,2	16	54	68,5	27,5	46
03NGM2512	16V6842	25 x 1/2"	50	4.800	0,111	0,0002	25	14	37	1/2"	13,2	17	54	71,5	30,5	49
03NGM2534	16V6843	25 x 3/4"	40	3.520	0,155	0,0002	25	18,5	42	3/4"	14,5	17	54	73,5	30,5	51,5
03NGM3212	16V6846	32 x 1/2"	30	2.880	0,136	0,0003	32	14	42	1/2"	13,2	18	61	82	36	57
03NGM3234	16V6845	32 x 3/4"	30	2.640	0,180	0,0003	32	18,5	42	3/4"	14,5	18	61	84	36	57
03NGM321	16V6844	32 x 1"	20	1.760	0,300	0,0004	32	24	54	1"	16,8	20	65	86,5	47	74


## FEMALE THREADED 90° ELBOW WITH HANGER



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16x1/2" ÷ ø20x1/2"**

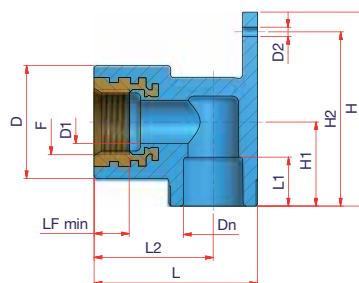

**FIG. 213D**

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	D2	D	F	LF min	L1	L2	L	H1	H2	H
03NTER1612	16V6801	16 x 1/2"	40	3.520	0,085	0,0002	16	14	3	37	1/2"	11,5	13	39	53,5	27,5	57	63,5
03NTER2012	16V6802	20 x 1/2"	40	3.520	0,083	0,0002	20	14	3	37	1/2"	11,5	16	39	53,5	27,5	57	63,5



## FEMALE THREADED 90° ELBOW WITH DOUBLE HANGER



Material: *PPR - Brass*

Standards: *DIN 16962 - UNI EN ISO 15874*

Range:  $\varnothing 20 \times 3/8'' \div \varnothing 20 \times 1/2'' \text{ mm}$

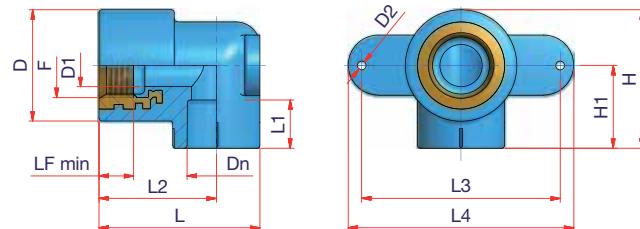


FIG. 213E

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	D2	D	F	LF min	L1	L2	L3	L4	L	H1	H
03NGTF2038	16V6781	$20 \times 3/8''$	40	3.840	0,071	0,0002	20	11	3	37	$3/8''$	11	16	50	66	75	64,5	27,5	46
03NGTF2012	16V6782	$20 \times 1/2''$	40	3.520	0,075	0,0002	20	14	3	37	$1/2''$	13,2	16	54	66	75	64,5	27,5	46



## MALE THREADED 90° ELBOW WITH DOUBLE HANGER

Material: *PPR - Brass*

Standards: *DIN 16962 - UNI EN ISO 15874*

Range:  $\varnothing 20 \times 3/8'' \div \varnothing 20 \times 1/2'' \text{ mm}$

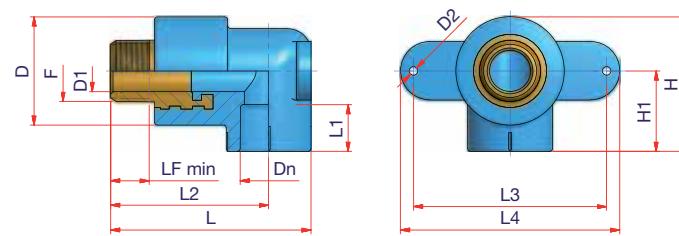


FIG. 213F

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	D2	D	F	LF min	L1	L2	L3	L4	L	H1	H
03NGTM2038	16V6790	$20 \times 3/8''$	40	3.840	0,092	0,0002	20	11	3	37	$3/8''$	11	16	50	66	75	64,5	27,5	46
03NGTM2012	16V6791	$20 \times 1/2''$	40	3.840	0,110	0,0002	20	14	3	37	$1/2''$	13,2	16	54	66	75	68,5	27,5	46




## MOUNTING UNIT WITH 2 ELBOWS FOR ADJUSTABLE INSTALLATIONS



Material: **PPR - Brass - Metal**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1/2'' \text{ mm}$**

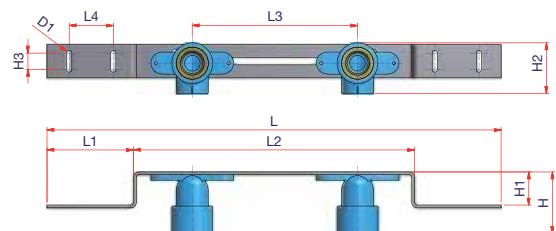

**FIG. 214**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L2	L3	L4	L	H1	H2	H3	H	D1
03NGVRF2012	-	<b><math>20 \times 1/2''</math></b>	12	624	0,388	0,0014	20	77,5	255	150	40	410	30	46	15	56	5


## TEMPLATE FOR EXTERNAL BATH TAPS



Material: **PPR - Brass - Metal**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1/2'' \div \varnothing 25 \times 1/2'' \text{ mm}$**

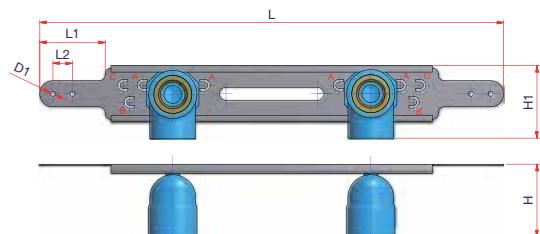

**FIG. 214A**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L2	L	H1	H	D1	A-A	B-A	B-B	C-C
03NGVF2012	16V6792	<b><math>20 \times 1/2''</math></b>	12	624	0,308	0,0014	20	50	15	354	50,5	55,5	4	150	160	170	180
03NGVF2512	16V6793	<b><math>25 \times 1/2''</math></b>	6	312	0,350	0,0029	20	50	15	354	56	55,5	4	150	160	170	180




## FEMALE THREADED 90° ELBOW FOR TEMPLATE



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1/2'' \div \varnothing 25 \times 1/2'' \text{ mm}$**

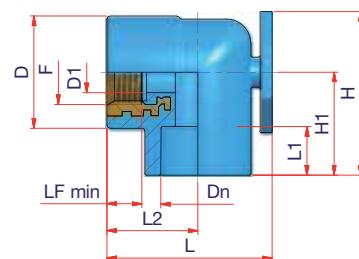

**FIG. 214B**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	D	F	LF min	L1	L2	L	H1	H
03NGOF2012	16V6795	20 x 1/2"	50	4.800	0,081	0,0002	20	14	37	1/2"	11,5	16	30	54,5	28,5	48,5
03NGOF2512	16V6797	25 x 1/2"	40	3.840	0,086	0,0002	25	14	37	1/2"	11,5	16	30	54,5	34	54


## MALE THREADED 90° ELBOW FOR TEMPLATE



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1/2'' \text{ mm}$**

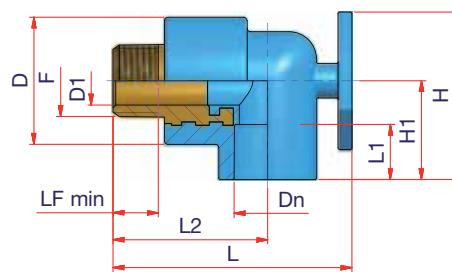

**FIG. 214C**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	D	F	LF min	L1	L2	L	H1	H
03NGOM2012	16V6796	20 x 1/2"	40	3.840	0,111	0,0002	20	14	37	1/2"	13,2	16	45	69,5	28,5	48,5



## MOUNTING UNIT

Material: **Metal**

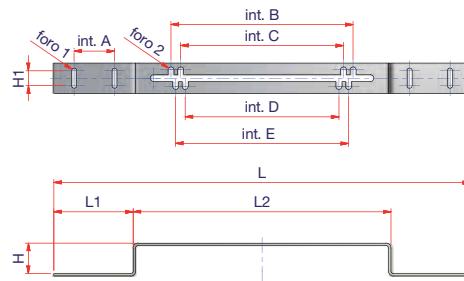


FIG. 214D

NIRON/POLYSYSTEM Codice	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	L	L1	L2	H	H1	hole 1	int. A	hole 2	int. B	int. C	int. D	int. E
00DIMMA	28	-	0,239	0,0005	410	77,5	255	30	15	5	40	6,5	170	150	160	180

## LONG BRACKET FOR OCTAGONAL BASE

Material: **Metal**

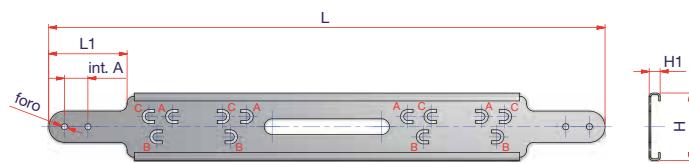


FIG. 214E

NIRON/POLYSYSTEM Codice	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	L	L1	H	H1	hole	int.A	A-A	B-A	B-B	C-C
00DIMARL	100	-	0,125	0,0001	354	50	42,5	6,5	4	15	150	160	170	180




## MALE/FEMALE 90° ELBOW



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20 ÷ ø40 mm**

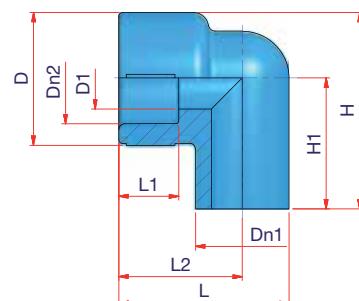

**FIG. 213G**

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	D1	D	L1	L2	L	H1	H
03NGMF20	16V6212	20	100	8.800	0,015	0,0001	13,2	30	16	29	39	28,5	43,5
03NGMF25	16V6213	25	75	6.600	0,024	0,0001	16,6	35	16	33	45,5	35	52,5
03NGMF32	-	32	70	3.360	0,057	0,0002	24	43	20	34	50	47,5	68,5
03NGMF40	-	40	50	2.400	0,082	0,0003	24	43	20	34	50	47,5	68,5


## MALE/FEMALE THREADED 90° ELBOW



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20x1/2" mm**

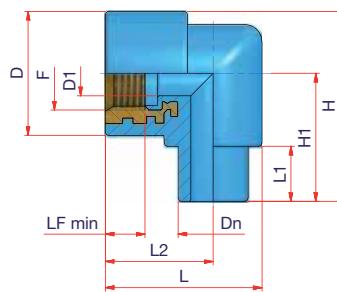


**FIG. 213H**


NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	D1	D	F	LF min	L1	L2	L	H1	H
03NGMFF2012	16V6805	20x1/2	70	6.720	0,077	0,0001	20	13,2	36	1/2"	11,5	16	31	45	37	55




(A)



(B)



(C)

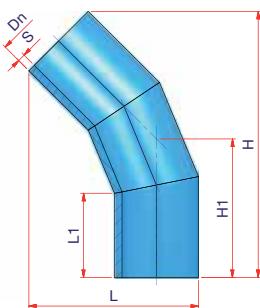

## 45° ELBOW

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16 ÷ ø630 mm**

Notes: **Type B - Male/Male fitting (SDR11) for butt welding or electrofusion welding**

**Type C - Segmented fitting**

**FIG. 215**

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	S	D1	D	L1	L	H1	H
03NC4516	16V6301	A	16	150	13.200	0,011	0,0001	16	-	15	25	13	33	16,5	37
03NC4520	16V6302	A	20	200	9.600	0,018	0,0001	20	-	16,5	29	16	33	21,5	46
03NC4525	16V6303	A	25	150	7.200	0,023	0,0001	25	-	23,5	34	16	46	24,5	53,5
03NC4532	16V6304	A	32	40	3.520	0,039	0,0002	32	-	30	42	20	56	29	64
03NC4540	16V6305	A	40	24	2.112	0,075	0,0004	40	-	36	53	22	67	32	72,5
03NC4550	16V6306	A	50	26	1.248	0,123	0,0007	50	-	47,5	66	25	83,5	39,5	90
03NC4563	16V6307	A	63	15	720	0,216	0,0012	63	-	60	83	29	102	45	105
03NC4575	-	A	75	6	288	0,467	0,0028	75	-	70	99	33	129,5	65	145
03NC4590	-	A	90	4	192	0,675	0,0042	90	-	86	123,5	37	145	57	140
03NC45110	-	A	110	2	96	1,150	0,0084	110	-	100	146	43	172,5	70	169,5
03NC45125	-	A	125	2	96	1,525	0,0084	125	-	113	165	47,5	194	78	189,5
03NC45160 <sup>(1)</sup>	-	B	160	70	70	1,985	0,0130	160	14,6	-	-	103	245	150	311
03NC45200 <sup>(1)</sup>	-	B	200	36	36	4,305	0,0250	200	18,2	-	-	117	306	195	402
03NC45250 <sup>(1)</sup>	-	C	250	1	-	-	-	250	22,7	-	-	250	-	412	-
03NC45315 <sup>(1)</sup>	-	C	315	1	-	-	-	315	28,6	-	-	300	-	498	-
03NC45355 <sup>(1)</sup>	-	C	355	1	-	-	-	355	32,2	-	-	300	-	520	-
03NC45400 <sup>(1)(2)</sup>	-	C	400	1	-	-	-	400	36,3	-	-	300	-	548	-
03NC45450 <sup>(1)(2)</sup>	-	C	450	1	-	-	-	450	40,9	-	-	300	-	580	-
03NC45500 <sup>(1)(2)</sup>	-	C	500	1	-	-	-	500	45,4	-	-	350	-	665	-
03NC45560 <sup>(1)(2)</sup>	-	C	560	1	-	-	-	560	50,8	-	-	350	-	698	-
03NC45630 <sup>(1)(2)</sup>	-	C	630	1	-	-	-	630	57,2	-	-	350	-	741	-

<sup>(1)</sup> Diameter not included in the standard UNI EN ISO 15874 + Amendment • <sup>(2)</sup> Diameter not included in the standard DIN 16962



## 45° ELBOW - SDR 17




Material: **PPR**

Standards: **DIN 16962**

Range: **ø160 ÷ ø400 mm**

Notes: **Segmented fitting**

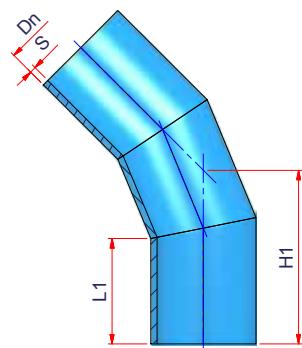

**FIG. 215A**

NIRON Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	S	L1	H1
03NCD45160	160	1	1	-	-	160	9,5	150	249
03NCD45200	200	1	1	-	-	200	11,9	150	274
03NCD45250	250	1	1	-	-	250	14,8	250	412
03NCD45315	315	1	1	-	-	315	18,7	300	498
03NCD45355	355	1	1	-	-	355	21,1	300	520
03NCD45400	400	1	1	-	-	400	23,7	300	548




## MALE/FEMALE 45° ELBOW

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20 ÷ ø25 mm**

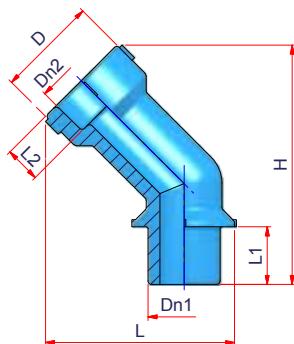


**FIG. 215B**

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	D	L1	L2	L	H
03NCMF4520	-	20	100	8.800	0,016	0,0001	20	20	28	16	10	53	66
03NCMF4525	-	25	70	6.720	0,028	0,0001	25	25	35	17	12	56,5	72



(A)



## 90° TEE

Material: **PPR**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16 ÷ ø630 mm**



Notes: **Type B - Male/Male fitting (SDR11) for butt welding or electrofusion welding**

**Type C - Segmented fitting**

(B)

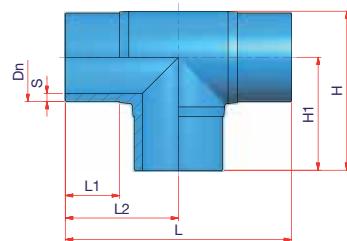

(C)

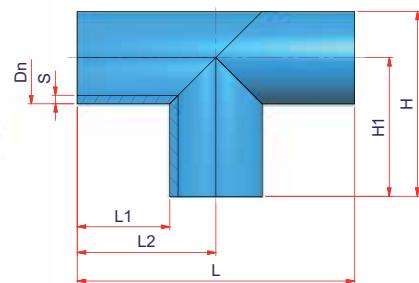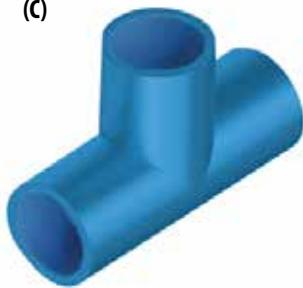

**FIG. 216**

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	S	D1	D	L1	L2	L	H1	H
03NT16	16V6401	A	16	100	8.800	0,019	0,0001	16	-	13	24	14,5	23,5	47	23,5	35,5
03NT20	16V6402	A	20	150	7.200	0,026	0,0001	20	-	18	33	16	27	54	27	43,5
03NT25	16V6403	A	25	80	3.840	0,042	0,0002	25	-	21	35	17	31,5	63	31,5	49
03NT32	16V6404	A	32	40	1.920	0,083	0,0004	32	-	30	46	20	37	74	37	60
03NT40	16V6405	A	40	30	1.440	0,127	0,0006	40	-	36	56	22	43	86	43	71
03NT50	16V6406	A	50	16	768	0,234	0,0011	50	-	46	70	25	51	102	51	86
03NT63	16V6407	A	63	8	384	0,438	0,0021	63	-	59	88	29	62	124	62	106
03NT75	-	A	75	5	240	0,650	0,0034	75	-	70	101	33	73	146	73	123,5
03NT90	-	A	90	4	192	0,788	0,0042	90	-	88	113	37	84	168	84	140,5
03NT110	-	A	110	2	96	1,900	0,0084	110	-	100	146	43	100	200	100	173
03NT125	-	A	125	1	48	2,700	0,0168	125	-	113	165	47,5	125	250	125	207,5
03NT160 <sup>(1)</sup>	-	B	160	40	40	4,200	0,0225	160	14,6	-	-	101	210	420	210	293,5
03NT200 <sup>(1)</sup>	-	B	200	10	20	7,000	0,0509	200	18,2	-	-	115	245	490	245	349
03NT250 <sup>(1)</sup>	-	C	250	1	-	7,500	-	250	22,7	-	-	250	375	750	375	500
03NT315 <sup>(1)</sup>	-	C	315	1	-	-	-	315	28,6	-	-	300	460	920	460	617,5
03NT355 <sup>(1)</sup>	-	C	355	1	-	-	-	355	32,2	-	-	300	480	960	480	657,5
03NT400 <sup>(1)(2)</sup>	-	C	400	1	-	-	-	400	36,3	-	-	300	500	1.000	500	700
03NT450 <sup>(1)(2)</sup>	-	C	450	1	-	-	-	450	40,9	-	-	300	525	1.050	525	750
03NT500 <sup>(1)(2)</sup>	-	C	500	1	-	-	-	500	45,4	-	-	350	600	1.200	600	850
03NT560 <sup>(1)(2)</sup>	-	C	560	1	-	-	-	560	50,8	-	-	350	630	1.260	630	910
03NT630 <sup>(1)(2)</sup>	-	C	630	1	-	-	-	630	57,2	-	-	350	665	1.330	665	980

<sup>(1)</sup> Diameter not included in the standard UNI EN ISO 15874 + Amendment • <sup>(2)</sup> Diameter not included in the standard DIN 16962



## 90° TEE - SDR 17




Material: **PPR**

Standards: **DIN 16962**

Range: **ø160 ÷ ø400 mm**

Notes: **Segmented fitting**

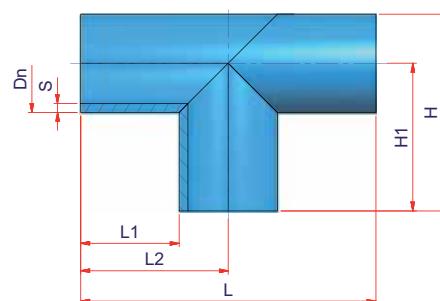

**FIG. 216A**

NIRON Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	S	L1	L2	L	H1	H
03NTD160	160	1	1	-	-	160	9,5	150	230	460	230	310
03NTD200	200	1	1	-	-	200	11,9	150	250	500	250	350
03NTD250	250	1	1	-	-	250	14,8	250	375	750	375	500
03NTD315	315	1	1	-	-	315	18,7	300	460	920	460	617,5
03NTD355	355	1	1	-	-	355	21,1	300	480	960	480	657,5
03NTD400	400	1	1	-	-	400	23,7	300	500	1.000	500	700




## FEMALE THREADED TEE



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 16 \times 1/2'' \times 16 \div \varnothing 32 \times 1'' \times 32 \text{ mm}$**

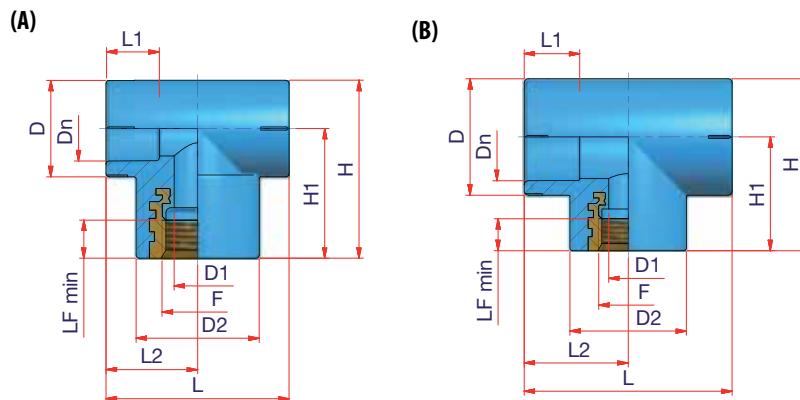

**FIG. 216B**

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Qty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	D2	D	F	LF min	L1	L2	L	H1	H
03NTF1612	16V6851A	A	<b><math>16 \times 1/2'' \times 16</math></b>	50	4.800	0,085	0,0002	16	14,1	37	29	$1/2''$	11,5	14	26,5	53	33	47,5
03NTF2012	16V6851	A	<b><math>20 \times 1/2'' \times 20</math></b>	50	4.400	0,078	0,0002	20	14,1	37	29	$1/2''$	11,5	16	27,5	55	39	53,5
03NTF2512	16V6853	A	<b><math>25 \times 1/2'' \times 25</math></b>	40	3.520	0,089	0,0002	25	14,1	37	35	$1/2''$	11,5	17	30,5	61	39	56,5
03NTF2534	16V6854	A	<b><math>25 \times 3/4'' \times 25</math></b>	35	3.080	0,116	0,0002	25	18,5	42	35	$3/4''$	13,2	17	30,5	61	39	56,5
03NTF3212	16V6855A	B	<b><math>32 \times 1/2'' \times 32</math></b>	20	1.760	0,117	0,0004	32	14,1	42	42	$1/2''$	11,5	20	37,5	75	41	62
03NTF3234	16V6855	B	<b><math>32 \times 3/4'' \times 32</math></b>	24	2.112	0,140	0,0004	32	18,5	42	42	$3/4''$	13,2	20	37,5	75	41	62
03NTF321	16V6852	B	<b><math>32 \times 1'' \times 32</math></b>	16	1.408	0,216	0,0005	32	24	54	42	$1''$	17,8	20	47	95	39	66



## MALE THREADED TEE



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 16 \times 1/2'' \times 16 \div \varnothing 32 \times 1'' \times 32 \text{ mm}$**

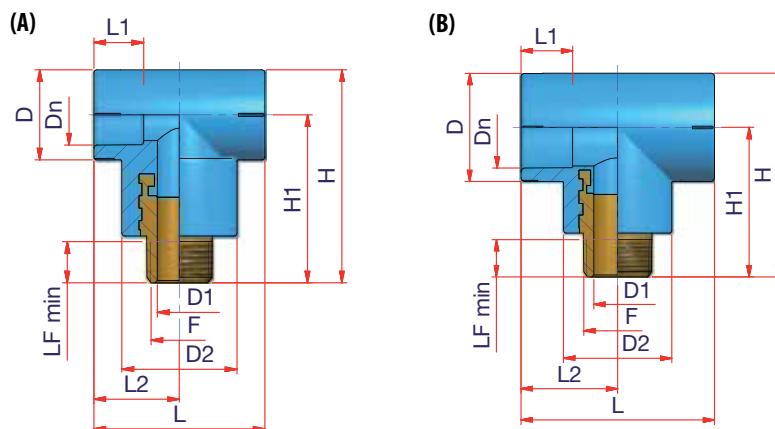


FIG. 216C

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	D2	D	F	LF min	L1	L2	L	H1	H
03NTM1612	16V6856A	A	16 x 1/2" x 16	50	4.800	0,112	0,0002	16	14,1	37	29	1/2"	13,2	14	26,5	53	48	62,5
03NTM2012	16V6856	A	20 x 1/2" x 20	50	4.400	0,112	0,0002	20	14,1	37	29	1/2"	13,2	16	27,5	55	54	68,5
03NTM2512	16V6857	A	25 x 1/2" x 25	40	3.840	0,116	0,0002	25	14,1	37	35	1/2"	13,2	17	30,5	61	54	71,5
03NTM2534	16V6858	A	25 x 3/4" x 25	30	2.640	0,162	0,0003	25	18,5	42	35	3/4"	14,5	17	30,5	61	56	73,5
03NTM3212	16V6859A	B	32 x 1/2" x 32	25	2.400	0,149	0,0004	32	14,1	42	42	1/2"	13,2	20	37,5	75	56	77
03NTM3234	16V6859	B	32 x 3/4" x 32	24	2.112	0,183	0,0004	32	18,5	42	42	3/4"	14,5	20	37,5	75	58	79
03NTM321	16V6860	B	32 x 1" x 32	14	1.232	0,322	0,0005	32	24	54	42	1"	16,8	20	47,5	95	63,5	85



## REDUCED TEE




Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16-20-16 ÷ ø315-160-315 mm**

Notes: **Type E - Segmented fitting - Male/Male (SDR11)  
for butt welding or electrofusion welding**

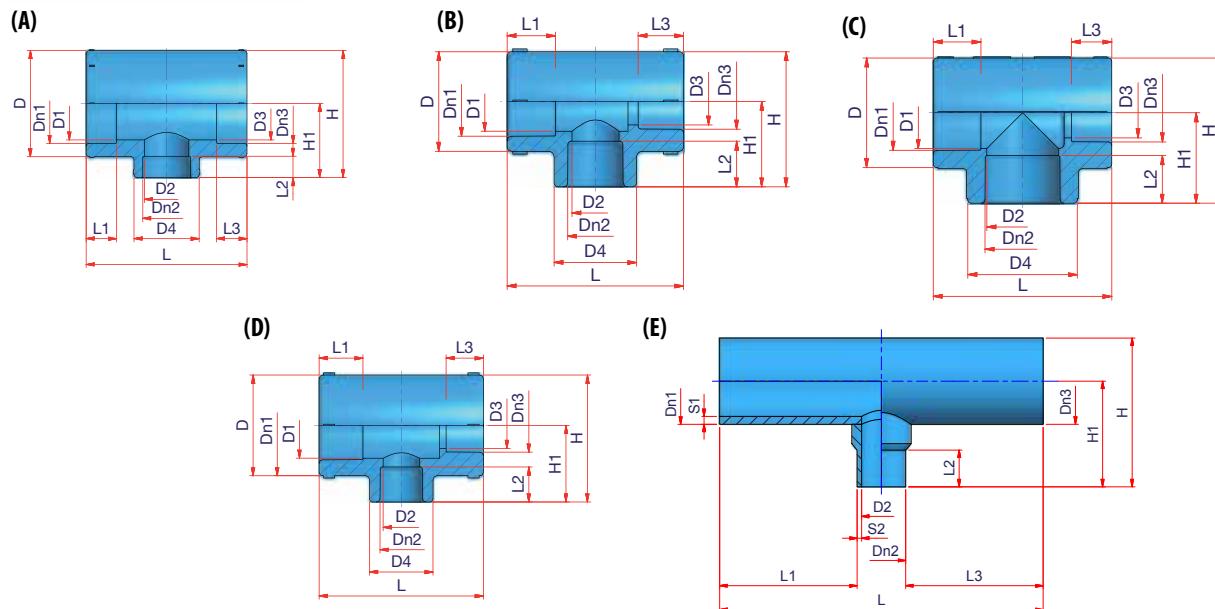

**FIG. 216D**

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	D1	D2	D3	D4	D	L1	L2	L3	L	H1	H
03NTR162016	16V6409A	A	16x20x16	150	7.200	0,029	0,0001	16	20	16	13,5	14	13,5	29	29	14	16	14	53	27	42
03NTR201616	16V6409B	B	20x16x16	150	7.200	0,029	0,0001	20	16	16	14	13,5	13,5	29	29	16	14	14	53	27	42
03NTR201620	16V6409	A	20x16x20	150	7.200	0,028	0,0001	20	16	20	16,5	13,5	16,5	29	29	16	14	16	53	27	42
03NTR202016	16V6409C	C	20x20x16	150	7.200	0,030	0,0001	20	20	16	14	14	13,5	29	29	16	16	14	53	27	42
03NTR251625	16V6410	A	25x16x25	80	3.840	0,040	0,0002	25	16	25	21	13,5	21	29	35	17	14	17	62	30	47,5
03NTR252020	16V6412	B	25x20x20	90	4.320	0,041	0,0002	25	20	20	21	16,5	16,5	29	35	17	16	16	62	30	47,5
03NTR252025	16V6413	A	25x20x25	80	3.840	0,038	0,0002	25	20	25	21	16,5	21	29	35	17	16	17	62	30	47,5
03NTR252520	16V6411	C	25x25x20	80	3.840	0,045	0,0002	25	25	20	21	21	16,5	35	35	17	17	16	62	30	47,5
03NTR253225	-	A	25x32x25	80	3.840	0,038	0,0002	25	32	25	21	21	21	46	46	17	20	17	74	38	61
03NTR322020	-	B	32x20x20	50	2.400	0,080	0,0004	32	20	20	30	16,5	16,5	29	46	20	16	16	75	35	58
03NTR322025	16V6415	D	32x20x25	40	1.920	0,102	0,0004	32	20	25	30	16,5	21	29	46	20	16	17	75	35	58
03NTR322032	16V6414	A	32x20x32	40	1.920	0,072	0,0004	32	20	32	30	16,5	30	29	46	20	16	20	75	35	58
03NTR322525	-	B	32x25x25	50	2.400	0,079	0,0004	32	25	25	30	21	21	35	46	20	17	17	75	35	58
03NTR322532	16V6416	A	32x25x32	40	1.920	0,074	0,0004	32	25	32	30	21	30	35	46	20	17	20	75	35	58
03NTR323225	16V6417	C	32x32x25	40	1.920	0,090	0,0004	32	32	25	30	30	21	46	46	20	20	17	75	38	61
03NTR402040	16V6418	A	40x20x40	20	1.760	0,085	0,0004	40	20	40	36	16,5	36	33	53	24	16	24	74	39	66
03NTR402540	16V6419	A	40x25x40	20	1.760	0,085	0,0004	40	25	40	36	21	36	33	53	24	20	24	74	39	66
03NTR403240	16V6419A	A	40x32x40	18	1.584	0,131	0,0005	40	32	40	35	30	35	54	54	22	20	22	87	43	70



## REDUCED TEE



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16-20-16 ÷ ø315-160-315 mm**

Notes: **Type E - Segmented fitting - Male/Male (SDR11)  
for butt welding or electrofusion welding**

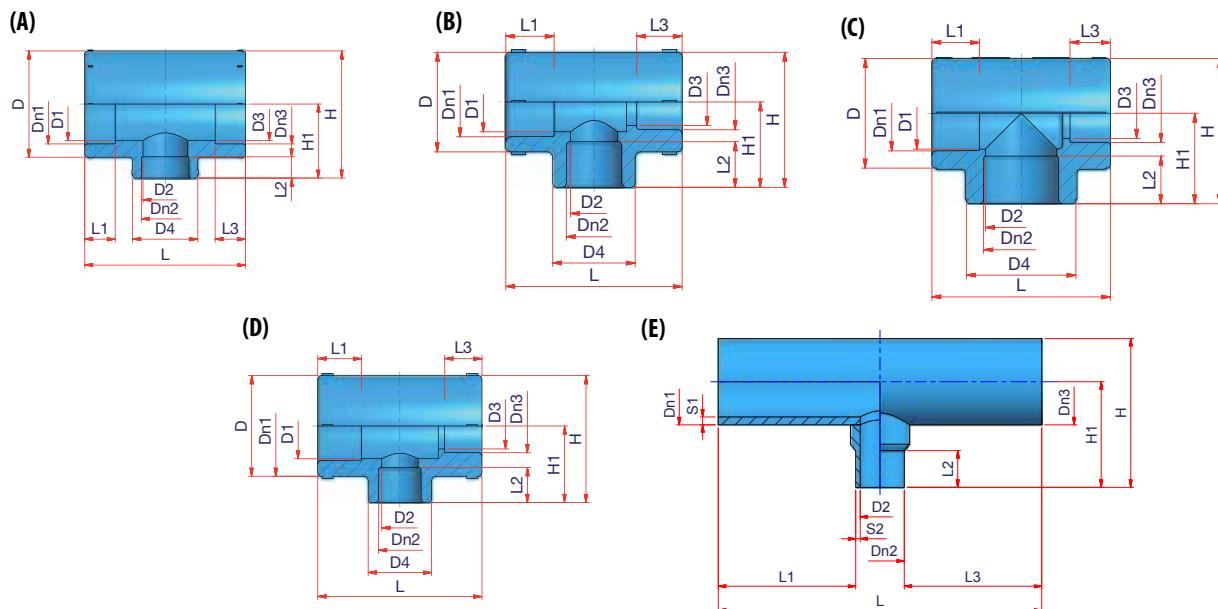


FIG. 216D

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	Dn3	D1	D2	D3	D4	D	L1	L2	L3	L	H1	H
03NTR502050	16V6420	A	50x20x50	12	1.056	0,158	0,0006	50	20	50	47	16,5	47	43	66	26	16	26	87	47	80
03NTR502550	16V6421	A	50x25x50	10	880	0,160	0,0008	50	25	50	47	21	47	43	66	26	20	26	87	47	80
03NTR503250	16V6422	A	50x32x50	10	880	0,150	0,0008	50	32	50	47	30	47	43	66	26	20	26	87	47	80
03NTR504050	16V6423	A	50x40x50	8	704	0,225	0,0010	50	40	50	43	36	43	66	66	23	22	23	102	50	83
03NTR632563	16V6424A	A	63x25x63	6	528	0,280	0,0014	63	25	63	60	21	60	53	83	30	21	30	102	54	96
03NTR633263	16V6424	A	63x32x63	6	528	0,283	0,0014	63	32	63	60	30	60	53	83	30	21	30	102	54	96
03NTR634063	16V6425	A	63x40x63	6	528	0,275	0,0014	63	40	63	60	36	60	53	83	30	23	30	102	54	96
03NTR635063	16V6426	A	63x50x63	6	528	0,350	0,0014	63	50	63	50	46	50	80	80	25	26	25	122	64	104
03NTR753275	-	A	75x32x75	6	288	0,633	0,0028	75	32	75	60	22	60	43	98	30	18	30	139	67	116
03NTR754075	-	A	75x40x75	5	240	0,590	0,0034	75	40	75	60	36	60	65	98	30	23	30	139	69	118
03NTR755075	-	A	75x50x75	5	240	0,600	0,0034	75	50	75	60	46	60	65	98	30	24	30	139	69	118
03NTR756375	-	A	75x63x75	5	240	0,610	0,0034	75	63	75	72	59	72	99	99	45	29	45	172	86	135,5
03NTR906390	-	A	90x63x90	4	192	0,800	0,0042	90	63	90	78	50	78	85	120	33	27	33	160	73	133
03NTR907590	-	A	90x75x90	4	192	0,863	0,0042	90	75	90	87	71	87	114	114	37	33	37	167	83	140
03NTR11063110	-	A	110x63x110	2	96	1,300	0,0084	110	63	110	100	59	100	86	146	43	33	43	200	100	173
03NTR11075110	-	A	110x75x110	2	96	1,625	0,0084	110	75	110	100	69	100	101	146	43	33	43	200	100	173
03NTR11090110	-	A	110x90x110	2	96	1,650	0,0084	110	90	110	100	85	100	119	146	43	37	43	200	100	173
03NTR12575125	-	A	125x75x125	1	48	2,500	0,0168	125	75	125	113	69	113	101	165	47,5	33	47,5	250	115	197,5




## REDUCED TEE

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 16-20-16 \div \varnothing 315-160-315$  mm**

Notes: **Type E - Fabricated fitting - Male/Male (SDR11)  
for butt welding or electrofusion welding**

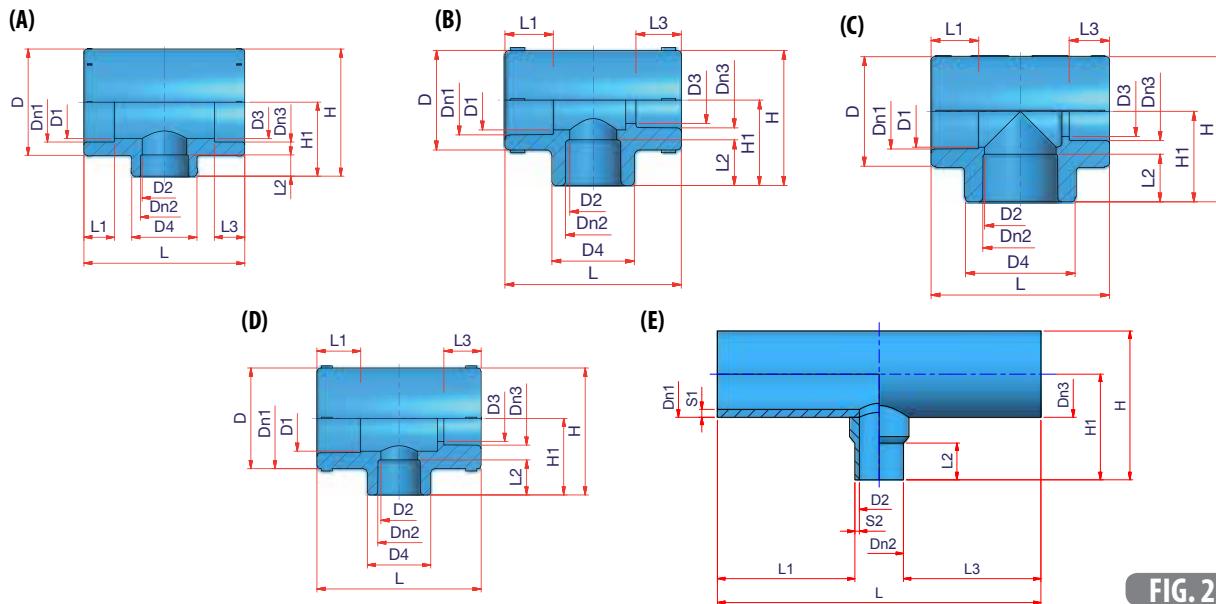

**FIG. 216D**

NIRON Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	D <sub>n1</sub>	D <sub>n2</sub>	D <sub>n3</sub>	S <sub>1</sub>	S <sub>2</sub>	D <sub>1</sub>	D <sub>2</sub>	D <sub>3</sub>	D <sub>4</sub>	D	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	L	H <sub>1</sub>	H
03NTR12590125	A	125x90x125	1	48	2,700	0,0168	125	90	125	113	85	113	122	165	47,5	37	47,5	250	115	197,5	115	197,5
03NTR125110125	A	125x110x125	1	48	2,600	0,0168	125	110	125	113	100	113	146	165	47,5	43	47,5	250	120	202,5	120	202,6
03NTR16075160	E	160x75x160	1	-	-	-	160	75	160	14,6	6,8	-	59,8	-	-	-	187,5	82	187,5	450	185	265
03NTR16090160	E	160x90x160	9	36	4,766	0,0240	160	90	160	14,6	8,2	-	73,6	-	-	-	180	78	180	450	189	269
03NTR160110160	E	160x110x160	9	36	4,977	0,0240	160	110	160	14,6	10	-	90	-	-	-	170	82	170	450	195	275
03NTR160125160	E	160x125x160	1	-	-	-	160	125	160	14,6	11,4	-	102,2	-	-	-	162,5	100	162,5	450	223	303
03NTR20075200	E	200x75x200	1	-	-	-	200	75	200	18,2	6,8	-	59,8	-	-	-	235,5	82	235,5	550	205	305
03NTR20090200	E	200x90x200	1	-	3,900	-	200	90	200	18,2	8,2	-	73,6	-	-	-	230	78	230	550	209	309
03NTR200110200	E	200x110x200	1	-	4,500	-	200	110	200	18,2	10	-	90	-	-	-	245	82	245	600	215	315
03NTR200125200	E	200x125x200	1	-	-	-	200	125	200	18,2	11,4	-	102,2	-	-	-	237,5	100	237,5	600	243	343
03NTR200160200	E	200x160x200	1	-	-	-	200	160	200	18,2	14,6	-	130,8	-	-	-	220	97	220	600	235	335
03NTR25075250	E	250x75x250	1	-	-	-	250	75	250	22,7	6,8	-	59,8	-	-	-	262,5	82	262,5	600	230	355
03NTR25090250	E	250x90x250	1	-	-	-	250	90	250	22,7	8,2	-	73,6	-	-	-	255	78	255	600	234	359
03NTR250110250	E	250x110x250	1	-	-	-	250	110	250	22,7	10	-	90	-	-	-	245	82	245	600	240	365
03NTR250125250	E	250x125x250	1	-	-	-	250	125	250	22,7	11,4	-	102,2	-	-	-	237,5	100	237,5	600	268	393
03NTR250160250	E	250x160x250	1	-	-	-	250	160	250	22,7	14,6	-	130,8	-	-	-	220	97	220	600	260	385
03NTR31575315	E	315x75x315	1	-	-	-	315	75	315	28,6	6,8	-	59,8	-	-	-	362,5	82	362,5	800	262,5	420
03NTR31590315	E	315x90x315	1	-	-	-	315	90	315	28,6	8,2	-	73,6	-	-	-	355	78	355	800	266,5	424
03NTR315110315	E	315x110x315	1	-	-	-	315	110	315	28,6	10	-	90	-	-	-	345	82	345	800	272,5	430
03NTR315125315	E	315x125x315	1	-	-	-	315	125	315	28,6	11,4	-	102,2	-	-	-	337,5	100	337,5	800	300,5	458,
03NTR315160315	E	315x160x315	1	-	-	-	315	160	315	28,6	14,6	-	130,8	-	-	-	320	97	320	800	292,5	470



## REDUCED FLANGED TEE




Material: **PPR - Aluminium**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø160-75-160 ÷ ø315-125-315 mm**

Notes: **Fabricated flanged (\*) fitting - Male/Male (SDR11)  
for butt welding or electrofusion welding**

(\*) **Aluminium flange 00FLAALPV (EN 1092)**

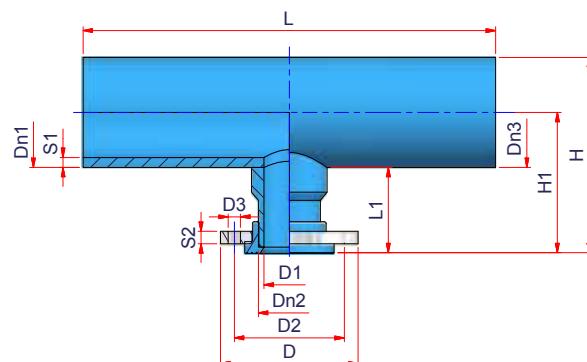

**FIG. 216E**

NIRON Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	Dn3	S1	D1	D2	D3	Holes	Screws	D	S2	L1	L	H1	H
03NTFLA16075160	160x75x160	1	-	-	-	160	75	160	14,6	59,8	145	18	4	M16	185	20	117	450	197	277
03NTFLA16090160	160x90x160	1	-	-	-	160	90	160	14,6	73,6	160	18	8	M16	200	22	118	450	198	278
03NTFLA160110160	160x110x160	1	-	-	-	160	110	160	14,6	90,0	180	18	8	M16	220	22	129	450	209	289
03NTFLA160125160	160x125x160	1	-	-	-	160	125	160	14,6	102,2	190	18	8	M16	230	22	158	450	238	318
03NTFLA20075200	200x75x200	1	-	-	-	200	75	200	18,2	59,8	145	18	4	M16	185	20	117	550	217	317
03NTFLA20090200	200x90x200	1	-	-	-	200	90	200	18,2	73,6	160	18	8	M16	200	22	118	550	218	318
03NTFLA200110200	200x110x200	1	-	-	-	200	110	200	18,2	90,0	180	18	8	M16	220	22	129	600	229	329
03NTFLA200125200	200x125x200	1	-	-	-	200	125	200	18,2	102,2	190	18	8	M16	230	22	158	600	258	358
03NTFLA25075250	250x75x250	1	-	-	-	250	75	250	22,7	59,8	145	18	4	M16	185	20	117	600	242	367
03NTFLA25090250	250x90x250	1	-	-	-	250	90	250	22,7	73,6	160	18	8	M16	200	22	118	600	243	368
03NTFLA250110250	250x110x250	1	-	-	-	250	110	250	22,7	90,0	180	18	8	M16	220	22	129	600	254	378
03NTFLA250125250	250x125x250	1	-	-	-	250	125	250	22,7	102,2	190	18	8	M16	230	22	158	600	283	408
03NTR31575315	315x75x315	1	-	-	-	315	75	315	28,6	59,8	145	18	4	M16	185	20	117	800	274	432
03NTR31590315	315x90x315	1	-	-	-	315	90	315	28,6	73,6	160	18	8	M16	200	22	118	800	275	433
03NTR315110315	315x110x315	1	-	-	-	315	110	315	28,6	90,0	180	18	8	M16	220	22	129	800	286	444
03NTR315125315	315x125x315	1	-	-	-	315	125	315	28,6	102,2	190	18	8	M16	230	22	158	800	315	473




## REDUCED CROSS



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 40-20-20-40 \div \varnothing 40-25-25-40$  mm**

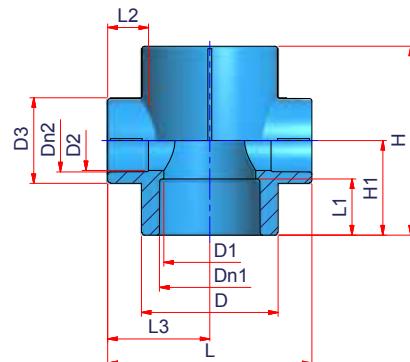

**FIG. 217**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p.	Volume $m^3/p.$	Dn1	Dn2	D1	D2	D3	D	L1	L2	L3	L	H1	H
03NCR402020	16V7520	<b>40-20-20-40</b>	16	1.536	0,098	0,0006	40	20	36	16,5	33	53	22	16	37	74	40	80
03NCR402525	16V7525	<b>40-25-25-40</b>	16	1.536	0,088	0,0006	40	25	36	23,5	33	53	22	16	37	74	40	80




## ELBOW THREE OUTLETS



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20 mm**

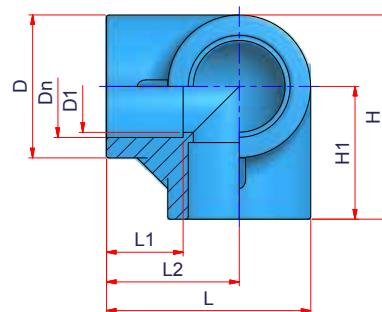

**FIG. 218**

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	D	L1	L2	L	H1	H
03NCTV20	16V6222	20	150	7.200	0,021	0,0001	20	18	28	15	26	40	26	40




## REDUCING SOCKET F/F

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20-16 \div \varnothing 160-125 \text{ mm}$**

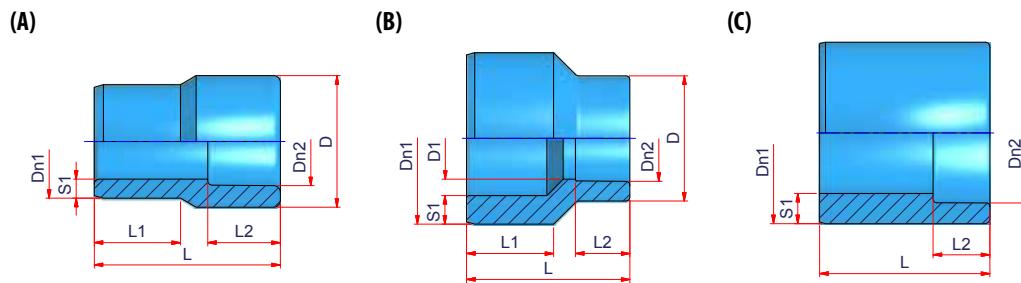

**FIG. 219**

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn1	S1	Dn2	D1	D	L1	L2	L
03NR2016	16V6501	A	20-16	150	13.200	0,009	0,0001	20	3,4	16	-	24	16	18	37
03NR2516	16V6502	A	25-16	100	9.600	0,015	0,0001	25	4,2	16	-	26	19	18	39
03NR2520	16V6503	A	25-20	100	8.800	0,015	0,0001	25	4,2	20	-	29	19	16	41
03NR3220	16V6504	B	32-20	80	7.040	0,019	0,0001	32	5,4	20	16	29	20	16	45
03NR3225	16V6505	A	32-25	80	7.040	0,023	0,0001	32	5,4	25	-	35	22	17	44
03NR4020	16V6506	B	40-20	70	6.160	0,031	0,0001	40	6,7	20	16	29	25	16	45
03NR4025	16V6507	B	40-25	60	5.280	0,030	0,0001	40	6,7	25	21	35	25	17	45
03NR4032	16V6508	A	40-32	40	3.520	0,043	0,0002	40	6,7	32	-	46	25	20	50
03NR5020	16V6509	B	50-20	50	4.400	0,049	0,0002	50	8,3	20	16	29	28	16	53
03NR5025	16V6510	B	50-25	40	3.520	0,050	0,0002	50	8,3	25	21	35	28	17	53
03NR5032	16V6511	B	50-32	35	3.080	0,056	0,0002	50	8,3	32	30	46	28	20	53
03NR5040	16V6512	A	50-40	30	2.640	0,067	0,0003	50	8,3	40	-	56	28	22	55
03NR6325	16V6513	B	63-25	20	1.760	0,080	0,0004	63	10,5	25	21	35	32	17	60
03NR6332	16V6514	B	63-32	20	1.760	0,093	0,0005	63	10,5	32	30	46	32	20	60
03NR6340	16V6515	B	63-40	20	1.760	0,098	0,0004	63	10,5	40	37	56	32	22	60
03NR6350	16V6516	A	63-50	20	1.760	0,120	0,0004	63	10,5	50	-	70	32	25	54
03NR7520	-	B	75-20	16	1.536	0,130	0,0006	75	12,5	20	20	26,5	35	5	62
03NR7525	-	B	75-25	16	1.408	0,130	0,0005	75	12,5	25	25	33	34	9	62
03NR7532	-	B	75-32	16	1.408	0,130	0,0005	75	12,5	32	32	43	35	12	62
03NR7540	-	B	75-40	16	1.408	0,130	0,0006	75	12,5	40	40	43	35	25	62
03NR7550	-	B	75-50	16	1.408	0,125	0,0005	75	12,5	50	50	66	34	20	59
03NR7563	-	A	75-63	10	880	0,190	0,0008	75	12,5	63	-	83	36	29	74
03NR9063	-	C	90-63	6	528	0,333	0,0014	90	15	63	-	-	-	29	81



## REDUCING SOCKET F/F




Material: **PPR**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20-16 ÷ ø160-125 mm**

(A)

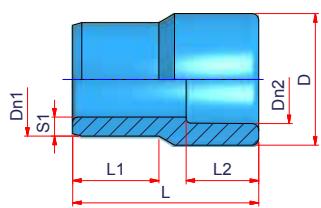

(B)



(C)




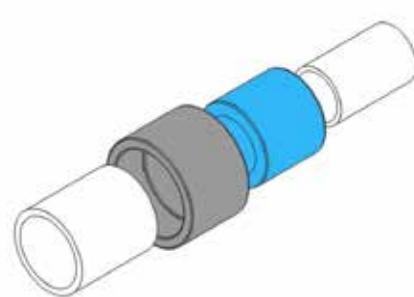


FIG. 219

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	S1	Dn2	D1	D	L1	L2	L
03NR9075	-	A	<b>90-75</b>	18	864	0,230	0,0009	90	15	75	-	96	37	34	80
03NR11063	-	B	<b>110-63</b>	12	576	0,358	0,0014	110	18,3	63	59	88	46	29	80
03NR11075	-	B	<b>110-75</b>	9	432	0,389	0,0019	110	18,3	75	69	101	46	33	80
03NR11090	-	A	<b>110-90</b>	6	528	0,250	0,0014	110	18,3	90	-	114,5	37	37	77
03NR12590	-	C	<b>125-90</b>	2	176	0,750	0,0014	125	20,8	90	-	-	-	37	104
03NR125110	-	A	<b>125-110</b>	6	288	0,683	0,0028	125	20,8	110	-	151	35	40	92
03NR160110	-	C	<b>160-110</b>	1	88	1,500	0,0083	160	26,6	110	-	-	-	43	143
03NR160125	-	C	<b>160-125</b>	1	88	1,500	0,0083	160	26,6	125	-	-	-	50	150

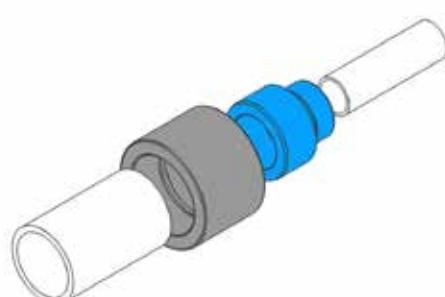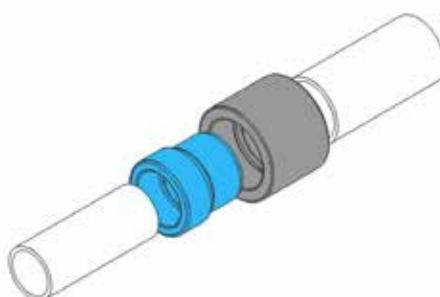

## REDUCER MALE/MALE (SDR11)


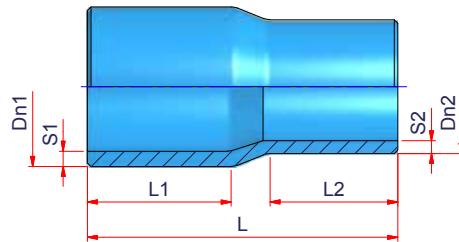


FIG. 219A

NIRON Code	POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	S1	Dn2	S2	L1	L2	L
03NRMM7540	-	75/40	16	768	0,163	0,0011	75	68	40	3,7	65	48	143
03NRMM7550	-	75/50	16	768	0,175	0,0011	75	6,8	50	4,6	65	48	141
03NRMM7563	-	75/63	12	576	0,225	0,0014	75	6,8	63	5,8	71	64	150
03NRMM9050	-	90/50	12	576	0,250	0,0014	90	8,2	50	4,6	73	57	152
03NRMM9063	-	90/63	12	576	0,260	0,0015	90	8,2	63	5,8	71	57	150
03NRMM9075	-	90/75	9	432	0,333	0,0019	90	8,2	75	6,8	81	72	175
03NRMM11063	-	110/63	6	288	0,426	0,0029	110	10	63	5,8	85	70	175
03NRMM11075	-	110/75	6	288	0,470	0,0029	110	10	75	6,8	88	58	185
03NRMM11090	-	110/90	6	288	0,473	0,0029	110	10	90	8,2	78	70	175
03NRMM12575	-	125/75	3	144	0,650	0,0059	125	11,4	75	6,8	92	60	199
03NRMM12590	-	125/90	4	192	0,615	0,0042	125	11,4	90	8,2	86	70	186
03NRMM125110	-	125/110	4	156	0,690	0,0050	125	11,4	110	10	89	77	187
03NRMM16090	-	160/90	1	1	-	-	160	14,6	90	8,2	108	90	230
03NRMM160110	-	160/110	1	1	-	-	160	14,6	110	10	103	88	315
03NRMM160125	-	160/125	1	1	-	-	160	14,6	125	11,4	102	91	214
03NRMM200160	-	200/160	22	88	2,182	0,0098	200	18,2	160	14,5	118	101	240
03NRMM250200	-	250/200	1	1	-	-	250	22,7	200	18,2	130	115	280
03NRMM315250	-	315/250	1	1	-	-	315	28,6	250	22,7	152	131	305

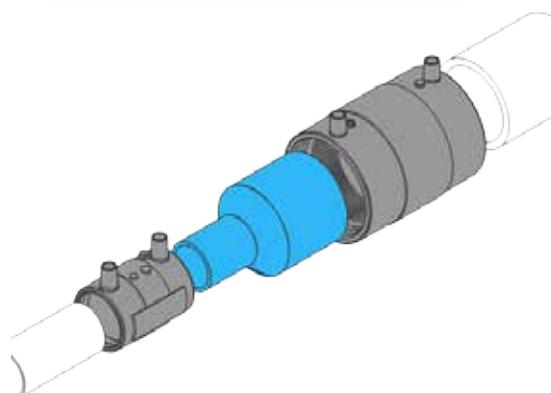


## SOCKET

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 16 \div \varnothing 125\text{ mm}$**

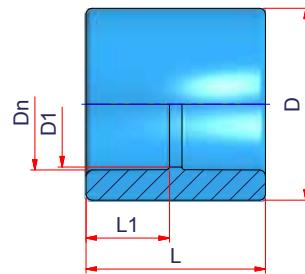


**FIG. 219B**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	D	L1	L
03NMAN16	16V6101	16	150	13.200	0,011	0,0001	16	15	24,5	16	34
03NMAN20	16V6102	20	300	14.400	0,014	0,0001	20	18	29	17	35
03NMAN25	16V6103	25	150	7.200	0,020	0,0001	25	20	35	18	39
03NMAN32	16V6104	32	40	3.520	0,041	0,0002	32	30	46	20	43
03NMAN40	16V6105	40	50	2.400	0,062	0,0003	40	37	56	22	48
03NMAN50	16V6106	50	20	1.760	0,110	0,0004	50	47	70	25	54
03NMAN63	16V6107	63	10	880	0,190	0,0008	63	60	88	29	62
03NMAN75	-	75	6	528	0,283	0,0014	75	70	101	33	71
03NMAN90	-	90	10	480	0,310	0,0017	90	87,5	114,5	37	77
03NMAN110	-	110	4	192	0,825	0,0042	110	106	151	43	92
03NMAN125	-	125	4	192	0,900	0,0042	125	117	160	47,5	102




(A)

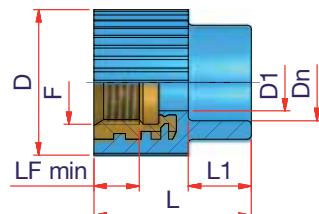

## PIPE UNION FEMALE THREADED

Material: **PPR - Brass**Standards: **DIN 16962 - UNI EN ISO 15874**Range:  **$\varnothing 16 \times 1/2'' \div \varnothing 125 \times 4'' \text{ mm}$** 

(B)

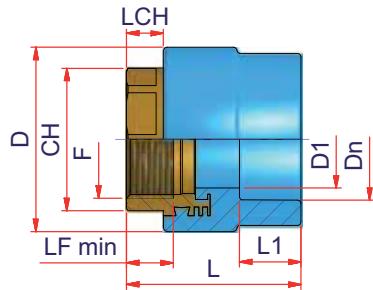

(C)


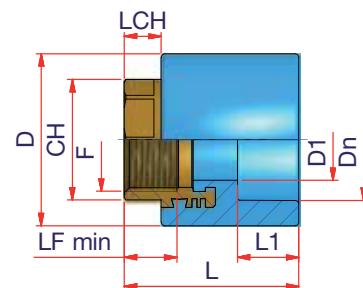


FIG. 219C

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	F	LF min	D1	D	L1	L	CH	LCH
03NFFF1612	16V6811	A	16 x 1/2"	70	6.160	0,071	0,0001	16	1/2"	11,5	14,1	37	15	40	-	-
03NFFF2012	16V6812	A	20 x 1/2"	70	6.160	0,063	0,0001	20	1/2"	11,5	14,1	37	16	40	-	-
03NFFF2034	16V6813	A	20 x 3/4"	60	5.280	0,103	0,0001	20	3/4"	13,2	18	43	20,5	46	-	-
03NFFF2512	16V6813A	A	25 x 1/2"	70	6.160	0,064	0,0001	25	1/2"	11,5	14,1	37	17	41	-	-
03NFFF2534	16V6814	A	25 x 3/4"	60	5.280	0,097	0,0001	25	3/4"	13,2	18	42	18	46	-	-
03NFFF3234	16V6815A	A	32 x 3/4"	40	3.520	0,118	0,0002	32	3/4"	13,2	18	45,5	21,5	51,5	-	-
03NFFF321	16V6815	A	32 x 1"	30	2.640	0,173	0,0002	32	1"	18	24	54	20	52	-	-
03NFFF401	-	C	40 x 1"	32	2.816	0,218	0,0002	40	1"	18	24	56	22	67	38	15
03NFFF4014	16V6816	B	40 x 1 1/4"	20	1.760	0,290	0,0004	40	1 1/4"	21,4	33	66	22	69	46	15
03NFFF5014	-	C	50 x 1 1/4"	18	1.584	0,319	0,0004	50	1 1/4"	21,4	33	70	25	71	46	15
03NFFF5012	16V6817	B	50 x 1 1/2"	18	1.584	0,411	0,0004	50	1 1/2"	19	39,5	75	25	72	55	15
03NFFF6312	-	C	63 x 1 1/2"	10	880	0,495	0,0008	63	1 1/2"	19	39,5	88	29	71	55	15
03NFFF632	-	B	63 x 2"	9	792	0,578	0,0009	63	2"	23,7	50	92	29	80	65	20
03NFFF752	-	C	75 x 2"	4	352	0,688	0,0021	75	2"	23,7	50	103	33	84	65	20
03NFFF75212	-	B	75 x 2 1/2"	4	384	0,813	0,0022	75	2 1/2"	30,2	63,5	110	33	89	80	20
03NFFF903	-	B	90 x 3"	4	352	1,288	0,0021	90	3"	33,3	75	129	37	99	95	23
03NFFF1104	-	B	110 x 4"	1	88	2,100	0,0083	110	4"	39,3	99,5	160	43	111	120	30
03NFFF1254	-	C	125 x 4"	1	96	2,150	0,0089	125	4"	39,3	99,5	160	47,5	115,5	120	30



(A)

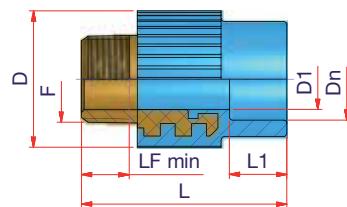


## PIPE UNION MALE THREADED

Material: **PPR - Brass**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø16x1/2" ÷ ø125x4" mm**

(B)

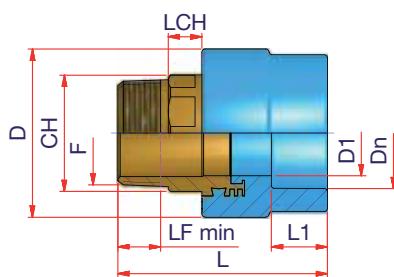

(C)

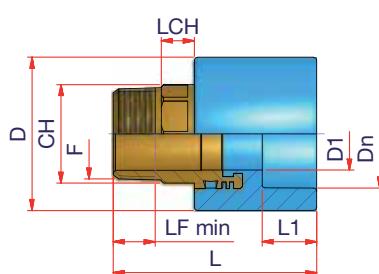

**FIG. 219D**

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	F	LF min	D1	D	L1	L	CH	LCH
03NRFM1612	16V6821	A	16 x 1/2"	70	6.160	0,099	0,0001	16	1/2"	13,2	14,1	37	15	55	-	-
03NRFM2012	16V6822	A	20 x 1/2"	70	6.160	0,096	0,0001	20	1/2"	13,2	14,1	37	16	55	-	-
03NRFM2034	16V6823	A	20 x 3/4"	50	4.400	0,159	0,0002	20	3/4"	14,5	18	43	20,5	63	-	-
03NRFM2512	16V6823A	A	25 x 1/2"	70	6.160	0,097	0,0001	25	1/2"	13,2	14,1	37	17	56	-	-
03NRFM2534	16V6824	A	25 x 3/4"	50	4.400	0,140	0,0002	25	3/4"	14,5	18	42	17,5	62	-	-
03NRFM3234	16V6825A	A	32 x 3/4"	40	3.520	0,159	0,0002	32	3/4"	14,5	18	45,5	20	68,5	-	-
03NRFM321	16V6825	A	32 x 1"	26	2.288	0,287	0,0003	32	1"	16,8	24	54	20	71	-	-
03NRFM401	-	C	40 x 1"	20	1.760	0,295	0,0004	40	1"	16,8	24	56	22	86	34	13
03NRFM40114	16V6826	B	40 x 1 1/4"	15	1.320	0,380	0,0006	40	1 1/4"	19,1	33	65	22	91	42	15
03NRFM50114	-	C	50 x 1 1/4"	15	1.320	0,413	0,0006	50	1 1/4"	19,1	33	70	25	93	42	15
03NRFM50112	16V6827	B	50 x 1 1/2"	10	880	0,500	0,0008	50	1 1/2"	19,1	33	70	25	93	42	15
03NRFM63112	-	C	63 x 1 1/2"	6	528	0,592	0,0014	63	1 1/2"	19,1	38	88	29	97,5	50	15
03NRFM632	16V6828	B	63 x 2"	6	528	0,783	0,0014	63	2"	23,4	49,5	92	29	105	60	18
03NRFM752	-	C	75 x 2"	5	440	0,870	0,0017	75	2"	23,4	49,5	103	33	109	60	18
03NRFM75212	-	B	75 x 2 1/2"	4	352	1,413	0,0021	75	2 1/2"	26,7	63,5	110	33	112	80	20
03NRFM903	-	B	90 x 3"	2	176	1,850	0,0041	90	3"	29,8	75	129	37	129	90	23
03NRFM1104	-	B	110 x 4"	1	88	3,100	0,0045	110	4"	35,8	99,5	160	43	148	115	30
03NRFM1254	-	C	125 x 4"	2	96	3,025	0,0084	125	4"	35,8	99,5	160	47,5	152,5	115	30




## SADDLE FEMALE THREADED



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 40/25 \times 1/2'' \div \varnothing 110/32 \times 1'' \text{ mm}$**

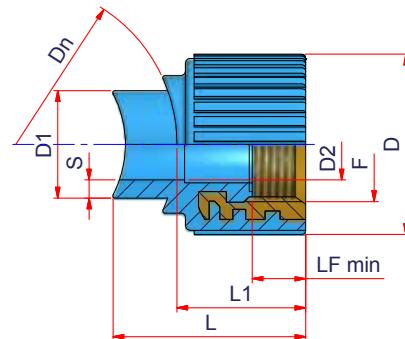

**FIG. 219E**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	$D_n$	$S$	$F$	$LF\ min$	$D_1$	$D_2$	$D$	$L_1$	$L$
03NGSF4012	-	<b>40/25 x 1/2"</b>	70	6.160	0,073	0,0001	40	4,2	1/2"	11,5	25	14,1	36	28	39,5
03NGSF5012	-	<b>50/25 x 1/2"</b>	70	6.720	0,073	0,0001	50	4,2	1/2"	11,5	25	14,1	36	28	39,5
03NGSF6312	16V6901	<b>63/25 x 1/2"</b>	70	6.160	0,064	0,0001	63	4,2	1/2"	11,5	25	14,1	37	30	46,5
03NGSF7512	-	<b>75/25 x 1/2"</b>	70	6.160	0,063	0,0001	75	4,2	1/2"	11,5	25	14,1	37	30	45
03NGSF9012	-	<b>90/25 x 1/2"</b>	70	3.360	0,064	0,0002	90	4,2	1/2"	11,5	25	14,1	37	30	46,7
03NGSF11012	-	<b>110/25 x 1/2"</b>	70	6.160	0,060	0,0001	110	4,2	1/2"	11,5	25	14,1	37	30	49,3
03NGSF5034	-	<b>50/25 x 3/4"</b>	60	5.280	0,116	0,0001	50	4,2	3/4"	13,2	25	16,6	43,5	41,5	52
03NGSF6334	16V6902	<b>63/25 x 3/4"</b>	50	4.400	0,095	0,0001	63	4,2	3/4"	13,2	25	16,6	42	30	46,5
03NGSF7534	-	<b>75/25 x 3/4"</b>	70	6.160	0,094	0,0001	75	4,2	3/4"	13,2	25	16,6	42	30	45
03NGSF9034	-	<b>90/25 x 3/4"</b>	70	6.720	0,095	0,0001	90	4,2	3/4"	13,2	25	16,6	42	30	46,7
03NGSF11034	-	<b>110/25 x 3/4"</b>	50	4.400	0,096	0,0002	110	4,2	3/4"	13,2	25	16,6	42	30	49,7
03NGSF631	-	<b>63/32 x 1"</b>	30	2.640	0,168	0,0003	63	5,4	1"	18	32	21,2	54	37	57,3
03NGSF751	-	<b>75/32 x 1"</b>	30	2.640	0,167	0,0003	75	5,4	1"	18	32	21,2	54	37	54,3
03NGSF901	-	<b>90/32 x 1"</b>	30	2.640	0,165	0,0003	90	5,4	1"	18	32	21,2	54	37	55,4
03NGSF1101	-	<b>110/32 x 1"</b>	30	2.640	0,166	0,0003	110	5,4	1"	18	32	21,2	54	37	57,7




## WELDING SADDLE

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  $\varnothing 50/25 \times 20 \div \varnothing 160/63 \times 63 \text{ mm}$


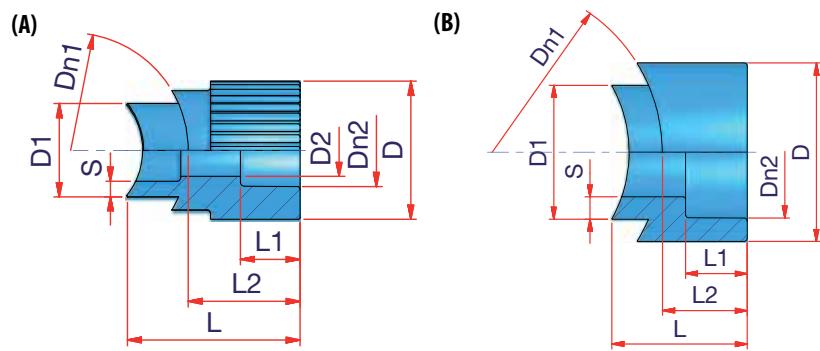


**FIG. 219F**



NIRON Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p	Dn1	Dn2	S	D1	D2	D	L1	L2	L
03NGS5020	A	<b>50/25x20</b>	70	6.720	0,026	0,0001	50	20	4,7	25	15,6	37,6	16	30	40
03NGS5025	A	<b>50/25x25</b>	80	7.040	0,026	0,0001	50	25	4,7	25	15,6	37	14,5	30	39,5
03NGS6320	A	<b>63/25x20</b>	70	6.720	0,027	0,0001	63	20	4,2	25	14,1	37	16	30	46,5
03NGS6325	A	<b>63/25x25</b>	70	6.160	0,024	0,0001	63	25	4,2	25	14,1	37	17	30	46,5
03NGS6332	A	<b>63/32x32</b>	40	3.520	0,062	0,0002	63	32	5,4	32	21	54	20	37	57
03NGS7520	A	<b>75/25x20</b>	70	6.720	0,029	0,0001	75	20	4,2	25	14,1	37	16	30	45
03NGS7525	A	<b>75/25x25</b>	70	6.160	0,024	0,0001	75	25	4,2	25	14,1	37	17	30	45
03NGS7532	A	<b>75/32x32</b>	30	2.880	0,067	0,0003	75	32	5,4	32	24	54	20	37	54
03NGS9020	A	<b>90/25x20</b>	70	6.720	0,029	0,0001	90	20	4,2	25	14,1	37	16	30	46,7
03NGS9025	A	<b>90/25x25</b>	70	6.720	0,024	0,0001	90	25	4,2	25	14,1	37	17	30	46,7
03NGS9032	A	<b>90/32x32</b>	30	2.880	0,067	0,0003	90	32	5,4	32	24	54	20	37	55,4
03NGS11020	A	<b>110/25x20</b>	70	6.160	0,028	0,0001	110	20	4,2	25	14,1	37	16	30	49,3
03NGS11025	A	<b>110/25x25</b>	70	6.720	0,025	0,0001	110	25	4,2	25	14,1	37	17	30	49
03NGS11032	A	<b>110/32x32</b>	30	2.880	0,067	0,0003	110	32	5,4	32	24	54	20	37	57,7
03NGS12563	B	<b>125/63x63</b>	25	1.200	0,168	0,0006	125	63	10,5	63	-	84	29	58	58
03NGS16040	B	<b>160/40x40</b>	80	3.840	0,051	0,0008	160	40	6,7	40	-	52	22	34	53
03NGS16063	B	<b>160/63x63</b>	20	960	0,172	0,0008	160	63	10,5	63	-	84	29	40	63,5




(A)



(B)



(C)



## END CAP

Material: **PPR**Standards: **DIN 16962 - UNI EN ISO 15874**Range:  **$\varnothing 16 \div \varnothing 630 \text{ mm}$** Notes: **Type B - Male/Male fitting (SDR11) for butt welding or electrofusion welding**

FIG. 219G

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p}$	$D_n$	S	D	L1	L
03NCC16	16V6601	A	16	250	24.000	0,010	0,0003	16	2,7	23,5	13,5	24
03NCC20	16V6602	A	20	200	17.600	0,011	0,0004	20	3,4	30	17	29
03NCC25	16V6603	A	25	130	11.440	0,018	0,0001	25	4,2	35,5	18	34
03NCC32	16V6604	A	32	70	6.160	0,036	0,0001	32	5,4	45	20	40
03NCC40	16V6605	A	40	50	4.400	0,048	0,0002	40	6,7	54	22	42
03NCC50	16V6606	A	50	25	2.200	0,076	0,0003	50	8,3	66	25,5	48
03NCC63	16V6607	A	63	14	1.232	0,161	0,0006	63	10,5	83	34	56
03NCC75	-	A	75	8	704	0,250	0,0010	75	12,5	99	43	61
03NCC90	-	A	90	6	440	0,383	0,0014	90	15	119	34	68
03NCC110	-	A	110	4	352	0,663	0,0021	110	18,3	147	37	79
03NCC125	-	A	125	5	240	0,850	0,0034	125	20,8	162	40	87
03NCC160	-	B	160	16	192	1,197	0,0050	160	14,8	-	117	145
03NCC200	-	B	200	24	96	2,137	0,0090	200	19,6	-	145	175
03NCC250	-	C	250	1	-	-	-	250	22,7	-	-	80
03NCC315	-	C	315	1	-	-	-	315	28,6	-	-	80
03NCC355	-	C	355	1	-	-	-	355	32,2	-	-	80
03NCC400	-	C	400	1	-	-	-	400	36,3	-	-	80
03NCC450	-	C	450	1	-	-	-	450	40,9	-	-	100
03NCC500	-	C	500	1	-	-	-	500	45,4	-	-	100
03NCC560	-	C	560	1	-	-	-	560	50,8	-	-	100
03NCC630	-	C	630	1	-	-	-	630	57,2	-	-	100



## 5.2.2 VALVES



### EXTRACTABLE BALL VALVE

Material: **PPR - Brass - Aluminium**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

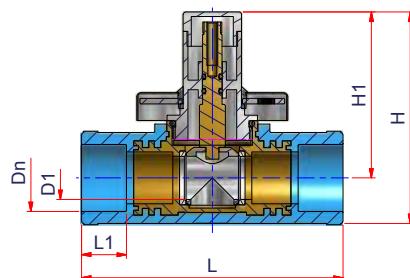


FIG. 221A

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p	Dn	D1	L1	L	H1	H
03NRS20	16V6720	20	10	880	0,460	0,0008	20	15	16	100,5	73	92
03NRS25	16V6721	25	10	880	0,455	0,0008	25	15	17	100,5	73	92
03NRS32	16V6722	32	10	960	0,590	0,0009	32	20	20	121	77	98



### CHROME PLATE FOR BALL VALVE

Material: **Chrome plated plastic**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

FIG. 221B

NIRON/POLYSYSTEM Code	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Notes
00RSRC	100	-	0,045	0,0002	for codes 03NRS20-03NRS25-03NRS32-16V6720-16V6721-16V6722



### SPARE BALL

Material: **Steel - Brass**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

FIG. 221C

NIRON/POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Notes
00RSRS2025	20-25	1	-	0,100	for codes 03NRS20-03NRS25-16V6720-16V6721
00RSRS32	32	1	-	0,200	for codes 03NRS32-16V6722



## EXTENSION



Material: **Steel - Brass**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

**FIG. 221D**

NIRON/POLYSYSTEM Code	L	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Notes
<b>00PROSF</b>	22 mm	20	-	0,080	0,0035	for codes 03NRS32-16V6722

## HANDLE FOR BALL VALVE



Material: **Steel - Brass**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

**FIG. 221E**

NIRON/POLYSYSTEM Code	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Notes
<b>00MAS</b>	10	-	0,127	0,0004	for codes 03NRS20-03NRS25-03NRS32-16V6720-16V6721-16V6722

## LEVER FOR BALL VALVE



Material: **Steel**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

**FIG. 221F**

NIRON/POLYSYSTEM Code	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Notes
<b>00LRS</b>	10	-	0,200	0,0004	for codes 03NRS20-03NRS25-03NRS32-16V6720-16V6721-16V6722




## 2-WAY BALL VALVE



Material: **PPR**

Standards: **DIN 16962**

Range: **ø20 ÷ ø110 mm**

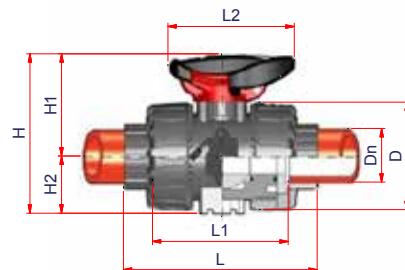

**FIG. 222**

NIRON/POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	Dn (PP)	PN	L2	L1	L	D	H1	H2	H
03NRSPVKD020	20	1	-	-	-	20	15	10	67	73	102	54	54	29	83
03NRSPVKD025	25	1	-	-	-	25	20	10	85	82	114	65	65	34,5	99,5
03NRSPVKD032	32	1	-	-	-	32	25	10	85	90	126	73	69,5	39	108,5
03NRSPVKD040	40	1	-	-	-	40	32	10	108	100	141	86	82,5	46	128,5
03NRSPVKD050	50	1	-	-	-	50	40	10	108	117	164	98	89	52	141
03NRSPVKD063	63	1	-	-	-	63	50	10	134	144	199	122	108	62	170
03NRSPVKD075	75	1	-	-	-	75	65	10	225	153	213	162	164	87	251
03NRSPVKD090	90	1	-	-	-	90	80	10	327	173	239	202	177	105	282
03NRSPVKD110	110	1	-	-	-	110	100	10	385	199	268	236	195	129	324




## PPR BALL VALVE FOR EXTERNAL USE



Material: **PPR - Metal**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 40 \text{ mm}$**



**FIG. 222A**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L2	L	H
<b>03NRSP20</b>	<b>16V6650</b>	<b>20</b>	1	-	-	-	20	16	84,5	73,5	74
<b>03NRSP25</b>	<b>16V6651</b>	<b>25</b>	1	-	-	-	25	17	84,5	77,5	74
<b>03NRSP32</b>	<b>16V6652</b>	<b>32</b>	1	-	-	-	32	20	108	89	92
<b>03NRSP40</b>	<b>16V6653</b>	<b>40</b>	1	-	-	-	40	22	108	97,5	105




## BUTTERFLY VALVE



Material: **PPR**

Standards: **DIN 16962**

Range:  **$\varnothing 50 \div \varnothing 225 \text{ mm}$**

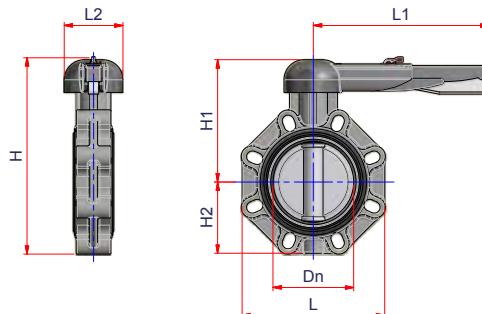

**FIG. 223**

NIRON/POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	Dn (PE)	PN	L1	L2	L	H1	H2	H	Nº Hole
03NVFK050112	50	1	-	-	-	50	40	10	175	100	132	137	60	197	4
03NVFK0632	63	1	-	-	-	63	50	10	175	100	147	143	70	213	4
03NVFK075212	75	1	-	-	-	75	65	10	272	110	165	164	80	244	4
03NVFK0903	90	1	-	-	-	90	80	10	272	110	185	178	93	271	8
03NVFK1104	110	1	-	-	-	110	100	10	272	110	211	192	107	299	8
03NVFK1606	160	1	-	-	-	160	150	10	330	110	268	225	134	359	8
03NVFK2002258	200-225	1	-	-	-	200-225	200	10	420	122	323	272	161	433	8




## COMPLETE STOP VALVE

Material: **PPR - Brass - Chrome plated plastic**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

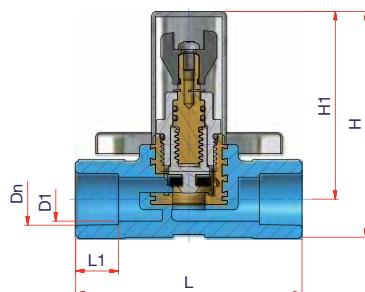

**FIG. 224**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	L1	L	H1	H
03NRA20	16V6702	20	10	880	0,180	0,0008	20	16,5	16	85	70,5	85
03NRA25	16V6703	25	10	880	0,310	0,0008	25	23,5	20	100	79	97



## STOP VALVE BODY



Material: **PPR - Brass**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

FIG. 224A

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$
03NCRA20	16V6706	20	20	1.920	0,105	0,0005
03NCRA25	16V6707	25	30	2.640	0,149	0,0003

## BOLT SPARE PART



Material: **Brass**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

FIG. 224B

NIRON / POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Notes
00VIT20	20	150	-	0,037	0,0001	for codes 03NRA20-16V6702
00VIT25	25	100	-	0,045	0,0001	for codes 03NRA25-16V6703



## CHROME PLATED BOLT



Material: **Chrome plated plastic**

Range: **ø20 ÷ ø25 mm**

**FIG. 224C**

NIRON / POLYSYSTEM Code	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Notes
00RARC	70	-	0,030	0,0002	for codes 03NRA20-03NRA25-03NRAPRO20-03NRAPRO25 16V6702-16V6703-16V6702P-16V6703P

## EXTENSION FOR STOP VALVE



Material: **Brass**

Range: **ø20 ÷ ø25 mm**

**FIG. 224D**

NIRON / POLYSYSTEM Code	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Notes
00PROVI	20	-	0,080	0,0004	for codes 03NRA20-03NRA25-03NRAPRO20-03NRAPRO25 16V6702-16V6703-16V6702P-16V6703P

## HANDLE FOR STOP VALVE



Material: **Brass - Metal**

Range: **ø20 ÷ ø25 mm**

**FIG. 224E**

NIRON / POLYSYSTEM Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Notes
00MAVI	25	10	-	0,065	0,0004	for codes 03NRA20-03NRA25-03NRAPRO20-03NRAPRO25 16V6702-16V6703-16V6702P-16V6703P




## EXTENDED STOP VALVE



Material: **PPR - Brass - Metal**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 25 \text{ mm}$**

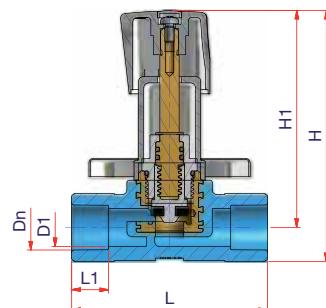

**FIG. 225**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	L1	L	H1	H
03NRAPRO20	16V6702P	20	10	960	0,210	0,0009	20	16,5	16	85	94	109
03NRAPRO25	16V6703P	25	10	880	0,350	0,0008	25	23,5	20	100	94	112


## INCLINED VALVE



Material: **PPR - Brass**

Standards: **DIN 16962**

Range:  **$\varnothing 20 \div \varnothing 32 \text{ mm}$**

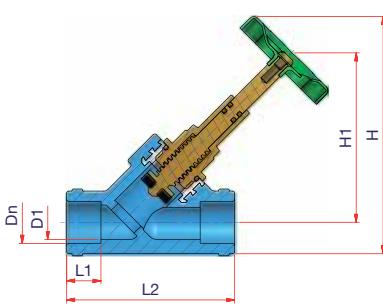

**FIG. 226**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	D1	L1	L2	L	H1	H
03NRAIN20	16V6726	20	15	1.320	0,200	0,0006	20	16,5	16	78	116	78	110
03NRAIN25	16V6727	25	10	960	0,320	0,0010	25	23,5	17	93	135	92	122
03NRAIN32	16V6728	32	6	528	0,560	0,0014	32	28	20	115	165	114	150



## 5.2.3 SPECIAL FITTINGS



### UNION THREE PIECES

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 40\text{ mm}$**

Notes: **Only for cold water**


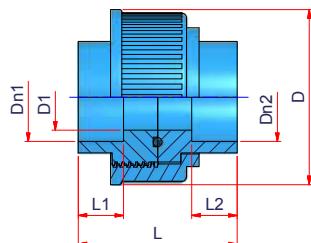


FIG. 230

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	D1	D	L1	L2	L
03NBRF20	16V6732	20	30	2.640	0,074	0,0003	20	20	14	53	20	20	73
03NBRF25	16V6733	25	26	2.288	0,088	0,0003	25	25	18	57	20	20	70
03NBRF32	16V6734	32	20	760	0,115	0,0004	32	32	24	67	20	20	70
03NBRF40	16V6735	40	18	1.584	0,147	0,0005	40	40	29	77	20	20	70

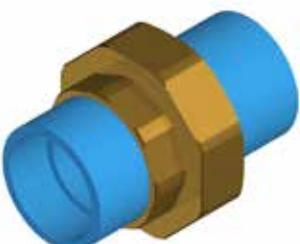

### SOCKET COUPLING F/F THREE PIECES

Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 63\text{ mm}$**

Notes: **Only for cold water**

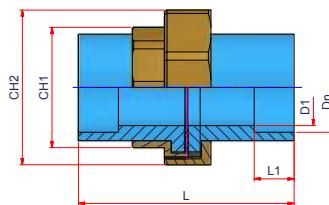


FIG. 231

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	D1	L1	L	CH1	CH2
03NCSJ2020	16V67320T	20-20	1	-	-	-	20-20	15	14	79	30	46
03NCSJ2525	16V67330T	25-25	1	-	-	-	25-25	19	16	85	38	52
03NCSJ3232	16V67340T	32-32	1	-	-	-	32-32	26	18	106	50	68
03NCSJ4040	16V67350T	40-40	1	-	-	-	40-40	33	22	120	54	80
03NCSJ5050	16V6735A0T	50-50	1	-	-	-	50-50	43	24	130	71	97
03NCSJ6363	16V6735B0T	63-63	1	-	-	-	63-63	52	28	153	80	109




## FLANGED STRAIGHT UNION



Material: **PPR - Brass**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 3/4" \div \varnothing 63 \times 2\frac{1}{2}" mm$**

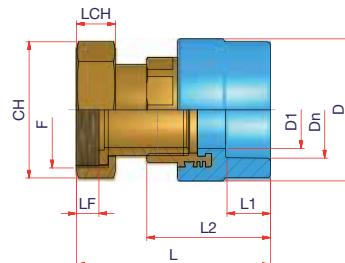

**FIG. 232**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $m^3/p.$	Dn	F	LF	D1	D	L1	L2	L	CH	LCH
03NBD2034	16V6740	20 x 3/4"	10	2.520	0,130	0,0004	20	3/4"	10,8	14,1	37	16	40	62	30	14
03NBD2534	16V6740A	25 x 3/4"	10	2.520	0,135	0,0004	25	3/4"	10,8	14,1	37	17	41	62	30	14
03NBD251	16V6741	25 x 1"	10	2.520	0,215	0,0004	25	1"	11,5	18	42	18	46	70,5	37	15
03NBD321	16V6741A	32 x 1"	5	1.260	0,240	0,0007	32	1"	11,5	18	45,5	21,5	51	76	37	15
03NBD32114	16V6742	32 x 1 1/4"	5	1.260	0,360	0,0007	32	1 1/4"	14	24	54,5	20	53	81	46	18
03NBD40114	-	40 x 1 1/4"	6	1.512	0,400	0,0005	40	1 1/4"	14	24	56	22	67	93	46	18
03NBD40112	16V6743	40 x 1 1/2"	4	1.008	0,550	0,0009	40	1 1/2"	14	33	66	22	69	98	52	18
03NBD50112	-	50 x 1 1/2"	3	756	0,870	0,0012	50	1 1/2"	14	33	70	25	56	101	52	18
03NBD502	16V6744	50 x 2"	3	756	0,870	0,0012	50	2"	17,5	39,5	76,5	25	72	107	64,5	24
03NBD632	-	63 x 2"	2	504	0,925	0,0017	63	2"	17,5	39,5	88	29	75	110	64,5	24
03NBD63212	16V6745	63 x 2 1/2"	2	504	1,350	0,0017	63	2 1/2"	21	50	93	29	81	135,5	81,5	25,5

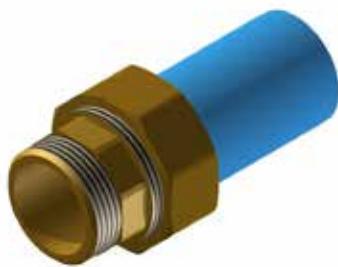


## MALE THREADED TRANSITION COUPLER THREE PIECES

Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1\frac{1}{2}'' \div \varnothing 63 \times 2''$  mm**

Notes: **Only for cold water**

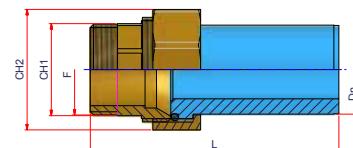

**FIG. 233A**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	F	L	CH1	CH2
03NTCMT20	16V6773FM	20 x $1\frac{1}{2}''$	1	-	-	-	20	$1\frac{1}{2}''$	90	22	29
03NTCMT25	16V6774FM	25 x $3\frac{1}{4}''$	1	-	-	-	25	$3\frac{1}{4}''$	98	26	38
03NTCMT32	16V6775FM	32 x 1"	1	-	-	-	25	1"	107	34	47
03NTCMT40	16V6776FM	40 x $1\frac{1}{4}''$	1	-	-	-	32	$1\frac{1}{4}''$	113	42	55
03NTCMT50	16V6777FM	50 x $1\frac{1}{2}''$	1	-	-	-	32	$1\frac{1}{2}''$	145	52	65
03NTCMT63	16V6778FM	63 x 2 "	1	-	-	-	63	2"	146	64	81




## FEMALE THREADED TRANSITION COUPLER THREE PIECES

Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 1\frac{1}{2}'' \div \varnothing 63 \times 2''$  mm**

Notes: **Only for cold water**

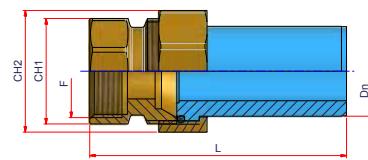

**FIG. 233B**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	F	L	CH1	CH2
03NTCFT20	16V6773FF	20 x $1\frac{1}{2}''$	1	-	-	-	20	$1\frac{1}{2}''$	89	24	30
03NTCFT25	16V6774FF	25 x $3\frac{1}{4}''$	1	-	-	-	25	$3\frac{1}{4}''$	89	32	38
03NTCFT32	16V6775FF	32 x 1"	1	-	-	-	25	1"	108	39	46
03NTCFT40	16V6776FF	40 x $1\frac{1}{4}''$	1	-	-	-	32	$1\frac{1}{4}''$	116	48	55
03NTCFT50	16V6777FF	50 x $1\frac{1}{2}''$	1	-	-	-	32	$1\frac{1}{2}''$	143	56	64
03NTCFT63	16V6778FF	63 x 2 "	1	-	-	-	63	2"	146	70	82



## FEMALE THREADED BRASS UNION



Material: **Brass**

Range:  $\varnothing 20 \times 1/2'' \div \varnothing 110 \times 4'' \text{ mm}$

Notes: **Only for cold water**

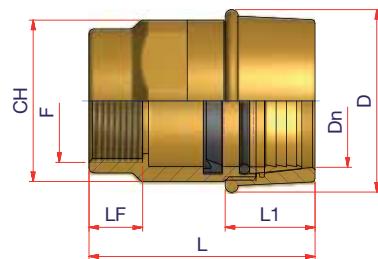


FIG. 234

NIRON Code	$\varnothing$	Pack.	Weight kg/p	Dn	F	LF	D	L1	L	CH
03BF2012	20 x 1/2"	1	0,160	20	1/2"	17	35	23	56	29
03BF2534	25 x 3/4"	1	0,240	25	3/4"	18	42	25	60	35
03BF321	32 x 1"	1	0,380	32	1"	21	50	25	69	43
03BF40114	40 x 1 1/4"	1	0,520	40	1 1/4"	21,4	58	26	72	52
03BF50112	50 x 1 1/2"	1	0,890	50	1 1/2"	19	71	35	88	63
03BF632	63 x 2"	1	1,280	63	2"	23,7	88	38	96	77
03BF75212	75 x 2 1/2"	1	1,680	75	2 1/2"	30,2	100	40	99	90
03BF903	90 x 3"	1	2,965	90	3"	33,3	120	42	120	109
03BF1104	110 x 4"	1	3,685	110	4"	39,3	142	43	125	129



‘

## MALE THREADED BRASS UNION



Material: **Brass**

Range:  $\varnothing 20 \times 1/2'' \div \varnothing 110 \times 4'' \text{ mm}$

Notes: **Only for cold water**

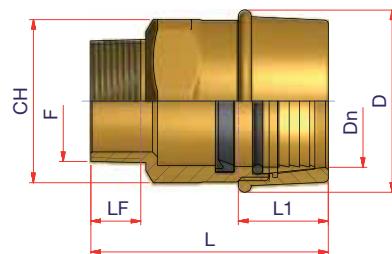


FIG. 234A

NIRON Code	$\varnothing$	Pack.	Weight kg/p	Dn	F	LF	D	L1	L	CH
03BM2012	<b>20 x 1/2"</b>	1	0,140	20	1/2"	13,2	35	23	56	29
03BM2534	<b>25 x 3/4"</b>	1	0,210	25	3/4"	14,5	42	25	61	35
03BM321	<b>32 x 1"</b>	1	0,340	32	1"	16,8	50	25	72	43
03BM40114	<b>40 x 1 1/4"</b>	1	0,500	40	1 1/4"	19,1	58	26	77	52
03BM50112	<b>50 x 1 1/2"</b>	1	0,800	50	1 1/2"	19,1	71	35	91	63
03BM632	<b>63 x 2"</b>	1	1,200	63	2"	23,4	88	38	100	77
03BM75212	<b>75 x 2 1/2"</b>	1	1,750	75	2 1/2"	26,7	100	40	109	90
03BM903	<b>90 x 3"</b>	1	2,815	90	3"	29,8	120	42	128	109
03BM1104	<b>110 x 4"</b>	1	3,940	110	4"	35,8	142	43	135	129




## FEMALE THREADED 90° FLANGED ELBOW



Material: **PPR - Brass**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \times 3/4'' \div \varnothing 32 \times 1\frac{1}{4}'' mm$**

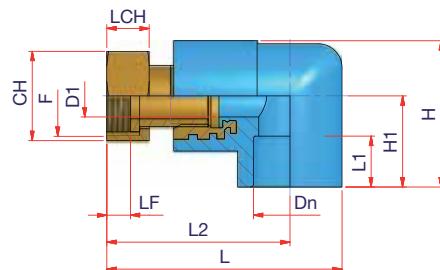

**FIG. 235**


NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $m^3/p.$	Dn	F	LF	D1	D	L1	L2	L	CH	LCH	H1	H
03NBC2034	16V6750	20 x 3/4"	10	2.520	0,145	0,0035	20	3/4"	10,8	14,1	37	16	59	73,5	30	14	27,5	46
03NBC251	16V6751	25 x 1"	10	2.520	0,220	0,0027	25	1"	11,5	18	42	17	63	80,5	37	15	30,5	51,5
03NBC32114	16V6752	32 x 1 1/4"	5	1.260	0,372	0,0054	32	1 1/4"	14	24	54	20	74	95	46	18	47	74

## REPAIRING STICK



Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

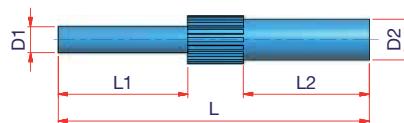


**FIG. 236**


NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $m^3/p.$	D1	D2	L1	L2	L
03NCAR711	16V8507	7-11	100	-	0,007	0,0003	7	11	35	35	84




(A)



(B)



(C)

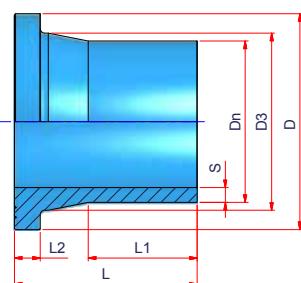

## STUB END - SDR11

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 32 \div \varnothing 630 \text{ mm}$**

Notes: **Type C - Male/Male fitting (SDR11) for butt welding or electrofusion welding**


**Type B and C - The gasket is supplied separately  
item code 00GRMBxxx**

**FIG. 237**

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	S	D	D1	D2	D3	L1	L2	L
03NCOSA32	16V7150	A	<b>32</b>	100	9.600	0,022	0,0001	32	-	51	28	40,6	-	18	-	26
03NCOSA40	16V7151	A	<b>40</b>	50	4.400	0,040	0,0002	40	-	64	36	49,4	-	20,5	-	30
03NCOSA50	16V7152	A	<b>50</b>	36	3.168	0,056	0,0002	50	-	73,2	45,5	61	-	23,5	-	34
03NCOSA63	16V7153	A	<b>63</b>	20	1.760	0,088	0,0004	63	-	90,5	56,5	76	-	27,5	-	38
03NCOSA75	-	A	<b>75</b>	12	1.056	0,129	0,0007	75	-	104,5	71	90	-	30	-	42
03NCOSA90	-	B	<b>90</b>	8	704	0,250	0,0010	90	-	138	84	107	-	37	-	46
03NCOSA110	-	B	<b>110</b>	10	480	0,375	0,0017	110	-	150	90	131	-	43	-	57
03NCOSA125	-	B	<b>125</b>	8	384	0,475	0,0021	125	-	162	110	146	-	47,5	-	62,5
03NCOSA160	-	C	<b>160</b>	24	96	1,758	0,0090	160	14,6	212	-	-	175	105	25	180
03NCOSA200	-	C	<b>200</b>	12	48	3,217	0,0180	200	18,2	268	-	-	232	125	32	200
03NCOSA250	-	C	<b>250</b>	18	36	4,416	0,0282	250	22,7	320	-	-	285	132	35	207
03NCOSA315	-	C	<b>315</b>	1	-	-	-	315	28,6	370	-	-	335	152	35	228
03NCOSA355	-	C	<b>355</b>	1	-	-	-	355	32,2	430	-	-	373	166	40	246
03NCOSA400	-	C	<b>400</b>	1	-	-	-	400	36,3	482	-	-	427	182	46	274
03NCOSA450	-	C	<b>450</b>	1	-	-	-	450	40,9	585	-	-	514	200	60	320
03NCOSA500	-	C	<b>500</b>	1	-	-	-	500	45,4	585	-	-	530	390	60	532
03NCOSA560	-	C	<b>560</b>	1	-	-	-	560	50,8	685	-	-	615	450	80	560
03NCOSA630	-	C	<b>630</b>	1	-	-	-	630	57,2	685	-	-	642	270	64	370



## STUB END - SDR 17

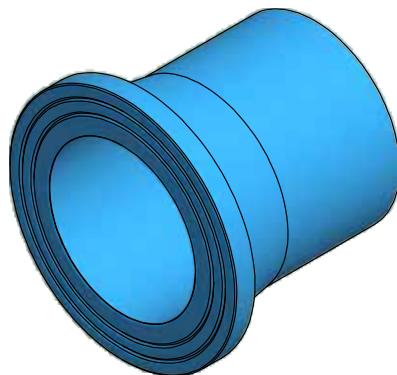


Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø160 ÷ ø400 mm**


Notes: **Male/Male fitting (SDR17) for butt welding or electrofusion welding**

**The gasket is supplied separately item code 00GRMBxxx**

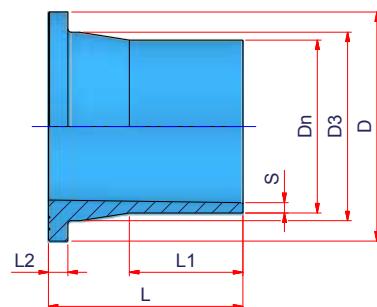

**FIG. 237A**


NIRON Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	S	D	D3	L1	L2	L
03NCOSA160	160	1	1	-	-	160	9,5	212	175	105	18	180
03NCOSA200	200	1	1	-	-	200	11,9	268	232	120	24	200
03NCOSA250	250	1	1	-	-	250	14,8	320	285	142	25	207
03NCOSA315	315	1	1	-	-	315	18,8	370	335	152	25	217
03NCOSA355	355	1	1	-	-	355	21,1	430	373	176	30	246
03NCOSA400	400	1	1	-	-	400	23,7	482	427	182	33	260



**EPDM BLUE GASKET REINFORCED  
WITH STEEL RING**

**FIG. 237E**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	PN	Di	De	S1	S2
00GRMB090	90	1	-	0,040	-	80	40	90	142	4	5
00GRMB112	110-125	1	-	0,020	-	110	16	115	162	5	6
00GRMB140	140	1	-	0,200	-	125	16	141	194	5	6
00GRMB1618	160-180	1	-	0,200	-	150	16	169	218	6	8
00GRMB222	200-225	1	-	0,200	-	200	16	220	273	6	8
00GRMB2528	250-280	1	-	0,360	-	250	16	274	330	6	8
00GRMB315	315	1	-	0,400	-	300	16	325	385	6	8
00GRMB355	355	1	-	0,600	-	350	16	368	445	7	10
00GRMB400	400	1	-	0,800	-	400	16	420	497	7	10
00GRMB500	450-500	1	-	1,000	-	500	10	520	595	7	10





## ALUMINIUM FLANGE FOR STUB END

Material: **Aluminium**

Standards: **EN 1092**

Range: **From ø32 to ø400 mm**

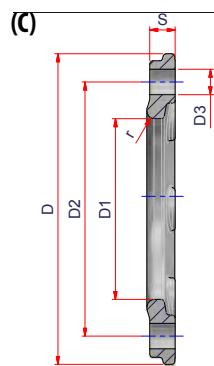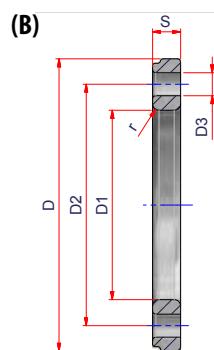

The new design allows a considerable reduction of weight and the particular shape of the flanges makes them behave as concave spring washers (cup springs) which store the preload necessary to balance each deformation of the thermoplastic material. Ease of installation is guaranteed by the lightness of the flanges and the re-tightening of the bolts after the installation is no longer required.

**FIG. 237B**

NIRON/ POLYSYSTEM Code	Type	Ø	Pack.	Weight kg/p	PN	DN (PP)	Dn	D	S	r	D1	D2	D3	Holes	Screws
00FLAALPV032	A	32	1	0,250	10	32	25	115	12	2	42	85	14	4	M12
00FLAALPV040	A	40	1	0,500	10	40	32	140	16	2	51	100	18	4	M16
00FLAALPV050	A	50	1	0,570	10	50	40	150	16	2	63	110	18	4	M16
00FLAALPV063	B	63	1	0,640	10	63	50	165	20	4	78	125	18	4	M16
00FLAALPV075	B	75	1	0,870	10	75	65	185	20	4	92	145	18	4	M16
00FLAALPV090	B	90	1	0,980	10	90	80	200	22	4	109	160	18	8	M16
00FLAALPV110	B	110	1	1,080	10	110	100	220	22	4	133	180	18	8	M16
00FLAALPV125	B	125	1	1,020	10	125	110	230	22	5	149	190	18	8	M16
00FLAAL160	C	160	1	1,700	10	160	160	285	22	5	178	240	22	8	M20
00FLAAL200-225	B	200-225	1	2,240	10	200-225	200	340	26	5	238	295	22	8	M20
00FLAAL250	B	250	1	3,000	10	250	250	395	28	5	288	350	22	12	M20
00FLAAL315	B	315	1	5,000	10	315	300	445	28	5	338	400	22	12	M20
00FLAAL355	B	355	1	4,800	10	355	350	505	22	5	376	460	22	16	M20
00FLAAL400	B	400	1	6,400	10	400	400	565	25	6	430	515	25	16	M24




## POLYPROPYLENE COATED CAST IRON FLANGE

Material: **PPR - Steel**

Standards: **EN 1092**

Range: **ø32 ÷ ø400 mm**

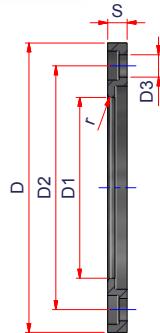

Made of cast iron, coated with black polypropylene and reinforced with fiber glass at 30% with excellent protection against corrosion. The flanges are designed using FEM (finite element method) analysis that optimizes their section while maintaining high performance. The main characteristics are ease of installation due to the lightness of the flanges, excellent corrosion resistance and the elimination of re-tightening of nuts and bolts after the installation.

The particular shape of the flanges makes them behave as concave spring washers (cup springs) which store a preload necessary to balance each deformation of the thermoplastic material.

**FIG. 237C**

NIRON/ POLYSYSTEM Code	Ø	Pack.	Weight kg/p	PN	DN (PP)	Dn	D	S	r	D1	D2	D3	Holes	Screws
00FLAACPP032	32	1	0,500	10	32	25	122	17	3	42	85	14	4	M12
00FLAACPP040	40	1	0,550	10	40	32	142	17	3	51	100	18	4	M16
00FLAACPP050	50	1	0,750	10	50	40	156	19	3	62	110	18	4	M16
00FLAACPP063	63	1	0,900	10	63	50	171	20	3	78	125	18	4	M16
00FLAACPP075	75	1	1,100	10	75	65	191	21	3	92	145	18	4	M16
00FLAACPP090	90	1	1,300	10	90	80	206	21	3	108	160	18	8	M16
00FLAACPP110	110	1	1,400	10	110	100	226	22	3	128	180	18	8	M16
00FLAACPP125	125	1	1,350	10	125	100	226	23	3	135	180	18	8	M16
00FLAACPP160	160	1	1,800	10	160	150	296	28	3	178	240	18	8	M20
00FLAACPP200225	200	1	2,400	10	200-225	200	350	23	3	250	295	22	8	M20
00FLAACPP250	250	1	3,450	10	250	250	412	36	4	288	350	22	12	M20
00FLAACPP315	315	1	7,150	10	315	300	462	42	4	338	400	22	12	M20
00FLAACPP355	355	1	11,500	10	355	350	525	52	6	376	460	22	16	M20
00FLAACPP400	400	1	14,700	10	400	400	586	56	6	430	515	26	16	M24




## BLACK EPOXY COATED CAST IRON FLANGE

Material: **Cast iron - Epoxy coating**

Standards: **EN 1092**

Range: **ø450 ÷ ø630 mm**

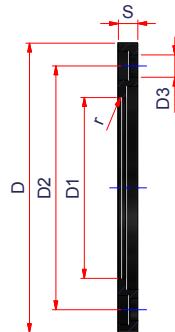

Made of cast iron and coated with black epoxy paint that provides excellent protection against corrosion. The flanges are designed using FEM (finite element method) analysis that optimizes their section while maintaining high performance. The main characteristics are ease of installation due to the lightness of the flanges, excellent corrosion resistance and the elimination of re-tightening of nuts and bolts after the installation.

The particular shape of the flanges makes them behave as concave spring washers (cup springs) which store a preload necessary to balance each deformation of the thermoplastic material.

**FIG. 23D**

NIRON Code	Ø	Pack.	Weight kg/p	PN	DN (PP)	Dn	D	S	r	D1	D2	D3	Holes	Screws
00FLAVN450	450	1	31,500	10	450	500	670	42	6	517	620	26	20	M24
00FLAVN500	500	1	23,300	10	500	500	670	38	4	533	620	26	20	M24
00FLAVN560	560	1	40,000	10	560	600	785	50	7	618	725	30	20	M27
00FLAVN630	630	1	26,800	10	630	600	785	40	4	645	725	30	20	M27



## 5.2.4 ELECTROFUSION FITTINGS

The electrofusion fittings listed below must be sold only to installers who attended a welding course or who fully respect the installation instructions indicated in our technical manual. We will not take any responsibility for damages due to installation mistakes.


### ELECTROFUSION COUPLER



Material: **PPR**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 315 \text{ mm}$**

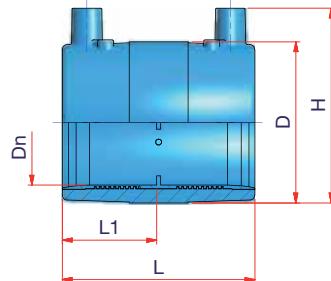

**FIG. 240**

NIRON Code	POLYSYSTEM Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L	H	D
03NME20	16V6712	20	60	2.880	0,054	0,0003	20	34	70	52	33
03NME25	16V6713	25	30	2.640	0,053	0,0003	25	34	70	58	38,5
03NME32	16V6714	32	40	1.920	0,075	0,0004	32	34	70	65	45,5
03NME40	16V6715	40	30	1.440	0,112	0,0006	40	41	85	75	55
03NME50	16V6716	50	40	1.080	0,150	0,0009	50	42,5	88	87	68
03NME63	16V6717	63	30	810	0,220	0,0012	63	47,5	98	100	82
03NME75	-	75	24	648	0,341	0,0015	75	61	125	114	98
03NME90	-	90	32	384	0,500	0,0025	90	72	146	130	113
03NME110	-	110	22	264	0,663	0,0036	110	77	155	144	136
03NME125	-	125	16	192	1,000	0,0050	125	82	166	167	156,5
03NME160	-	160	24	96	1,500	0,0090	160	86,5	175	201,5	190
03NME200	-	200	14	56	2,171	0,0154	200	91,5	185	243	232
03NME250	-	250	18	36	4,461	0,0282	250	106	212	300	296
03NME315	-	315	1	-	-	-	315	120	240	373	372,5

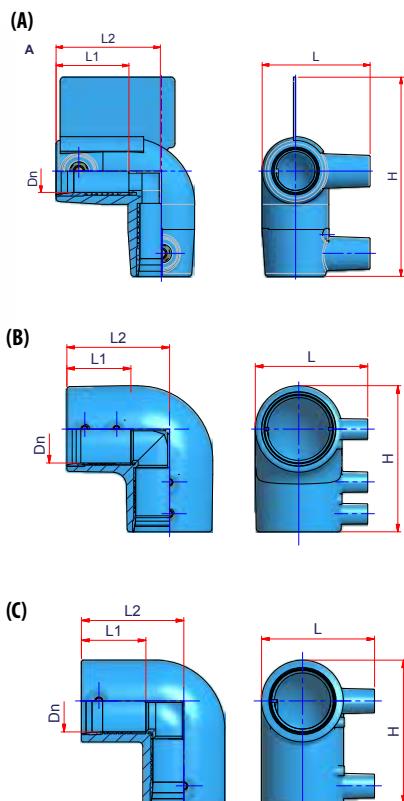

## 90° ELECTROFUSION ELBOW

Material: **PPR**


Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 160 \text{ mm}$**

Notes: **Type A and C single-wire**  
**Type B two-wire**

FIG. 241

NIRON Code	POLYSYSTEM Code	Type	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	L1	L2	L	H
03NGE20	-	A	20	30	1.440	-	-	20	34	50,5	52	95,5
03NGE25	-	A	25	30	1.440	-	-	25	37	54	57	102
03NGE32	-	C	32	20	960	-	-	32	34	57,5	64	80
03NGE40	16V7604	B	40	20	960	0,175	0,0008	40	41	65	73	91,5
03NGE50	16V7605	B	50	25	675	0,246	0,0014	50	48	77	84	109,5
03NGE63	16V7606	B	63	15	405	0,420	0,0024	63	53	88	100	126
03NGE75	-	C	75	12	324	0,420	0,0030	75	58	97	110	142
03NGE90	-	B	90	14	168	1,000	0,0057	90	78	119	133	176
03NGE110	-	B	110	10	120	1,395	0,0080	110	83	144	164	214
03NGE160	-	C	160	12	48	-	-	160	90	173	208,5	269

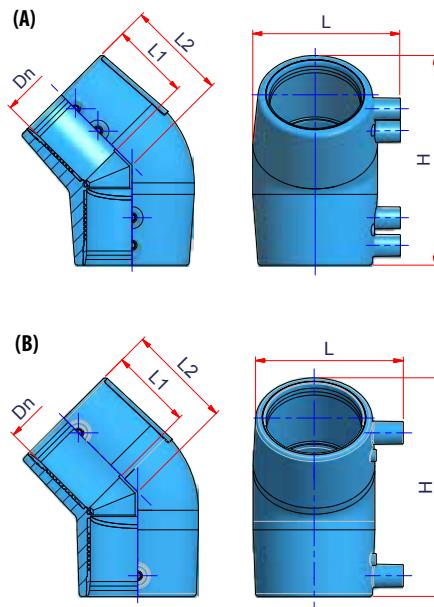

## 45° ELECTROFUSION ELBOW

Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø32 ÷ ø160 mm**

Notes: **Type A two-wire  
Type B single-wire**

**FIG. 242**



NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	L1	L2	L	H
03NCE32	-	B	32	30	1.440	-	-	32	36	46	64	94
03NCE40	16V7614	A	40	20	960	0,146	0,0009	40	42	52	74,5	109
03NCE50	16V7615	A	50	16	768	0,231	0,0011	50	47	63	85	126
03NCE63	16V7616	A	63	20	540	0,359	0,0018	63	54	68	100	146
03NCE75	-	A	75	14	378	0,443	0,0026	75	60	81	112,5	169
03NCE90	-	A	90	15	180	0,900	0,0080	90	67	97	132	219
03NCE110	-	A	110	12	144	1,188	0,0067	110	81	107	152	249
03NCE160	-	B	160	12	48	-	-	160	90	134	208	296



## ELECTROFUSION TEE



(A)





Material: **PPR**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range: **ø20 ÷ ø110 mm**

Notes: **Type A and B two-wire**  
**Type C single-wire with spigot end**

(B)



(C)





FIG. 243

NIRON Code	POLYSYSTEM Code	Type	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn	L1	L2	L3	L	H
03NTE20	-	C	20	40	1.920	-	-	20	37	70	46	52	83
03NTE25	-	C	25	30	1.440	-	-	25	37	77	46	57	87
03NTE32	-	C	32	25	1.200	-	-	32	37	90	47	64	96
03NTE40	16V7624	A	40	12	576	0,180	0,0015	40	44	70	-	75	99
03NTE50	16V7625	B	50	15	405	0,356	0,0024	50	48	77	-	86	140
03NTE63	16V7626	A	63	10	270	0,605	0,0036	63	54	90	-	103	135
03NTE75	-	C	75	6	162	1,083	0,0060	75	58	98	72	112	178
03NTE90	-	A	90	10	120	1,350	0,0080	90	68	120	-	134	182
03NTE110	-	A	110	7	84	1,828	0,0114	110	83	144	-	144	214



## 5.3 PPR COMPRESSION FITTINGS

### COUPLER




Material: **PPR**

Standards: **UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 110\text{ mm}$**

Notes: **From  $\varnothing 20$  to  $\varnothing 63$  class 2-6 bar**  
**From  $\varnothing 75$  to  $\varnothing 110$  class 1-6 bar**

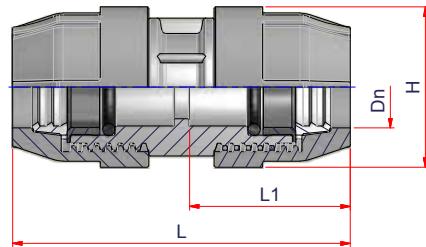

**FIG.311**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L	H
03NKMAn20	20	1	-	-	-	20	52,5	119	45
03NKMAn25	25	1	-	-	-	25	54,5	118,5	53
03NKMAn32	32	1	-	-	-	32	62,5	138	64,5
03NKMAn40	40	1	-	-	-	40	80	167,5	83,5
03NKMAn50	50	1	-	-	-	50	90	184	96
03NKMAn63	63	1	-	-	-	63	110	224,5	113
03NKMAn75	75	1	-	-	-	75	121	246	132
03NKMAn90	90	1	-	-	-	90	144	298	150,5
03NKMAn110	110	1	-	-	-	110	175,5	364	177




## REDUCER

Material: **PPR**

Standards: **UNI EN ISO 15874**

Range: **ø25-20 ÷ ø110-90 mm**

Notes: **From ø20 to ø63 class 2-6 bar**  
**From ø75 to ø110 class 1-6 bar**

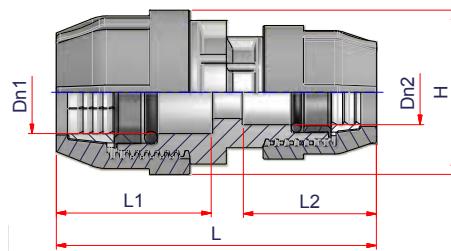

**FIG.312**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L	H
03NKR2520	25-20	1	-	-	-	25	20	54,5	52,5	111	53
03NKR3220	32-20	1	-	-	-	32	20	62,5	52,5	128,5	64,5
03NKR3225	32-25	1	-	-	-	32	25	62,5	54,5	129	64,5
03NKR4025	40-25	1	-	-	-	40	25	80	54,5	145	83,5
03NKR4032	40-32	1	-	-	-	40	32	80	62,5	145	83,5
03NKR5032	50-32	1	-	-	-	50	32	90	62,5	163	96
03NKR5040	50-40	1	-	-	-	50	40	90	80	160	96
03NKR6332	63-32	1	-	-	-	63	32	110	62,5	187	113
03NKR6340	63-40	1	-	-	-	63	40	110	80	204	113
03NKR6350	63-50	1	-	-	-	63	50	110	90	228	113
03NKR7550	75-50	1	-	-	-	75	50	121	90	228,5	132
03NKR7563	75-63	1	-	-	-	75	63	121	110	233	132
03NKR9063	90-63	1	-	-	-	90	63	144	110	254,5	152
03NKR9075	90-75	1	-	-	-	90	75	144	121	290,5	152
03NKR11090	110-90	1	-	-	-	110	90	175,5	144	330,5	181



## 90° ELBOW




Material: **PPR**

Standards: **UNI EN ISO 15874**

Range:  **$\varnothing 20 \div \varnothing 110\text{ mm}$**

Notes: **From  $\varnothing 20$  to  $\varnothing 63$  class 2-6 bar**

**From  $\varnothing 75$  to  $\varnothing 110$  class 1-6 bar**

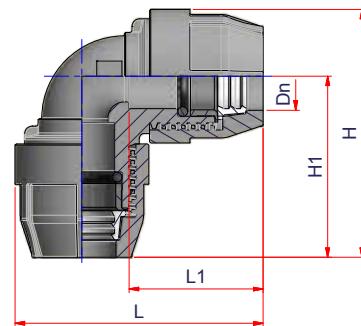

**FIG.313**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L	H1	H
03NKG20	20	1	-	-	-	20	52,5	93,5	69	93,5
03NKG25	25	1	-	-	-	25	54,5	100	73	100
03NKG32	32	1	-	-	-	32	62,5	120	86	120
03NKG40	40	1	-	-	-	40	80	152	109	152
03NKG50	50	1	-	-	-	50	90	168	122	168
03NKG63	63	1	-	-	-	63	110	201	147	201
03NKG75	75	1	-	-	-	75	121	236	170	236
03NKG90	90	1	-	-	-	90	144	282	207	282
03NKG110	110	1	-	-	-	110	175,5	331,5	243	331,5



90° TEE



## 90° TEE


Material: **PPR**

Standards: **UNI EN ISO 15874**

Range: **ø20 ÷ ø110 mm**

Notes: **From ø20 to ø63 class 2-6 bar**

**From ø75 to ø110 class 1-6 bar**

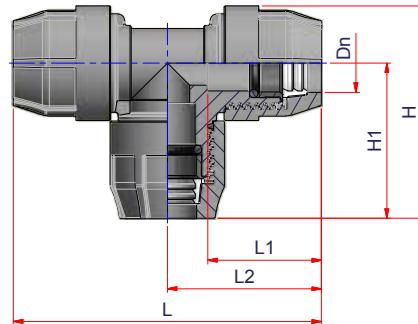

**FIG.314**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn	L1	L2	L	H1	H
03NKT20	20	1	-	-	-	20	52,5	68	136	68	91,5
03NKT25	25	1	-	-	-	25	54,5	73	146	73	98
03NKT32	32	1	-	-	-	32	62,5	87	174	87	118
03NKT40	40	1	-	-	-	40	80	108	216	108	152
03NKT50	50	1	-	-	-	50	95	122	244	122	175
03NKT63	63	1	-	-	-	63	110	145	290	145	197
03NKT75	75	1	-	-	-	75	121	168	336	168	234
03NKT90	90	1	-	-	-	90	144	207	414	207	281,5
03NKT110	110	1	-	-	-	110	175,5	244	488	244	332,5



## 5.4 PVDF COMPRESSION FITTINGS




### COUPLER



Material: **PVDF - PPR**

Standards: **UNI EN ISO 15874**

Range:  **$\varnothing 32 \div \varnothing 110\text{ mm}$**

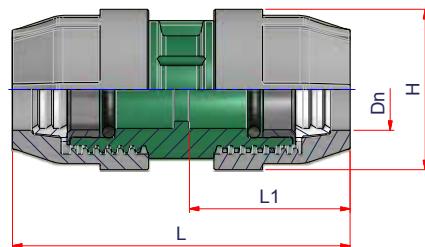

**FIG.411**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L	H
03NKMANPL32 •	32	1	-	-	-	32	62,5	138	64,5
03NKMANPL40 •	40	1	-	-	-	40	80	167,5	83,5
03NKMANPL50 •	50	1	-	-	-	50	90	184	96
03NKMANPL63 •	63	1	-	-	-	63	110	224,5	113
03NKMANPL90 •	90	1	-	-	-	90	144	298	150,5
03NKMANPL110 •	110	1	-	-	-	110	175,5	364	177

• Available only upon request




## REDUCER



Material: **PVDF - PPR**

Standards: **UNI EN ISO 15874**

Range: **ø40-32 ÷ ø110-90 mm**

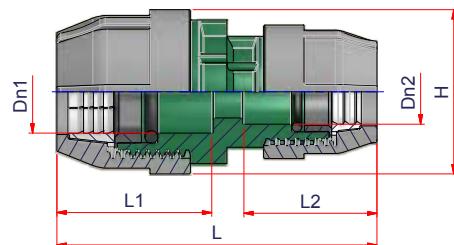

**FIG.412**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	L1	L2	L	H
03NKRPL4032 •	<b>40-32</b>	1	-	-	-	40	32	80	62,5	145	83,5
03NKRPL5032 •	<b>50-32</b>	1	-	-	-	50	32	90	62,5	163	96
03NKRPL5040 •	<b>50-40</b>	1	-	-	-	50	40	90	80	160	96
03NKRPL6332 •	<b>63-32</b>	1	-	-	-	63	32	110	62,5	187	113
03NKRPL6340 •	<b>63-40</b>	1	-	-	-	63	40	110	80	204	113
03NKRPL6350 •	<b>63-50</b>	1	-	-	-	63	50	110	90	228	113
03NKRPL9063 •	<b>90-63</b>	1	-	-	-	90	63	144	110	254,5	152
03NKRPL11090 •	<b>110-90</b>	1	-	-	-	110	90	175,5	144	330,5	181

• Available only upon request




## 90° ELBOW



Material: **PVDF - PPR**

Standards: **UNI EN ISO 15874**

Range:  **$\varnothing 32 \div \varnothing 110\text{ mm}$**

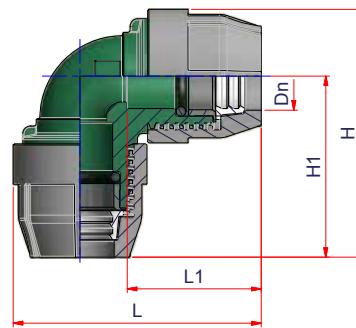

**FIG. 413**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L	H1	H
03NKGPL32•	32	1	-	-	-	32	62,5	120	86	120
03NKGPL40•	40	1	-	-	-	40	80	152	109	152
03NKGPL50•	50	1	-	-	-	50	90	168	122	168
03NKGPL63•	63	1	-	-	-	63	110	201	147	201
03NKGPL90•	90	1	-	-	-	90	144	282	207	282
03NKGPL110•	110	1	-	-	-	110	175,5	331,5	243	331,5

• Available only upon request

9


## 90° TEE



Material: **PVDF - PPR**

Standards: **UNI EN ISO 15874**

Range:  **$\varnothing 32 \div \varnothing 110\text{ mm}$**

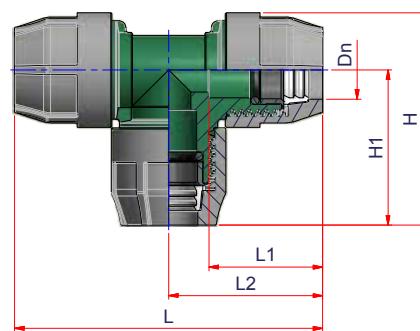

**FIG.414**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$	Dn	L1	L2	L	H1	H
03NKTP32•	<b>32</b>	1	-	-	-	32	62,5	87	174	87	118
03NKTP40•	<b>40</b>	1	-	-	-	40	80	108	216	108	152
03NKTP50•	<b>50</b>	1	-	-	-	50	95	122	244	122	175
03NKTP63•	<b>63</b>	1	-	-	-	63	110	145	290	145	197
03NKTP90•	<b>90</b>	1	-	-	-	90	144	207	414	207	281,5
03NKTP110•	<b>110</b>	1	-	-	-	110	175,5	244	488	244	332,5

• Available only upon request



## 5.5 PREINSULATED FITTINGS

### PREINSULATED 45° BEND



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø315 mm**

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**


Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078  
CSA B 137.11 - ASTM F 2389 - ISO 4065**

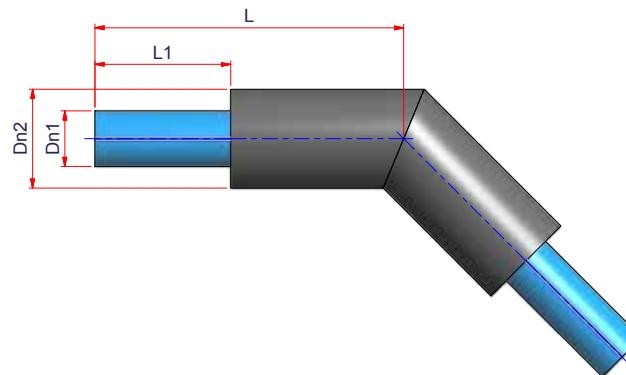

**FIG. 511**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m <sup>3</sup> /p.	Dn1	Dn2	L1	L
03NCL3211	32	1	-	-	-	32	90	220	500
03NCL4011	40	1	-	-	-	40	110	220	500
03NCL5011	50	1	-	-	-	50	110	220	500
03NCL6311	63	1	-	-	-	63	125	220	500
03NCL7511	75	1	-	-	-	75	140	220	500
03NCL9011	90	1	-	-	-	90	160	220	500
03NCL11011	110	1	-	-	-	110	200	220	500
03NCL12511	125	1	-	-	-	125	225	220	500
03NCL16011	160	1	-	-	-	160	250	220	500
03NCL20011	200	1	-	-	-	200	315	220	500
03NCL25011	250	1	-	-	-	250	400	220	500
03NCL31511	315	1	-	-	-	315	450	220	500



## PREINSULATED 45° BEND



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø250 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

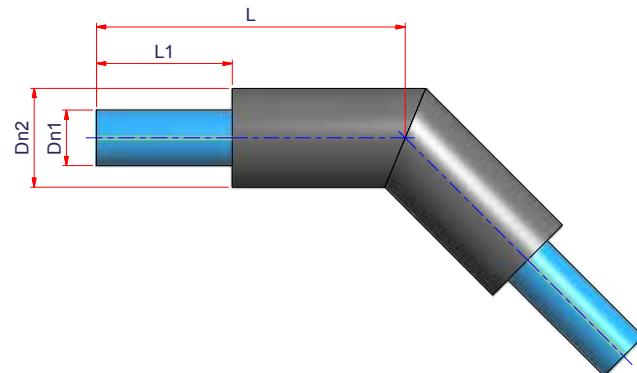

**FIG. 511A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NCFG3274	32	1	-	-	-	32	90	220	500
03NCFG4074	40	1	-	-	-	40	110	220	500
03NCFG5074	50	1	-	-	-	50	110	220	500
03NCFG6374	63	1	-	-	-	63	125	220	500
03NCFG7574	75	1	-	-	-	75	140	220	500
03NCFG9074	90	1	-	-	-	90	160	220	500
03NCFG11074	110	1	-	-	-	110	200	220	500
03NCFG12574	125	1	-	-	-	125	225	220	500
03NCFG16074	160	1	-	-	-	160	250	220	500
03NCFG20074	200	1	-	-	-	200	315	220	500
03NCFG25074	250	1	-	-	-	250	400	220	500



## PREINSULATED 45° BEND

Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø110 mm**



Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11**

**ASTM F 2389 (DIN 4726 floor heating)**

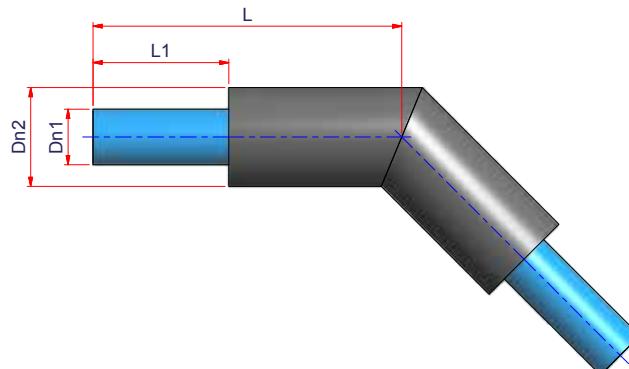

**FIG.511B**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NCWBF3274	32	1	-	-	-	32	90	220	500
03NCWBF4074	40	1	-	-	-	40	110	220	500
03NCWBF5074	50	1	-	-	-	50	110	220	500
03NCWBF6374	63	1	-	-	-	63	125	220	500
03NCWBF9074	90	1	-	-	-	90	160	220	500
03NCWBF11074	110	1	-	-	-	110	200	220	500



## PREINSULATED 90° BEND



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø315 mm**

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

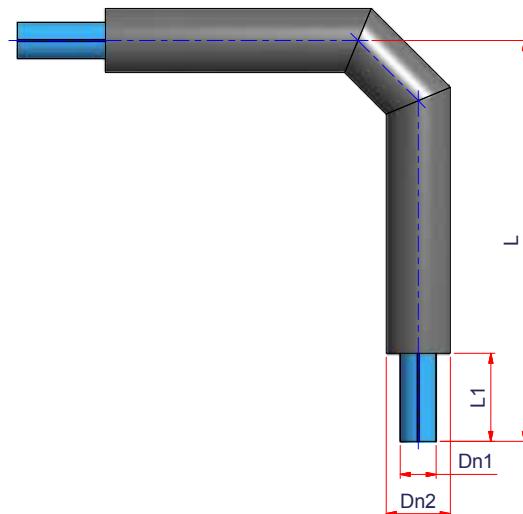

**FIG. 512**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGCL3211	32	1	-	-	-	32	90	220	1.000
03NGCL4011	40	1	-	-	-	40	110	220	1.000
03NGCL5011	50	1	-	-	-	50	110	220	1.000
03NGCL6311	63	1	-	-	-	63	125	220	1.000
03NGCL7511	75	1	-	-	-	75	140	220	1.000
03NGCL9011	90	1	-	-	-	90	160	220	1.000
03NGCL11011	110	1	-	-	-	110	200	220	1.000
03NGCL12511	125	1	-	-	-	125	225	220	1.000
03NGCL16011	160	1	-	-	-	160	250	220	1.000
03NGCL20011	200	1	-	-	-	200	315	220	1.000
03NGCL25011	250	1	-	-	-	250	400	220	1.000
03NGCL31511	315	1	-	-	-	315	450	220	1.000



## PREINSULATED 90° BEND

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø250 mm**



Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077**

**DIN 8078 - CSA B 137.11 - ASTM F 2389 - ISO 4065**

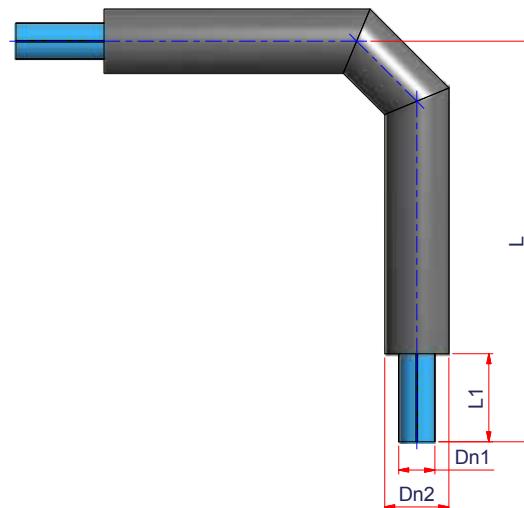

**FIG.512A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGFG3274	32	1	-	-	-	32	90	220	1.000
03NGFG4074	40	1	-	-	-	40	110	220	1.000
03NGFG5074	50	1	-	-	-	50	110	220	1.000
03NGFG6374	63	1	-	-	-	63	125	220	1.000
03NGFG7574	75	1	-	-	-	75	140	220	1.000
03NGFG9074	90	1	-	-	-	90	160	220	1.000
03NGFG11074	110	1	-	-	-	110	200	220	1.000
03NGFG12574	125	1	-	-	-	125	225	220	1.000
03NGFG16074	160	1	-	-	-	160	250	220	1.000
03NGFG20074	200	1	-	-	-	200	315	220	1.000
03NGFG25074	250	1	-	-	-	250	400	220	1.000



## PREINSULATED 90° BEND

Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø110 mm**



Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11**

**ASTM F 2389 (DIN 4726 floor heating)**

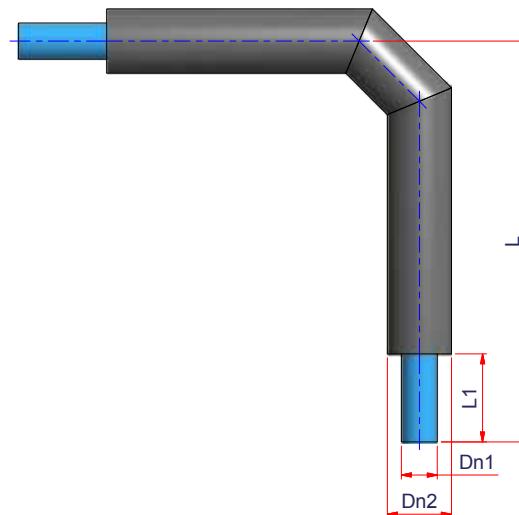

**FIG. 512B**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGWBF3274	32	1	-	-	-	32	90	220	1.000
03NGWBF4074	40	1	-	-	-	40	110	220	1.000
03NGWBF5074	50	1	-	-	-	50	110	220	1.000
03NGWBF6374	63	1	-	-	-	63	125	220	1.000
03NGWBF9074	90	1	-	-	-	90	160	220	1.000
03NGWBF11074	110	1	-	-	-	110	200	220	1.000



## PREINSULATED 90° SHORT BEND

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø75 mm**



Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

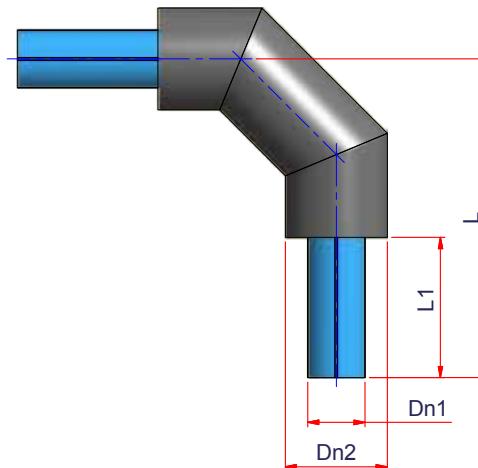

**FIG. 513**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGCLS3211	32	1	-	-	-	32	90	220	500
03NGCLS4011	40	1	-	-	-	40	110	220	500
03NGCLS5011	50	1	-	-	-	50	110	220	500
03NGCLS6311	63	1	-	-	-	63	125	220	500
03NGCLS7511	75	1	-	-	-	75	140	220	500



## PREINSULATED 90° SHORT BEND

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø75 mm**



Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

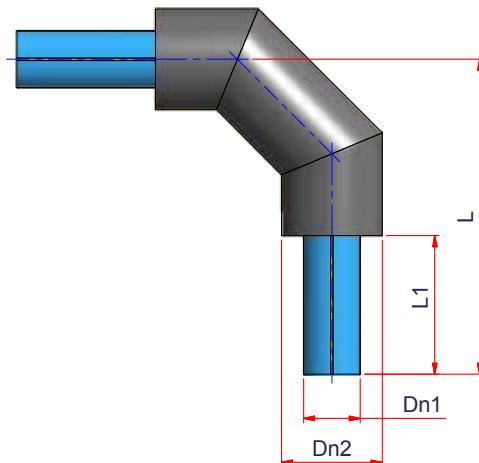

**FIG. 513A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGFGS3274	32	1	-	-	-	32	90	220	500
03NGFGS4074	40	1	-	-	-	40	110	220	500
03NGFGS5074	50	1	-	-	-	50	110	220	500
03NGFGS6374	63	1	-	-	-	63	125	220	500
03NGFGS7574	75	1	-	-	-	75	140	220	500



## PREINSULATED 90° SHORT BEND

Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø63 mm**



Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11**

**ASTM F 2389 (DIN 4726 floor heating)**

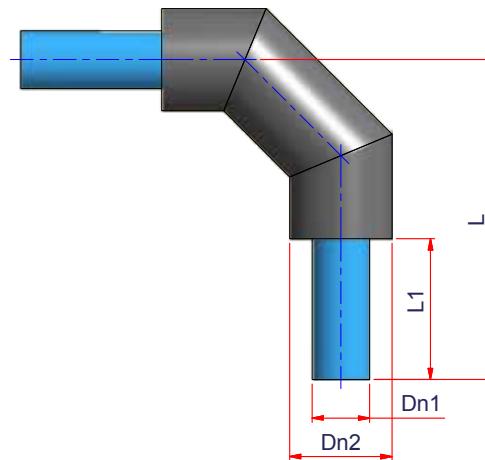


**FIG. 513B**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L
03NGWBFGS3274	32	1	-	-	-	32	90	220	500
03NGWBFGS4074	40	1	-	-	-	40	110	220	500
03NGWBFGS5074	50	1	-	-	-	50	110	220	500
03NGWBFGS6374	63	1	-	-	-	63	125	220	500



## PREINSULATED 90° TEE

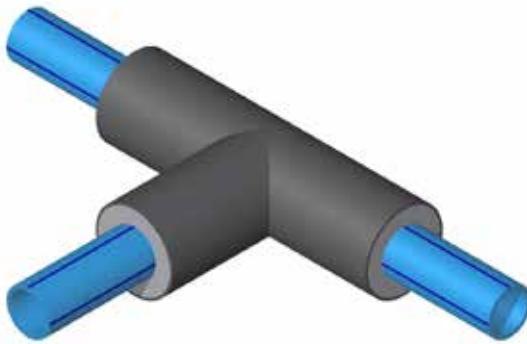

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø315 mm**

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

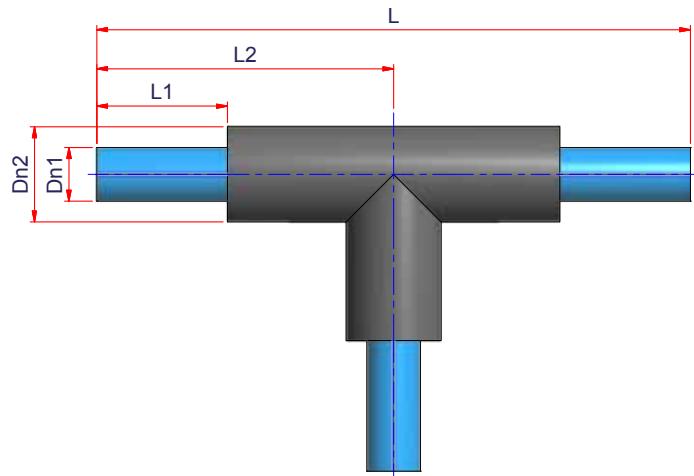


**FIG. 514**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L
03NTCL3211	32	1	-	-	-	32	90	220	500	1.000
03NTCL4011	40	1	-	-	-	40	110	220	500	1.000
03NTCL5011	50	1	-	-	-	50	110	220	500	1.000
03NTCL6311	63	1	-	-	-	63	125	220	500	1.000
03NTCL7511	75	1	-	-	-	75	140	220	500	1.000
03NTCL9011	90	1	-	-	-	90	160	220	500	1.000
03NTCL11011	110	1	-	-	-	110	200	220	500	1.000
03NTCL12511	125	1	-	-	-	125	225	220	500	1.000
03NTCL16011	160	1	-	-	-	160	250	220	500	1.000
03NTCL20011	200	1	-	-	-	200	315	220	750	1.500
03NTCL25011	250	1	-	-	-	250	400	220	750	1.500
03NTCL31511	315	1	-	-	-	315	450	220	750	1.500



## PREINSULATED 90° TEE

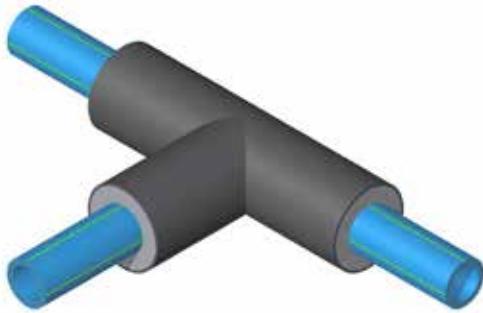

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø250 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

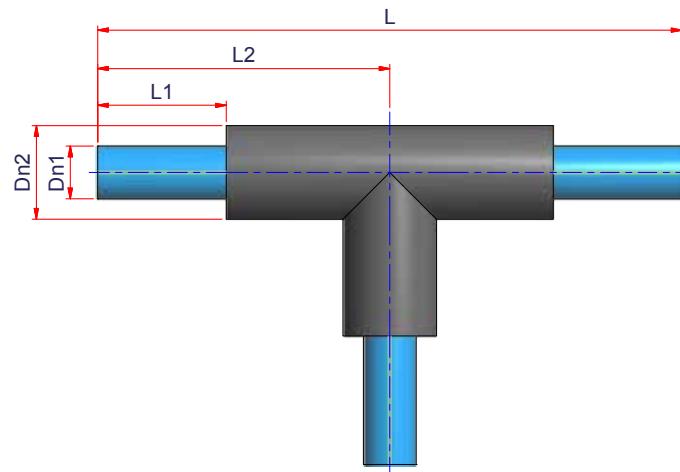

**FIG. 514A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L
03NTFG3274	32	1	-	-	-	32	90	220	500	1.000
03NTFG4074	40	1	-	-	-	40	110	220	500	1.000
03NTFG5074	50	1	-	-	-	50	110	220	500	1.000
03NTFG6374	63	1	-	-	-	63	125	220	500	1.000
03NTFG7574	75	1	-	-	-	75	140	220	500	1.000
03NTFG9074	90	1	-	-	-	90	160	220	500	1.000
03NTFG11074	110	1	-	-	-	110	200	220	500	1.000
03NTFG12574	125	1	-	-	-	125	225	220	500	1.000
03NTFG16074	160	1	-	-	-	160	250	220	500	1.000
03NTFG20074	200	1	-	-	-	200	315	220	750	1.500
03NTFG25074	250	1	-	-	-	250	400	220	750	1.500



## PREINSULATED 90° TEE



Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø110 mm**

Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11**

**ASTM F 2389 (DIN 4726 floor heating)**

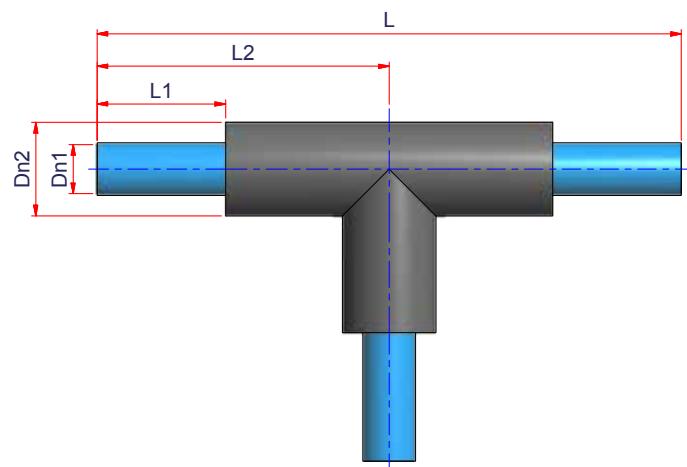

**FIG. 514B**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L
03NTWBF3274	32	1	-	-	-	32	90	220	500	1.000
03NTWBF4074	40	1	-	-	-	40	110	220	500	1.000
03NTWBF5074	50	1	-	-	-	50	110	220	500	1.000
03NTWBF6374	63	1	-	-	-	63	125	220	500	1.000
03NTWBF9074	90	1	-	-	-	90	160	220	500	1.000
03NTWBF11074	110	1	-	-	-	110	200	220	500	1.000




## PREINSULATED 90° REDUCING TEE

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø315/160 mm**

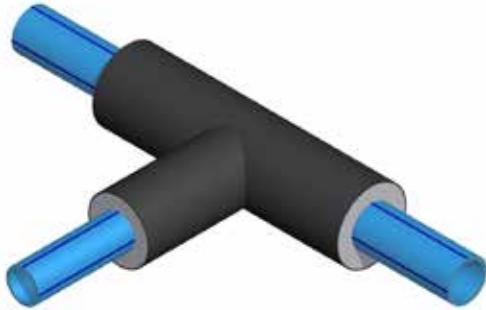

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

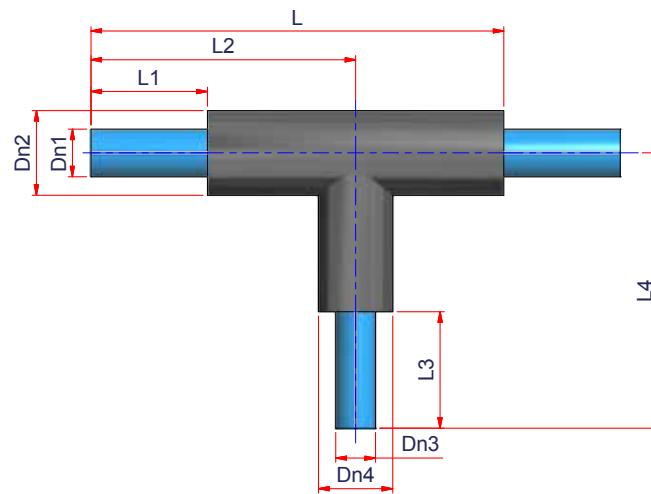


**FIG. 515**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRCL403211	40/32/40	1	-	-	-	40	110	32	90	220	500	220	500	1.000
03NTRCL503211	50/32/50	1	-	-	-	50	110	32	90	220	500	220	500	1.000
03NTRCL504011	50/40/50	1	-	-	-	50	110	40	110	220	500	220	500	1.000
03NTRCL633211	63/32/63	1	-	-	-	63	125	32	90	220	500	220	500	1.000
03NTRCL634011	63/40/63	1	-	-	-	63	125	40	110	220	500	220	500	1.000
03NTRCL635011	63/50/63	1	-	-	-	63	125	50	110	220	500	220	500	1.000
03NTRCL753211	75/32/75	1	-	-	-	75	140	32	90	220	500	220	500	1.000
03NTRCL754011	75/40/75	1	-	-	-	75	140	40	110	220	500	220	500	1.000
03NTRCL755011	75/50/75	1	-	-	-	75	140	50	110	220	500	220	500	1.000
03NTRCL756311	75/63/75	1	-	-	-	75	140	63	125	220	500	220	500	1.000
03NTRCL905011	90/50/90	1	-	-	-	90	160	50	110	220	500	220	500	1.000
03NTRCL906311	90/63/90	1	-	-	-	90	160	63	125	220	500	220	500	1.000
03NTRCL907511	90/75/90	1	-	-	-	90	160	75	140	220	500	220	500	1.000
03NTRCL1106311	110/63/110	1	-	-	-	110	200	63	125	220	500	220	500	1.000
03NTRCL1107511	110/75/110	1	-	-	-	110	200	75	140	220	500	220	500	1.000
03NTRCL1109011	110/90/110	1	-	-	-	110	200	90	160	220	500	220	500	1.000

...



## PREINSULATED 90° REDUCING TEE

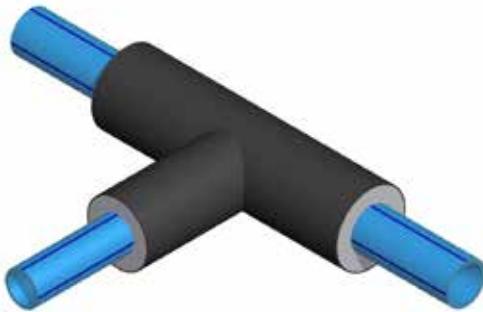

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø315/160 mm**

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

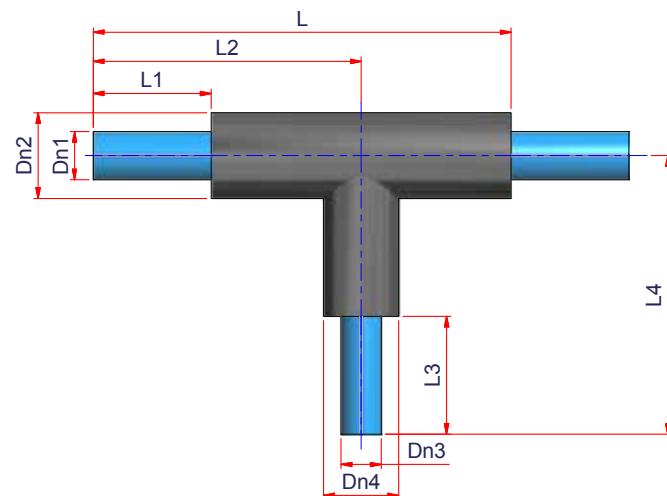


**FIG. 515**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRCL1259011	125/90/125	1	-	-	-	125	225	90	160	220	500	220	500	1.000
03NTRCL12511011	125/110/125	1	-	-	-	125	225	110	200	220	500	220	500	1.000
03NTRCL1609011	160/90/160	1	-	-	-	160	250	90	160	220	500	220	500	1.000
03NTRCL16011011	160/110/160	1	-	-	-	160	250	110	200	220	500	220	500	1.000
03NTRCL2009011	200/90/200	1	-	-	-	200	315	90	160	220	750	220	750	1.500
03NTRCL20011011	200/110/200	1	-	-	-	200	315	110	200	220	750	220	750	1.500
03NTRCL2509011	250/90/250	1	-	-	-	250	400	90	160	220	750	220	750	1.500
03NTRCL25011011	250/110/250	1	-	-	-	250	400	110	200	220	750	220	750	1.500
03NTRCL25012511	250/125/250	1	-	-	-	250	400	125	225	220	750	220	750	1.500
03NTRCL3159011	315/90/315	1	-	-	-	315	450	90	160	220	750	220	750	1.500
03NTRCL31512511	315/125/315	1	-	-	-	315	450	125	225	220	750	220	750	1.500
03NTRCL31516011	315/160/315	1	-	-	-	315	450	160	250	220	750	220	750	1.500



## PREINSULATED 90° REDUCING TEE

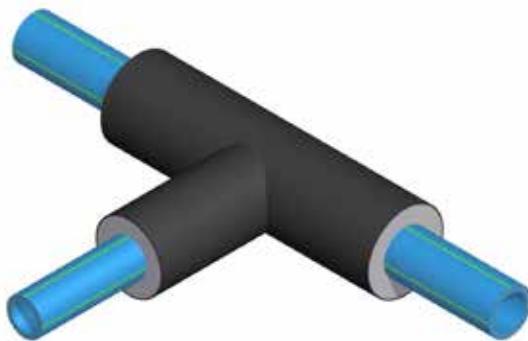

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø250/125 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

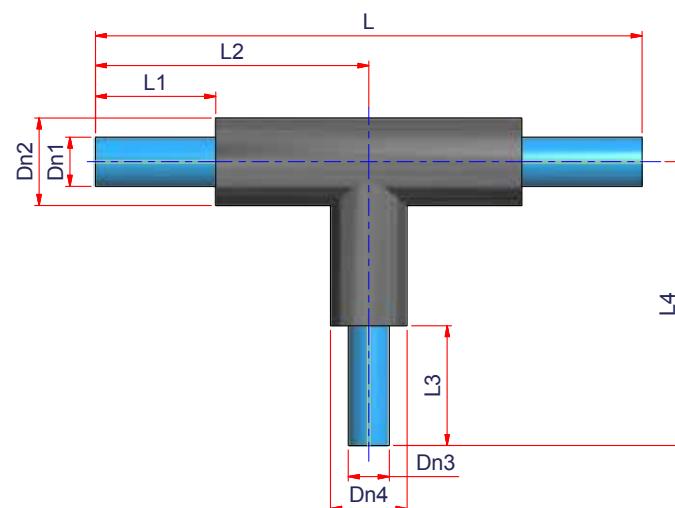


**FIG. 515A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRFG403274	40/32/40	1	-	-	-	40	110	32	90	220	500	220	500	1.000
03NTRFG503274	50/32/50	1	-	-	-	50	110	32	90	220	500	220	500	1.000
03NTRFG504074	50/40/50	1	-	-	-	50	110	40	110	220	500	220	500	1.000
03NTRFG633274	63/32/63	1	-	-	-	63	125	32	90	220	500	220	500	1.000
03NTRFG634074	63/40/63	1	-	-	-	63	125	40	110	220	500	220	500	1.000
03NTRFG635074	63/50/63	1	-	-	-	63	125	50	110	220	500	220	500	1.000
03NTRFG753274	75/32/75	1	-	-	-	75	140	32	90	220	500	220	500	1.000
03NTRFG754074	75/40/75	1	-	-	-	75	140	40	110	220	500	220	500	1.000
03NTRFG755074	75/50/75	1	-	-	-	75	140	50	110	220	500	220	500	1.000
03NTRFG756374	75/63/75	1	-	-	-	75	140	63	125	220	500	220	500	1.000
03NTRFG905074	90/50/90	1	-	-	-	90	160	50	110	220	500	220	500	1.000
03NTRFG906374	90/63/90	1	-	-	-	90	160	63	125	220	500	220	500	1.000
03NTRFG907574	90/75/90	1	-	-	-	90	160	75	140	220	500	220	500	1.000
03NTRFG1106374	110/63/110	1	-	-	-	110	200	63	125	220	500	220	500	1.000
03NTRFG1107574	110/75/110	1	-	-	-	110	200	75	140	220	500	220	500	1.000
														...



## PREINSULATED 90° REDUCING TEE

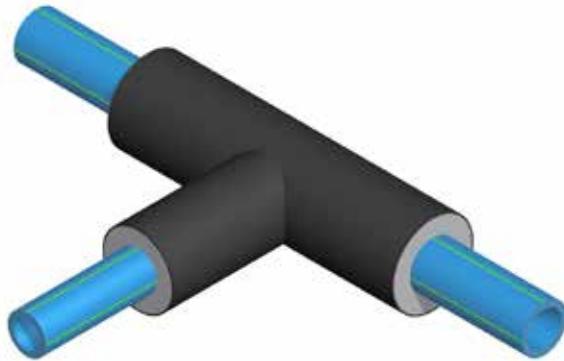

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø250/125 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**


Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

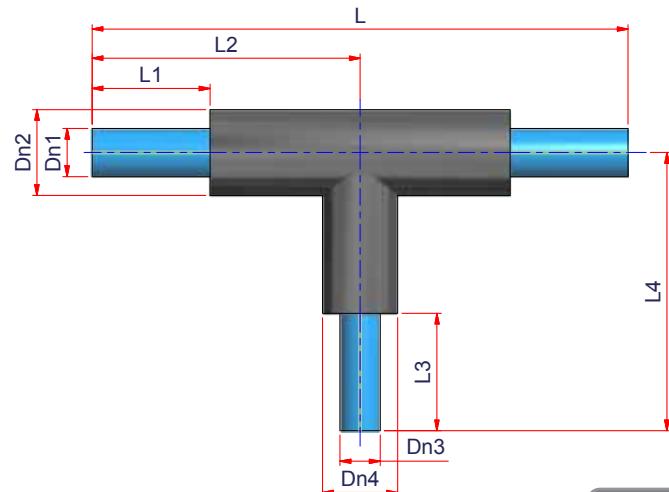

**FIG. 515A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRFG1109074	110/90/110	1	-	-	-	110	200	90	160	220	500	220	500	1.000
03NTRFG1259074	125/90/125	1	-	-	-	125	225	90	160	220	500	220	500	1.000
03NTRFG12511074	125/110/125	1	-	-	-	125	225	110	200	220	500	220	500	1.000
03NTRFG1609074	160/90/160	1	-	-	-	160	250	90	160	220	500	220	500	1.000
03NTRFG16011074	160/110/160	1	-	-	-	160	250	110	200	220	500	220	500	1.000
03NTRFG2009074	200/90/200	1	-	-	-	200	315	90	160	220	750	220	750	1.500
03NTRFG20011074	200/110/200	1	-	-	-	200	315	110	200	220	750	220	750	1.500
03NTRFG2509074	250/90/250	1	-	-	-	250	400	90	160	220	750	220	750	1.500
03NTRFG25011074	250/110/250	1	-	-	-	250	400	110	200	220	750	220	750	1.500
03NTRFG25012574	250/125/250	1	-	-	-	250	400	125	225	220	750	220	750	1.500

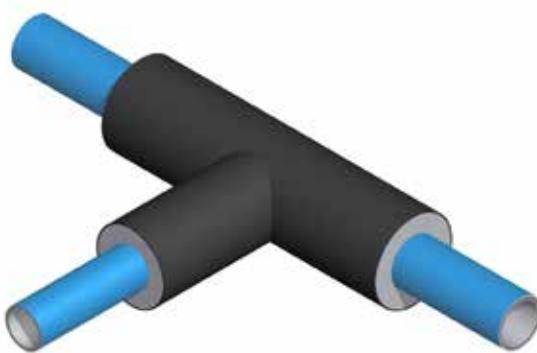

## PREINSULATED 90° REDUCING TEE

Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø110/90 mm**

Pipe type: **NIRON OB-CLIMA WHITE BLUE OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 11 - S 5**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F2389 (DIN 4726 floor heating)**

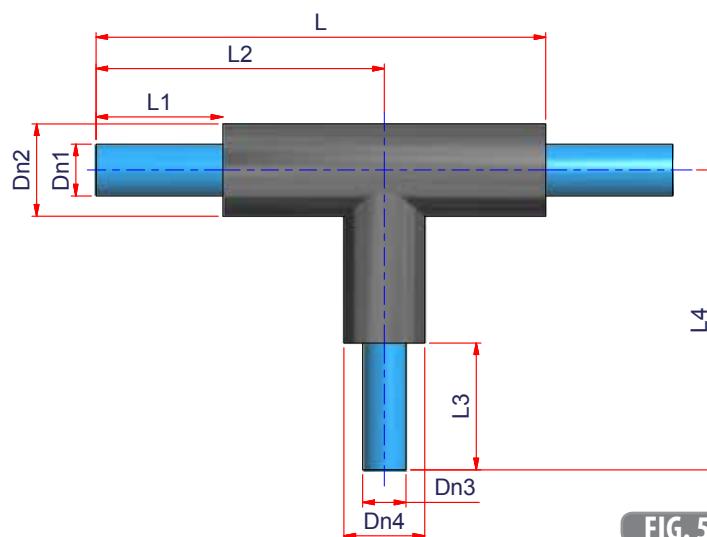


FIG. 515B

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRWBCL403211	40/32/40	1	-	-	-	40	110	32	90	220	500	220	500	1.000
03NTRWBCL503211	50/32/50	1	-	-	-	50	110	32	90	220	500	220	500	1.000
03NTRWBCL504011	50/40/50	1	-	-	-	50	110	40	110	220	500	220	500	1.000
03NTRWBCL633211	63/32/63	1	-	-	-	63	125	32	90	220	500	220	500	1.000
03NTRWBCL634011	63/40/63	1	-	-	-	63	125	40	110	220	500	220	500	1.000
03NTRWBCL635011	63/50/63	1	-	-	-	63	125	50	110	220	500	220	500	1.000
03NTRWBCL905011	90/50/90	1	-	-	-	90	160	50	110	220	500	220	500	1.000
03NTRWBCL906311	90/63/90	1	-	-	-	90	160	63	125	220	500	220	500	1.000
03NTRWBCL1106311	110/63/110	1	-	-	-	110	200	63	125	220	500	220	500	1.000
03NTRWBCL1109011	110/90/110	1	-	-	-	110	200	90	160	220	500	220	500	1.000



## PREINSULATED CROSSOVER 90° TEE



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø315 mm**

Pipe type: **NIRON CLIMA11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

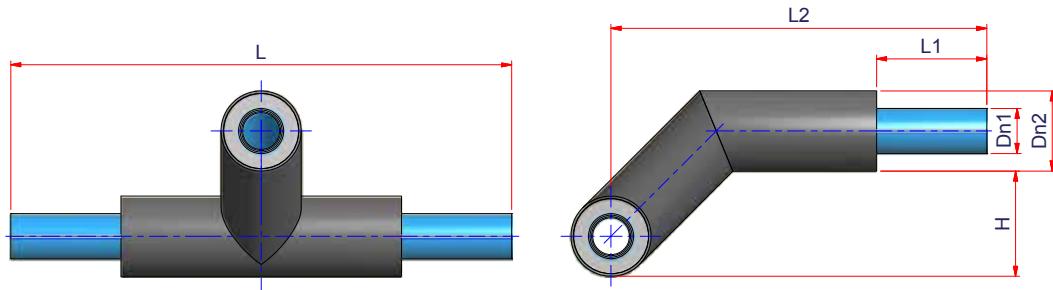


**FIG. 516**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L	H
03NTSCL3211	32	1	-	-	-	32	90	220	750	1.000	100
03NTSCL4011	40	1	-	-	-	40	110	220	750	1.000	120
03NTSCL5011	50	1	-	-	-	50	110	220	750	1.000	120
03NTSCL6311	63	1	-	-	-	63	125	220	750	1.000	135
03NTSCL7511	75	1	-	-	-	75	140	220	750	1.000	150
03NTSCL9011	90	1	-	-	-	90	160	220	750	1.000	170
03NTSCL11011	110	1	-	-	-	110	200	220	750	1.000	210
03NTSCL12511	125	1	-	-	-	125	225	220	750	1.000	235
03NTSCL16011	160	1	-	-	-	160	250	220	750	1.000	260
03NTSCL20011	200	1	-	-	-	200	315	220	1.000	1.500	325
03NTSCL25011	250	1	-	-	-	250	400	220	1.000	1.500	410
03NTSCL31511	315	1	-	-	-	315	450	220	1.000	1.500	480



## PREINSULATED CROSSOVER 90° TEE

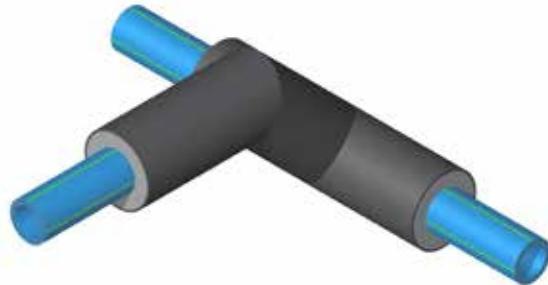

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø250 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

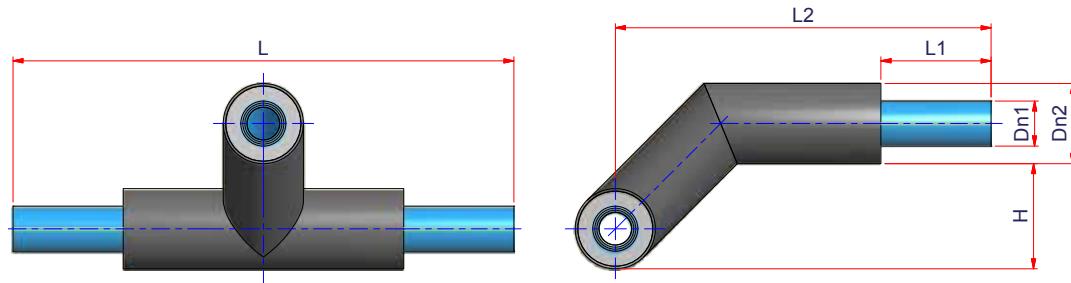

**FIG. 516A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L	H
03NTSFG3274	32	1	-	-	-	32	90	220	750	1.000	100
03NTSFG4074	40	1	-	-	-	40	740	220	750	1.000	120
03NTSFG5074	50	1	-	-	-	50	740	220	750	1.000	120
03NTSFG6374	63	1	-	-	-	63	125	220	750	1.000	135
03NTSFG7574	75	1	-	-	-	75	140	220	750	1.000	150
03NTSFG9074	90	1	-	-	-	90	160	220	750	1.000	170
03NTSFG11074	740	1	-	-	-	740	200	220	750	1.000	210
03NTSFG12574	125	1	-	-	-	125	225	220	750	1.000	235
03NTSFG16074	160	1	-	-	-	160	250	220	750	1.000	260
03NTSFG20074	200	1	-	-	-	200	315	220	1.000	1.500	325
03NTSFG25074	250	1	-	-	-	250	400	220	1.000	1.500	410




## PREINSULATED CROSSOVER 90° TEE

Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø32 to ø110 mm**

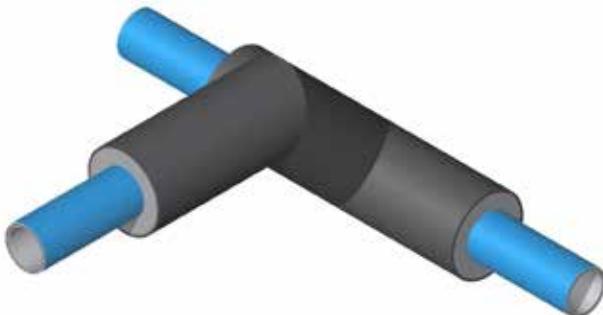

Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**


Pipe structure: **Multilayer pipe**

Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11  
ASTM F 2389**

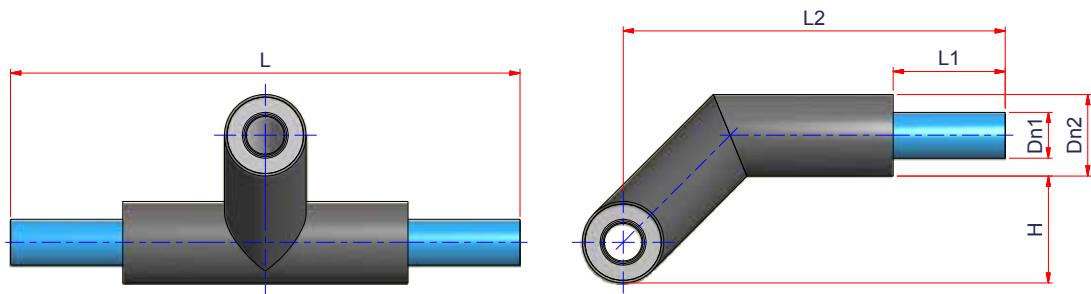

**FIG. 516B**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	L1	L2	L	H
03NTSWBFG3274	32	1	-	-	-	32	90	220	750	1.000	100
03NTSWBFG4074	40	1	-	-	-	40	110	220	750	1.000	120
03NTSWBFG5074	50	1	-	-	-	50	110	220	750	1.000	120
03NTSWBFG6374	63	1	-	-	-	63	125	220	750	1.000	135
03NTSWBFG9074	90	1	-	-	-	90	160	220	750	1.000	170
03NTSWBFG11074	110	1	-	-	-	110	200	220	750	1.000	210



## PREINSULATED CROSSOVER 90° REDUCING TEE

Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø315/160 mm**



Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

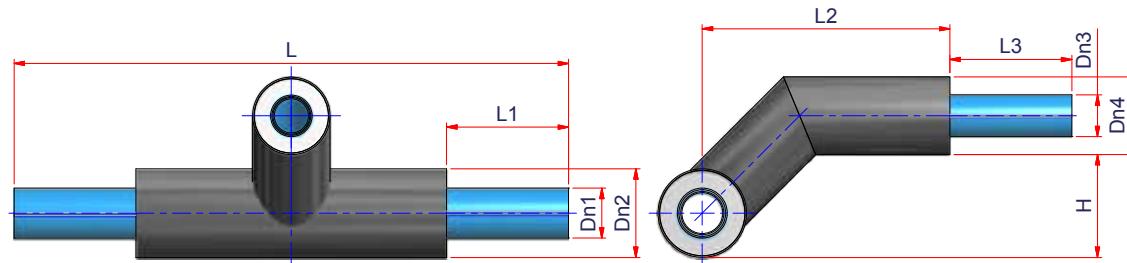

**FIG. 516C**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L4	L
03NTRSCL403211	40/32/40	1	-	-	-	40	110	32	90	220	500	220	500	1.000
03NTRSCL503211	50/32/50	1	-	-	-	50	110	32	90	220	500	220	500	1.000
03NTRSCL504011	50/40/50	1	-	-	-	50	110	40	110	220	500	220	500	1.000
03NTRSCL633211	63/32/63	1	-	-	-	63	125	32	90	220	500	220	500	1.000
03NTRSCL634011	63/40/63	1	-	-	-	63	125	40	110	220	500	220	500	1.000
03NTRSCL635011	63/50/63	1	-	-	-	63	125	50	110	220	500	220	500	1.000
03NTRSCL753211	75/32/75	1	-	-	-	75	140	32	90	220	500	220	500	1.000
03NTRSCL754011	75/40/75	1	-	-	-	75	140	40	110	220	500	220	500	1.000
03NTRSCL755011	75/50/75	1	-	-	-	75	140	50	110	220	500	220	500	1.000
03NTRSCL756311	75/63/75	1	-	-	-	75	140	63	125	220	500	220	500	1.000
03NTRSCL905011	90/50/90	1	-	-	-	90	160	50	110	220	500	220	500	1.000
03NTRSCL906311	90/63/90	1	-	-	-	90	160	63	125	220	500	220	500	1.000
03NTRSCL907511	90/75/90	1	-	-	-	90	160	75	140	220	500	220	500	1.000
03NTRSCL1106311	110/63/110	1	-	-	-	110	200	63	125	220	500	220	500	1.000
03NTRSCL1107511	110/75/110	1	-	-	-	110	200	75	140	220	500	220	500	1.000
03NTRSCL1109011	110/90/110	1	-	-	-	110	200	90	160	220	500	220	500	1.000

...



## PREINSULATED CROSSOVER 90° REDUCING TEE



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø315/160 mm**

Pipe type: **NIRON CLIMA 11 BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 11 - S 5**

Colour: **Blue with dark blue stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

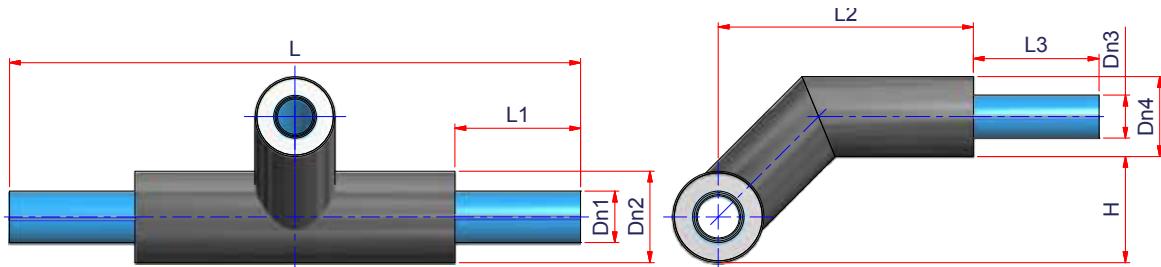

**FIG. 516C**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L	H
03NTRSCL1259011	125/90/125	1	-	-	-	125	225	90	160	220	750	220	1.000	235
03NTRSCL12511011	125/110/125	1	-	-	-	125	225	110	200	220	750	220	1.000	235
03NTRSCL1609011	160/90/160	1	-	-	-	160	250	90	160	220	750	220	1.000	260
03NTRSCL16011011	160/110/160	1	-	-	-	160	250	110	200	220	750	220	1.000	260
03NTRSCL2009011	200/90/200	1	-	-	-	200	315	90	160	220	1.000	220	1.500	325
03NTRSCL20011011	200/110/200	1	-	-	-	200	315	110	200	220	1.000	220	1.500	325
03NTRSCL2509011	250/90/250	1	-	-	-	250	400	90	160	220	1.000	220	1.500	410
03NTRSCL25011011	250/110/250	1	-	-	-	250	400	110	200	220	1.000	220	1.500	410
03NTRSCL25012511	250/125/250	1	-	-	-	250	400	125	225	220	1.000	220	1.500	410
03NTRSCL3159011	315/90/315	1	-	-	-	315	450	90	160	220	1.000	220	1.500	480
03NTRSCL31512511	315/125/315	1	-	-	-	315	450	125	225	220	1.000	220	1.500	480
03NTRSCL31516011	315/160/315	1	-	-	-	315	450	160	250	220	1.000	220	1.500	480



## PREINSULATED CROSSOVER 90° REDUCING TEE



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø250/125 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

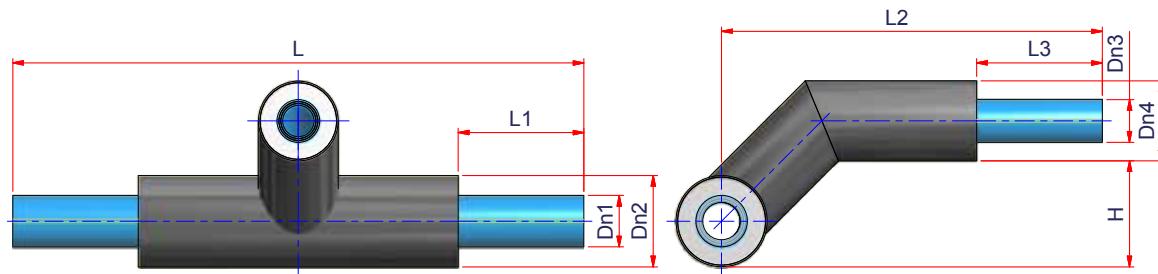

**FIG. 517**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L	H
03NTRSG403274	40/32/40	1	-	-	-	40	110	32	90	220	750	220	1.000	120
03NTRSG503274	50/32/50	1	-	-	-	50	110	32	90	220	750	220	1.000	120
03NTRSG504074	50/40/50	1	-	-	-	50	110	40	110	220	750	220	1.000	120
03NTRSG633274	63/32/63	1	-	-	-	63	125	32	90	220	750	220	1.000	135
03NTRSG634074	63/40/63	1	-	-	-	63	125	40	110	220	750	220	1.000	135
03NTRSG635074	63/50/63	1	-	-	-	63	125	50	110	220	750	220	1.000	135
03NTRSG753274	75/32/75	1	-	-	-	75	140	32	90	220	750	220	1.000	150
03NTRSG754074	75/40/75	1	-	-	-	75	140	40	110	220	750	220	1.000	150
03NTRSG755074	75/50/75	1	-	-	-	75	140	50	110	220	750	220	1.000	150
03NTRSG756374	75/63/75	1	-	-	-	75	140	63	125	220	750	220	1.000	150
03NTRSG905074	90/50/90	1	-	-	-	90	160	50	110	220	750	220	1.000	170
03NTRSG906374	90/63/90	1	-	-	-	90	160	63	125	220	750	220	1.000	170
03NTRSG907574	90/75/90	1	-	-	-	90	160	75	140	220	750	220	1.000	170
03NTRSG1106374	110/63/110	1	-	-	-	110	200	63	125	220	750	220	1.000	210
03NTRSG1107574	110/75/110	1	-	-	-	110	200	75	140	220	750	220	1.000	210
03NTRSG1109074	110/90/110	1	-	-	-	110	200	90	160	220	750	220	1.000	210

...



## PREINSULATED CROSSOVER 90° REDUCING TEE



Fitting structure: **PPR - Fiber glass - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø250/125 mm**

Pipe type: **NIRON FG BLUE PPR FIBER GLASS PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **Blue with green stripes**

Standards: **EN 8075 - EN 253 - UNI EN ISO 15874 - DIN 8077 - DIN 8078**

**CSA B 137.11 - ASTM F 2389 - ISO 4065**

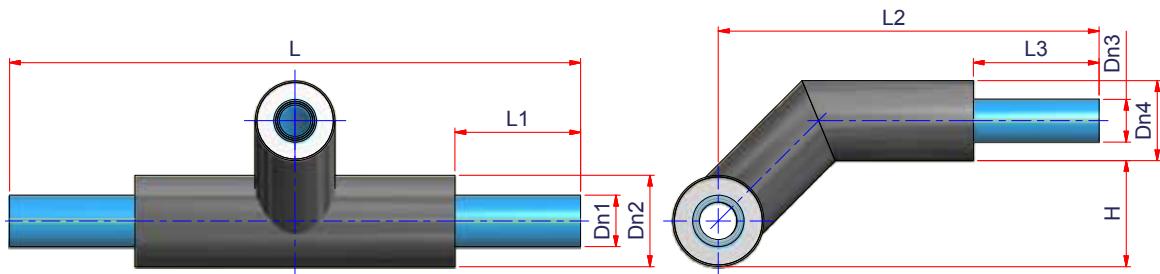

**FIG. 517**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L	H
03NTRSG1259074	125/90/125	1	-	-	-	125	225	90	160	220	1.000	220	1.000	235
03NTRSG12511074	125/110/125	1	-	-	-	125	225	110	200	220	1.000	220	1.000	235
03NTRSG1609074	160/90/160	1	-	-	-	160	250	90	160	220	1.000	220	1.000	260
03NTRSG16011074	160/110/160	1	-	-	-	160	250	110	200	220	1.000	220	1.000	260
03NTRSG2009074	200/90/200	1	-	-	-	200	315	90	160	220	1.500	220	1.500	325
03NTRSG20011074	200/110/200	1	-	-	-	200	315	110	200	220	1.500	220	1.500	325
03NTRSG2509074	250/90/250	1	-	-	-	250	400	90	160	220	1.500	220	1.500	410
03NTRSG25011074	250/110/250	1	-	-	-	250	400	110	200	220	1.500	220	1.500	410
03NTRSG25012574	250/125/250	1	-	-	-	250	400	125	225	220	1.500	220	1.500	410



## PREINSULATED CROSSOVER 90° REDUCING TEE



Fitting structure: **PPR - Fiber glass - Oxygen barrier - PUR - HDPE cover**

Standards: **UNI EN ISO 15874 - EN 253 - EN 488 - EN 489 - DIN 8075**

Range: **From ø40/32 to ø110/90 mm**

Pipe type: **NIRON OB-FG WHITE-BLUE PPR OXYGEN BARRIER PIPE**

Pipe structure: **Multilayer pipe**


Material: **PPR - Fiber glass - Oxygen barrier**

Pipe series: **SDR 7,4 - S 3,2**

Colour: **White - Blue**

Standards: **UNI EN ISO 15874 - DIN 8077 - DIN 8078 - CSA B 137.11**

**ASTM F 2389**

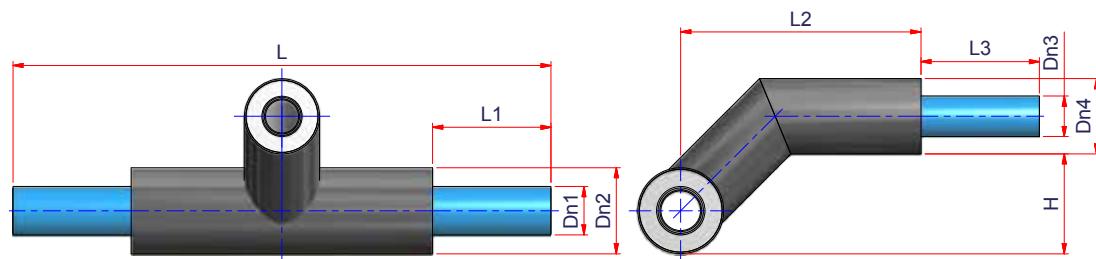


**FIG. 517A**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	Dn1	Dn2	Dn3	Dn4	L1	L2	L3	L	H
03NTRSWBFG403274	40/32/40	1	-	-	-	40	110	32	90	220	750	220	1.000	120
03NTRSWBFG503274	50/32/50	1	-	-	-	50	110	32	90	220	750	220	1.000	120
03NTRSWBFG504074	50/40/50	1	-	-	-	50	110	40	110	220	750	220	1.000	120
03NTRSWBFG633274	63/32/63	1	-	-	-	63	125	32	90	220	750	220	1.000	135
03NTRSWBFG634074	63/40/63	1	-	-	-	63	125	40	110	220	750	220	1.000	135
03NTRSWBFG635074	63/50/63	1	-	-	-	63	125	50	110	220	750	220	1.000	135
03NTRSWBFG905074	90/50/90	1	-	-	-	90	160	50	110	220	750	220	1.000	170
03NTRSWBFG906374	90/63/90	1	-	-	-	90	160	63	125	220	750	220	1.000	170
03NTRSWBFG1106374	110/63/110	1	-	-	-	110	200	63	125	220	750	220	1.000	210
03NTRSWBFG1109074	110/90/110	1	-	-	-	110	200	90	160	220	750	220	1.000	210



## 5.6 EQUIPMENT

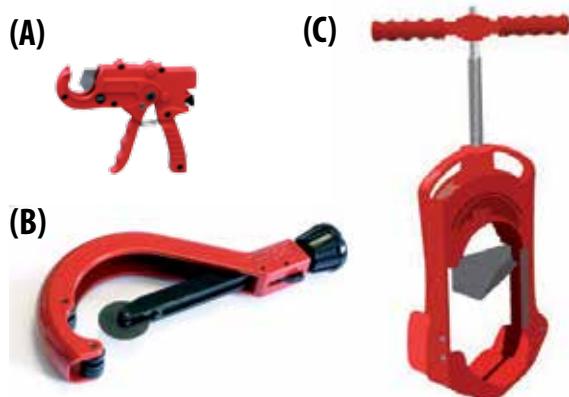

### PIPE CUTTER

Material: **Metal**

Standards: **UNI 10566**

Range: **ø16 ÷ ø315 mm**

Notes: \*The guillotine cutter is designed according to UNI 10566 Standard. The operator performs the welding procedure without any failure due to bad cut. Easy to use, it is designed to be installed inside the trench. The lower part can be opened to cut pipes underground that are still joined together. Supplied with user's handbook.

FIG. 611

Code	Type	Ø	Pack.	Weight kg/p	Volume m³/p.
00TT1540	A Shear	16 ÷ 40	1	1,000	-
19SCUT	B Circular	50 ÷ 125	1	1,700	-
00TA2 *	C Guillotine	max 225 (< SDR11)	1	19,800	0,0760
00TA3 *	C Guillotine	max 315 (< SDR11)	1	61,600	0,3937

#### SPARE BLADES FOR CIRCULAR PIPE CUTTER

19SLRCUT	for 19SCUT	1	0,008	-
00TTG2LR	for 00TA2	1	0,700	-
00TTG3LR	for 00TA3	1	0,700	-



### MANUAL SCRAPER


Material: **Wood + Metal**

Standards: **UNI 10566**

Range: **All diameters**

FIG. 612

Code	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.
00RAM1	10	-	0,140	0,0049

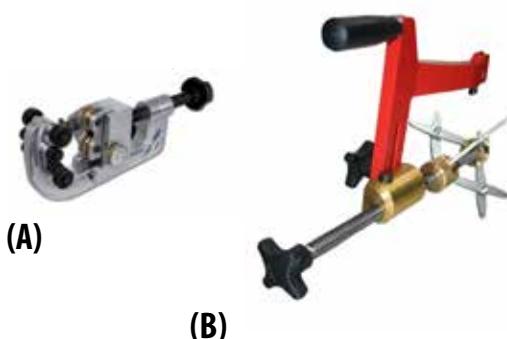

## SCRAPER

Material: **Metal**

Standards: **UNI 10566**

Range:  **$\varnothing 25 \div \varnothing 400\text{ mm}$**

FIG. 613

Code	Type	$\varnothing$	Pack.	Weight Kg/p	Volume $\text{m}^3/\text{p.}$
00RATOR25075	A - Orbital	<b><math>25 \div 75</math></b>	1		1,000
00RAT1A	B - Revolving	<b><math>75 \div 180</math></b>	1	4,800	0,0243
00RAT2A	B - Revolving	<b><math>200 \div 400</math></b>	1	8,400	0,0262
<b>SPARE BLADES FOR SCRAPERS</b>					
00RATKITRIC	<b>for 00RAT1A / 00RAT2A</b>		1	1,200	0,0030



## ALIGNER FOR ELECTROFUSION FITTINGS

Material: **Metal**

Standards: **UNI 10566**

Range:  **$\varnothing 20 \div \varnothing 400\text{ mm}$**

FIG. 614

Code	$\varnothing$	Pack.	Weight Kg/p	Volume $\text{m}^3/\text{p.}$
00ALL063/4	<b><math>20 \div 63</math></b>	1	4,800	0,0168
00ALL225/4	<b><math>50 \div 225</math></b>	1	20,800	0,0642
00ALL315/4	<b><math>225 \div 400</math></b>	1	87,000	0,3375



## WELDER WITH CASE

Material: **Metal**  
 Range:  **$\varnothing 20 \div \varnothing 32\text{ mm}$**   
 Notes: **Die pairs included**

FIG. 615

Code	$\varnothing$	Pack.	Weight Kg/p	Power supply
00NSBEP	<b><math>20 \div 32</math></b>	1	8,000	220V- 800W



## WELDER WITH SUPPORT

Material: **Metal**  
 Range:  **$\varnothing 16 \div \varnothing 63\text{ mm}$**

FIG. 616

Code	$\varnothing$	Pack.	Weight Kg/p	Power supply
00NPCC	<b><math>16 \div 63</math></b>	1	2,800	800 W



## WELDER WITH SUPPORT

Material: **Metal**  
 Range:  **$\varnothing 16 \div \varnothing 125\text{ mm}$**

FIG. 616A

Code	$\varnothing$	Pack.	Weight Kg/p	Power supply
00NPCC125	<b><math>16 \div 125</math></b>	1	4,000	1.400 W



## MALE/FEMALE DIE PAIR FOR WELDER

Material: **Metal**  
Range:  **$\varnothing 16 \div \varnothing 125 \text{ mm}$**

**FIG. 616B**

Code	$\varnothing$	Pack.	Weight Kg/p
00MATRICE16	<b>16</b>	1+1	0,100
00MATRICE20	<b>20</b>	1+1	0,110
00MATRICE25	<b>25</b>	1+1	0,150
00MATRICE32	<b>32</b>	1+1	0,230
00MATRICE40	<b>40</b>	1+1	0,330
00MATRICE50	<b>50</b>	1+1	0,480
00MATRICE63	<b>63</b>	1+1	0,630
00MATRICE75	<b>75</b>	1+1	0,920
00MATRICE90	<b>90</b>	1+1	1,400
00MATRICE110	<b>110</b>	1+1	2,340
00MATRICE125	<b>125</b>	1+1	2,220



## DRILL FOR SADDLES

Material: **Metal**  
Range:  **$\varnothing 25 \div \varnothing 32 \text{ mm}$**   
Notes: *For codes NGSF and NGS*

**FIG. 616C**

Code	$\varnothing$	Pack.	Weight Kg/p
00FGS25	<b>25</b>	1+1	0,157
00FGS32	<b>32</b>	1+1	0,226



## DIE PAIR FOR SADDLES

Material: **Metal**

Standards: **DIN 16962 - UNI EN ISO 15874**

Range:  **$\varnothing 40/25 \div \varnothing 110/32 \text{ mm}$**

Notes: **For codes NGSF and NGS**

**FIG. 616D**

Code	$\varnothing$	Pack.	Weight Kg/p
00MATGS40	<b>40/25</b>	1+1	0,200
00MATGS50	<b>50/25</b>	1+1	0,230
00MATGS63	<b>63/25</b>	1+1	0,280
00MATGS75	<b>75/25</b>	1+1	0,280
00MATGS7532	<b>75/32</b>	1+1	0,386
00MATGS90	<b>90/25</b>	1+1	0,280
00MATGS110	<b>110/25</b>	1+1	0,290
00MATGS6332	<b>63/32</b>	1+1	0,372
00MATGS9032	<b>90/32</b>	1+1	0,398
00MATGS11032	<b>110/32</b>	1+1	0,408



## MALE/FEMALE DIES FOR HOLE MENDING

Material: **Metal**

Standards: **DIN 16962 - UNI EN ISO 15874**

**FIG. 616E**

Code	$\varnothing$ holes	Pack.	Weight Kg/p
00MARP7	<b>6 max</b>	1+1	0,100
00MARP11	<b>10 max</b>	1+1	0,100



## PLASTIC TEMPLATE

Material: **Plastic**

**FIG. 626**

Code	Pack.	Weight Kg/p
00DIMAA	1	0,185



## INSTALLATION TESTING CAP

Material: **Plastic**




**FIG. 627**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	D1	D2	L
00TUN	1/2" - 3/4"	60	5.280	0,030	0,0001	1/2"	3/4"	88



## MALE THREADED INSTALLATION TESTING CAP

Material: **Plastic**

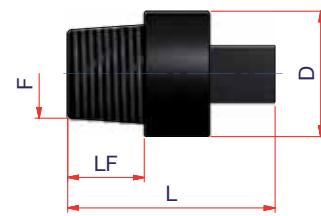

**FIG. 628**

Code	Ø	Pack.	Q.ty pallet	Weight kg/p	Volume m³/p.	F	LF	L	D
00TF12	1/2"	100	8.800	0,016	0,0001	1/2"	18,7	48	29
00TF34	3/4"	100	9.600	0,016	0,0001	3/4"	18,87	48	29



## TORQUE WRENCH FOR COMPRESSION FITTING RINGS

Material: **Plastic**

Range:  **$\varnothing 32 \div \varnothing 110\text{ mm}$**

Notes: **For compression fitting torque**

**FIG. 629**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$
00CHIAVE032	<b>32</b>	1	-	0,047	-
00CHIAVE040	<b>40</b>	1	-	0,054	-
00CHIAVE050	<b>50</b>	1	-	0,060	-
00CHIAVE063	<b>63</b>	1	-	0,067	-
00CHIAVE075	<b>75</b>	1	-	0,289	-
00CHIAVE090	<b>90</b>	1	-	0,300	-
00CHIAVE110	<b>110</b>	1	-	0,394	-



## TORQUE WRENCH KIT FOR COMPRESSION FITTING RINGS

Material: **Plastic**

Notes: **For compression fitting torque**

**FIG. 630**

Code	$\varnothing$	Pack.	Q.ty pallet	Weight kg/p	Volume $\text{m}^3/\text{p.}$
00CKIT2563	<b><math>25 \div 63</math></b>	1	-	0,400	-
00CKIT75110	<b><math>75 \div 110</math></b>	1	-	1,000	-
00CKIT25110	<b><math>25 \div 110</math></b>	1	-	1,200	-



(A)



(B)



## AUTOMATIC MULTIFUNCTION WELDING UNIT WITH BARCODE SCANNER FOR ELECTROFUSION FITTINGS

### BASIC EQUIPMENT SUPPLIED WITH THE WELDING UNIT

- Electronic user's handbook and quick guide on paper
- Software for data download
- Shipping box
- Scanner for barcode input
- Adapters with 4,7 mm pins

### ADDITIONAL EQUIPMENT

- **00USBKEY:** Software CD for data download (welding report, traceability, GPS coordinates and pressure test)
- **00GPS:** Global Positioning System (only for code 00E9001)
- **00SENS:** Pressure test unit
- **00BCSCAN:** Barcode scanner

### TECHNICAL CHARACTERISTICS

Conforms with CE requirements

Conforms with UNI 10566 – MULTIFUNCTION type

Barcode reader conforming with ISO 13950 and manual setting of time and voltage

Illuminated display with 4 lines, 20 characters each

Memory for 10000 welding cycles

8 Memories of 500 parameters each for pressure tests

Fitting working range up to 100 Amp maximum peak (00E9001) - up to 40 Amp peak (00E9001L)

Ambient temperature sensor

Power supply: 230V / 115V / 48V E 50Hz / 60Hz

Maximum power: 2.500 VA (00E9001) - 1.000 VA (00E9001L)

Output voltage: From 5 to 42 V

Power cable: L=3,8 m

Welding cable: L=3 m

Connectors - 4 mm (art. 0058305) with 4,7mm adaptors (0058203)

Dimensions: 340x450xH220 mm

Weight: 25,2 kg (00E9001) - 13,0 kg (00E9001L)

Degree of protection: IP 54

Working temperature: >From -18° to + 55°C

**FIG. 617**

Code	Type	Ø	Pack.	Weight Kg/p	Volume m <sup>3</sup> /p.	Notes
00E9001L	A	20 ÷ 160	1	13,000	0,0104	Light version
00E9001	B	20 ÷ 630	1	26,000	0,0575	With integrated Bluetooth system



## WELDING MACHINE FOR WORKBENCH


Material: **Metal**

Standards: **UNI 10566**

Range: **ø20 ÷ ø125 mm**

**FIG. 618**

Code	Ø	Pack.	Weight Kg/p	Power supply
<b>00STL90</b>	<b>20 ÷ 90</b>	<b>1</b>	<b>78,000</b>	<b>1.000 W</b>
<b>00STL125</b>	<b>25 ÷ 125</b>	<b>1</b>	<b>100,000</b>	<b>1.400 W</b>

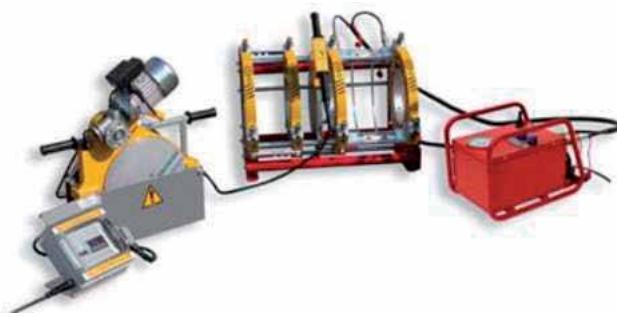

## BUTT WELDING MACHINE FOR THERMOPLASTIC PIPES AND FITTINGS

*Welding capacity:*  
from Ø 40 mm to Ø 160 mm  
from Ø 90 mm to Ø 250 mm  
from Ø 90 mm to Ø 315 mm  
Maximum pressure: 150 bar

*The butt welding machine consists of: basic machine, heating element, hydraulic unit, electric planing tool, pair of flexible hydraulic pipes, steel box for heating element and electric planing tool with reducers.*

**FIG. 619**

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Code	00S10160	00S10250	00S10315
Total dimensions of the machine complete with reducers	no. 1 shipping box 120x80x74 cm	no. 1 shipping box 120x80x74 cm	no. 1 shipping box 120x80x85 cm
Total weight of the machine complete with reducers	115,2 Kg	166,5 Kg	208,7 Kg
Maximum Absorbed Power	2,55 kW - 230 Volt - 50/60 Hz	3,05 kW - 230 Volt - 50/60 Hz	3,80 kW - 230 Volt -50/60 Hz



## BASIC MACHINE

Complete with four main jaws arranged on a slanting frame, sliding hardened chromate guides, third adjustable jaw, quick hydraulic antidrop release coupling and automatic breakaway of thermoplate.

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Dimensions	730x410x420 mm	830x520x520 mm	830x565x565 mm
Weight	39 Kg	56 Kg	65 Kg
Carriage stroke	163 mm	163 mm	163 mm
Welding capacity	40-160 mm	90-250 mm	90-315 mm
Total thrust section	353 mm <sup>2</sup>	510 mm <sup>2</sup>	510 mm <sup>2</sup>
Pipe and/or fitting material	PP-PE and other materials		



## THERMOELEMENT

PTFE covered with remote electronic adjustment of temperature, feeding cable with connector to the thermostat box.

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Voltage	230 Volt - 50/60 Hz		
Dimensions	470x400x50 mm	500x430x50 mm	500x455x50 mm
Electric power	1 kW	1,5 kW	2,5 kW
Electronic adjustment of temperature	50°C - 300°C	50°C - 300°C	50°C - 300°C
Weight	5 Kg	8 Kg	10 Kg
Welding capacity	≥160 mm	≥250 mm	≥315 mm



## HYDRAULIC UNIT

Complete with manometer - Class 1,0 (0 ÷ 160 bar - Ø 100 mm), throttle valve and drive cylinders joystick, quick hydraulic antidrop release couplings.

Type of oil	ISO 68 - 1,5 l
Manometer	class 1,0 - dimensions 100 mm - 0÷160 bar
Electric motor power	0,75 kW
Voltage	230 Volt - 50/60 Hz
Dimensions	280 x 430 x 310 mm
Pump features	cubic capacity 1,2 cm <sup>3</sup> capacity 1,58 l/min; n.rev. 1.400 r/min
Operating pressure	150 bar
Weight	25 Kg



## ELECTRIC PLANING TOOL

Equipped with positioner and safety microswitch to avoid dangerous and sudden ignitions.

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Electric motor power	0,8 kW	0,8 kW	0,55 kW
Voltage	230 Volt - 50/60 Hz		
Drive		Chain	
Dimensions	380 x 250 x 60 mm	500 x 430 x 250 mm	545 x 510 x 270 mm
Weight	8 Kg	14,2 Kg	26 kg



## PAIR OF FLEXIBLE HYDRAULIC PIPES

*Complete with quick release antidrop couplings*

Length	4 m
Weight	1,5 Kg



## STEEL BOX FOR THERMOELEMENT AND PLANING TOOL

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Dimensions	540 x 230 x 300 mm	640 x 390 x 260 mm	700 x 420 x 260 mm
Weight	7,5 Kg	9 Kg	11 kg



## TOOL FOR FLANGE WELDING

FIG. 618A

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Code	00S10160SCRT	00S10250SCRT	00S10315SCRT
Diameters	Ø 215 mm	Ø 318 mm	Ø 385 mm
Total weight	3,5 kg	7,5 Kg	10,5 kg



## LEVEL AND BEVELED REDUCER KIT

FIG. 618B

	Ø 40 ÷ 160	Ø 90 ÷ 250	Ø 90 ÷ 315
Code	00S10160KIT	00S10250KIT	00S10315KIT
Diameters	Ø 40, 50, 63, 75, 90, 110, 125 e 140 mm	Ø 90, 110, 125, 140, 160, 180, 200 e 225 mm	Ø 90, 110, 125, 140, 160, 180, 200, 225, 250 e 280 mm
Total weight	21 kg	44,6 Kg	62 kg



## LEVEL AND BEVELED REDUCERS

FIG. 618C

For welding unit Model	00S10160KIT Ø 40 ÷ 160		00S10250KIT Ø 63 ÷ 250		00S10315KIT Ø 90 ÷ 315	
	Code	Diameters	Code	Diameters	Code	Diameters
	00S10R160040	160/40	00S10R250063	250/63	00S10R250090	250/90
	00S10R160050	160/50	00S10R250075	250/75	00S10R250110	250/110
	00S10R160063	160/63	00S10R250090	250/90	00S10R250125	250/125
	00S10R160075	160/75	00S10R250110	250/110	00S10R250140	250/140
	00S10R160090	160/90	00S10R250125	250/125	00S10R250160	250/160
	00S10R160110	160/110	00S10R250140	250/140	00S10R250180	250/160
	00S10R160125	160/125	00S10R250160	250/160	00S10R250200	250/200
	00S10R160140	160/140	00S10R250180	250/160	00S10R250225	250/225
			00S10R250200	250/200	00S10R315250	315/250
			00S10R250225	250/225	00S10R315250S	315/250 blunt
					00S10R315280	315/280



## BUTT WELDING MACHINE FOR PREINSULATED FITTINGS

Material: **Metal**

Range: Ø 40 ÷ 160 mm - SDR 41-SDR 17,6  
Ø 40 ÷ 125 mm - SDR 11

Voltage: 230V - 50 Hz

Absorption: 1,6 kW - 7,2A

**Butt welding machine complete with:**

- Basic machine
- Heating element
- Hydraulic control unit
- Electric milling machine
- Hydraulic pipes
- Adapters

**FIG. 619A**

Code	Ø	Pack.	Weight Kg/p	Volume m <sup>3</sup> /p.
00S10160WA	90 ÷ 160	1	60,000	0,35



## BUTT WELDING MACHINE FOR PREINSULATED FITTINGS

Material: **Metal**

Range: Ø 90 ÷ 315 mm - SDR 41-SDR 6

Voltage: 230V - 50 Hz

Absorption: 5,14 kW – 25 A

**Butt welding machine complete with:**

- Basic machine
- Heating element
- Hydraulic control unit
- Electric milling machine
- Hydraulic pipes
- Adapters

**FIG. 619B**

Code	Ø	Pack.	Weight Kg/p	Volume m <sup>3</sup> /p.
00S10315WA	90 ÷ 315	1	33,000	0,85

# BIBLIOGRAPHY & CREDITS

- G. Menges, K. Lutterbeck - Stress Corrosion in Fiber-Reinforced Plastics in Aqueous Media, cap. 4 in Development in Reinforced Plastics - 3, edito da G.Pritchard, Elsevier Applied Science Publishers, Londra, 1984
- Selecting Plastics for Chemical Resistance Modern Plastics Encyclopedia 1985-1986, 419 G. Pritchard
- Reinforced Plastics in Anti-Corrosion Applications Seminari sui Compositi Avanzati, 24 Novembre 1987 Cranfield Institute of Technology L.T. Butt, D.C. Wright
- Use of Polymers in Chemical Plant Construction Applied Science Publishers LTD, Londra, 1980 L.T.Butt, J.Pacitti, J.R.Scott RAPRA Chemical Resistance Data Sheets
- G. Bianchi, F. Mazza, "Corrosione e Protezione dei Metalli", 3a edizione, Masson Italia Editori, Milano, 1989
- P. Pedeferrri, "Corrosione e Protezione dei Materiali Metallici", 2a edizione, CLUP, Milano, 1978
- H.H. Uhlig, "Corrosion and Corrosion Control", John Wiley & Sons Inc. 1986
- P.J. Gellings, "Introduction to Corrosion Prevention and Control for Engineers", Delft University Press, 1976
- Manuale di Progettazione Edilizia , Vol.2 "Criteri ambientali ed impianti", a cura di G.Raffellini, Ed. HOEPLI, Milano
- G. Dall'O, "Architettura e Impianti", Città Studi Edizioni, Milano
- AA.VV., "Acqua. Sistemi e dispositivi per il risparmio e il riuso", EdicomEdizioni, Monfalcone, 2002
- Erica Alberoni, Maria Roberta Brusi, Matteo Brunori, Istr024-Piano qualità PP-R – Nupigeco S.p.A.
- ASTM F 2389-10 Pressure-rated PP Piping Systems 2.1 ASTM Standards:2
- D792 Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement
- D1505 Test Method for Density of Plastics by the Density-Gradient Technique
- D1598 Test Method for Time-to-Failure of Plastic Pipe Under Constant Internal Pressure
- D1600 Terminology for Abbreviated Terms Relating to Plastics
- D2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings
- D2749 Symbols for Dimensions of Plastic Pipe Fittings
- D3895 Test Method for Oxidative-Induction Time of Polyolefins by Differential Scanning Calorimetry
- D4101 Specification for Polypropylene Injection and Extrusion Materials
- F412 Terminology Relating to Plastic Piping Systems
- F2023 Test Method for Evaluating the Oxidative Resistance of Crosslinked Polyethylene (PEX) Tubing and Systems to Hot Chlorinated Water
- 2.2 International Organization for Standardization (ISO) Standards
- ISO 3127 Thermoplastic Pipes—Determination of Resistance to External Blows—Round the Clock Method
- ISO 4065 Thermoplastics Pipes—Universal Wall Thickness Table
- UNI EN ISO 15874-1 Plastics piping system for hot and cold water installations
- Polypropylene (PP) Part 1
- UNI EN ISO 15874-2 Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 2: Pipes
- UNI EN ISO 15874-3 Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 3: Fittings
- UNI EN ISO 15874-5 Plastics piping system for hot and cold water installations
- Polypropylene (PP) Part 5: Fitness for purpose of the system
- EN ISO/TS 15874-7 Plastics Piping Systems for Hot and Cold Water Installations—Polypropylene (PP)—Part 7: Guidance for the Assessment of Conformity 3.2.3 NSF International Standards
- NSF/ANSI 14 Plastics Piping System Components and Related Materials
- NSF/ANSI 61 Drinking Water System Components—Health Effects
- DIN 1988-1 Drinking water supply systems – General (DVGW Code of practice)
- DIN 1988-2 Drinking water supply systems – Materials, components, appliances, design and installation (DVGW Code of practice)
- DIN 1988-3 Drinking water supply systems – Pipe sizing (DVGW Code of practice)
- DIN 1988-4 Drinking water supply systems – Protection of drinking water and drinking water quality control (DVGW Code of practice)
- DIN 1988-5 Drinking water supply systems – Pressure boosting and reduction (DVGW Code of practice)
- DIN 1988-6 Drinking water supply systems – Fire fighting and fire protection installations (DVGW Code of practice)
- DIN 1988-7 Drinking water supply systems – Measures to prevent corrosion and scale formation (DVGW Code of practice)
- DIN 1988-8 Drinking water supply systems – Operation (DVGW Code of practice)
- DIN 2001 Private and individual drinking water supply systems - Basic requirements for drinking water, and the design, construction and operation of systems (DVGW Code of practice)
- DIN 2425-1 Plans for public utilities, water engineering and long-distance lines – Pipework diagrams for public gas and water supply systems
- DIN 2425-3 Plans for public utilities, water engineering and long-distance lines – Plans for long-distance pipelines (DVGW Code of practice)
- DIN 2425-5 Plans for public utilities, water engineering and long-distance pipelines – Maps and plans for water engineering
- DIN 2880 Use of cement mortar linings on cast iron pipes, steel pipes and fittings
- DIN 50930-6 Corrosion behaviour of metallic materials in contact with water – Influence of the drinking water composition\*)
- EN 805 Water supply – Requirements for systems and components outside buildings
- DIN EN 1508 Water supply – Requirements for systems and components for the storage of water
- DIN EN 12502-1 Protection of metallic materials against corrosion – Corrosion likelihood in water-conveying systems – Part 1: General\*)
- DIN 4102 FIRE BEHAVIOUR PPR
- DIN 8078 Polypropylene (PP) pipes — PP-H, PP-B, PP-R, PP-RCT — General quality requirements and Testing
- ISO 4065 Thermoplastics pipes — Universal wall thickness table
- ISO 472 Plastics — Vocabulary
- ISO 1043-1 Plastics — Symbols and abbreviated terms — Part 1: Basic polymers and their special characteristics
- EN ISO 1133 Plastics Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics
- EN ISO 1167-1 Thermoplastics pipes, fittings and assemblies for the conveyance of fluids - Determination of the resistance to internal pressure - Part 1: General method
- EN ISO 1167-2 Thermoplastics pipes, fittings and assemblies for the conveyance of fluids - Determination of the resistance to internal pressure - Part 2: Preparation of pipe test pieces
- EN ISO 2505 Thermoplastics pipes - Longitudinal reversion - Test methods and parameters
- EN ISO 3126 Plastics piping systems — Plastics piping components — Measurement of dimensions
- ISO 4065 Thermoplastics pipes – Universal wall thickness table
- EN ISO 7686 Plastics piping systems Plastics pipes and fittings Determination of the opacity
- ISO 9080 Plastics piping and ducting systems Determination of the long-term hydrostatic strength of thermoplastics materials in pipe form by extrapolation
- ISO 9854-1 Thermoplastics pipes for the transport of fluids Determination of pendulum impact strength by the Charpy method Part 1: General test method
- ISO 9854-2 Thermoplastics pipes for the transport of fluids Determination of pendulum impact strength by the Charpy method Part 2: Test conditions for pipes of various materials
- EN ISO 1167-3 Thermoplastics pipes, fittings and assemblies for the conveyance of fluids - Determination of the resistance to internal pressure - Part 3
- EN ISO 1167-4 Thermoplastics pipes, fittings and assemblies for the conveyance of fluids - Determination of the resistance to internal pressure - Part 4
- EN 681-1 Elastomeric seals Materials requirements for pipe joint seals used in water and drainage applications Part 1: Vulcanized rubber
- EN 681-2 Elastomeric seals Materials requirements for pipe joint seals used in water and drainage applications Part 2: Thermoplastic elastomers
- EN 1254-3 Copper and copper alloys Plumbing fittings - Part 3: Fittings with compression ends for use with plastics pipes
- EN 10088-1 Stainless steels Part 1: List of stainless steels



EN 10226-1 Pipe threads where pressure-tight joints are made on the threads Part 1: Taper external threads and parallel internal treads — Dimensions, tolerances and designation

EN 12107 Plastics piping systems Injection-moulded thermoplastics fittings, valves and ancillary equipment Determination of long-term hydrostatic strength of thermoplastics materials for injection moulding of piping components

EN 713 Plastics piping systems Mechanical joints between fittings and polyolefin pressure pipes

EN 12294 Plastics piping systems — Systems for hot and cold water Test method for leak tightness under vacuum

ISO/FDIS 19893 Plastics piping systems — Thermoplastics pipes and fittings for hot and cold water -- Test method

ISO 19892 Plastics piping systems - Thermoplastics pipes and associated fittings for hot and cold water – Test method for resistance

UNI 9737 Classificazione e qualificazione dei saldatori di materie plastiche. Saldatori con il procedimento ad elementi termici per contatto con attrezzature meccaniche e ad elettrofusione per tubi e raccordi in polietilene per il convogliamento di gas combustibile, di acqua e di altri fluidi in pressione

UNI 10565 Saldatrici da cantiere ad elementi termici per contatto impiegati per l'esecuzione di giunzioni testa a testa in polietilene, per il trasporto di gas combustibile, di acqua e di altri fluidi in pressione

CENTR 12 108 Sistemi di tubazioni di materia plastica - Guida per l'installazione all'interno degli edifici per i sistemi di tubazioni in pressione per acqua calda e fredda destinata al consumo umano

UNI EN ISO 15494 Sistemi di tubazioni di materia plastica per applicazioni industriali - Polibutene (PB), polietilene (PE) e polipropilene (PP) - Specifiche per i componenti ed il sistema - Serie Metrica

UNI EN ISO 527-1 Determinazione delle caratteristiche a trazione - Principi generali

UNI EN ISO 527-2 Determinazione delle caratteristiche a trazione - Condizioni di prova per materie plastiche per stampaggio ed estrusione.

ISO 7-1 Pipe threads where pressure-tight joints are made on the threads - Part 1: Dimensions, tolerances and designation

ISO 179-2 Plastics - Determination of Charpy impact properties - Part 2: Instrumented impact test

ISO 228-1 Pipe threads where pressure-tight joints are not made on the threads - Part 1: Dimensions, tolerances and designation

ISO 265-1 Pipes and fittings of plastics materials - Fittings for domestic and industrial waste pipes - Basic dimensions: Metric series - Part 1: Unplasticized poly(vinyl chloride) (PVC-U)

ISO 2505-2 Thermoplastics pipes - Longitudinal reversion - Part 2: Determination parameters

ISO 3213 Polypropylene (PP) pipes - Effect of time and temperature on expected strength

ISO 6964 Polyolefin pipes and fittings - Determination of carbon black content by calcination and pyrolysis - Test method and basic specification

ISO/TR 10358 Plastics pipes and fittings - Combined chemical-resistance classification table

ISO/TR 10837 Determination of the thermal stability of polyethylene (PE) for use in gas pipes and fittings

ISO 11922-1 Thermoplastics pipes for the conveyance of fluids – Dimensions and tolerances - Part 1: Metric series

ISO 12092 Fittings, valves and other piping system components made of unplasticized poly(vinyl chloride) (PVC-U), chlorinated poly(vinylchloride) (PVC-C), acrylonitrile-butadiene-styrene (ABS) and acrylonitrile-styrene-acrylester (ASA) for pipes under pressure - Resistance to internal pressure

ISO 12162 Thermoplastics materials for pipes and fittings for pressure applications - Classification and designation - Overall service (design) coefficient

ISO 13949 Method for the assessment of the degree of pigment dispersion in polyolefin pipes, fittings and compounds

ISO 15853 Thermoplastics materials - Preparation of tubular test pieces for the determination of the hydrostatic strength of materials used for injection moulding

ISO 16135-1 Industrial valves - Ball valves of thermoplastics materials

ISO 16136-1 Industrial valves - Butterfly valves of thermoplastics materials

ISO 16138-1 Industrial valves - Diaphragm valves of thermoplastics materials

ISO 16139-1 Industrial valves - Gate valves of thermoplastics materials

ISO 21787-1 Industrial valves - Globe valves of thermoplastics materials

IEC 60364-1 Electrical installations of buildings - Part 1: Fundamental principles, assessment of general characteristics, definitions

IEC 60449 Voltage bands for electrical installations of buildings

IEC 60529 Degrees of protection provided by enclosures (IP code) (Consolidated edition including Amendment 1)

ISO 22621-5 (under preparation) Plastic piping systems for gas supply for a maximum permissible operating pressure of 2 MPa (20 bar) – Polyamide (PA)

DIN EN ISO 15512 Plastics; determination of the water content, Method B

DIN EN 12814-4 Testing of welded joints between thermoplastics; Part 4: Peeling test

DVGW VP 603 Test basis for cleaning agents and their receptacles for the preparation of welded joints between polyethylene pipes

DVS 2202-1 Defects in welded joints between thermoplastics; characteristics, description and evaluation

DVS 2203-1 Testing of welded joints between thermoplastics; test procedures – requirements

Supplement 1 Requirements in the tensile test

Supplement 2 Requirements in the tensile creep test

Supplement 3 Requirements in the technological bending test, bending angle / bending path

Supplement 4 Requirements on shear and peeling tests for sleeve welding with an incorporated heating element (HM) and heated tool sleeve welding (HD) on pipes and fittings

DVS 2203-2 Testing of welded joints between thermoplastics; test procedures – tensile test

DVS 2203-4 Testing of welded joints between thermoplastics; test procedures – tensile creep test

Supplement 1 Testing of sleeve-welded joints between pipes

Supplement 3 Testing of the resistance to slow crack growth in the full-notch creep test (FNCT)

DVS 2203-5 Testing of welded joints between thermoplastics; test procedures – technological bending test

DVS 2203-6 Testing of welded joints between thermoplastics; test procedures – testing of joints between polymeric materials

Supplement 1 Torsion shear and radial peeling tests for joints manufactured by means of sleeve welding with an incorporated heating element and heated tool sleeve welding

DVS 2208-1 Welding of thermoplastics; machines and devices for the heated tool welding of pipes, piping parts and panels

Supplement 1 – Requirements on tools and devices (under preparation)

DVS 2212-1 Qualification testing of plastics welders; Qualification Test Groups I and II

## TECHNICAL LITERATURE BY NUPIGECO STAFF

Texts, technical literature, product development: Matteo Brunori  
Standards, work flow: Erica Alberoni, Maria Roberta Brusi  
Photographs, know how: Giuseppe Matteo Rovigo  
Graphics: Silvia Leonora  
Technical data sheets: Corinna Grampa  
Graphic layout: Studio Montevercchi

N.B.: drawings, diagrams, pictures in this catalogue are property of NUPIGECO S.p.A. They shall not be reproduced, even partially, by any means. NUPIGECO adopts a policy of continuous improvement of the quality of its products and reserves the right to make any change to this catalogue without notice. NUPIGECO reserves the right to change the packaging units without notice. NUPIGECO reserves the right to modify its products without notice. Copyright NUPIGECO. All rights reserved.



# nupigeco



**Registered Office and Headquarters**  
via Stefano Ferrario  
21052 Busto Arsizio (VA) Italy  
Ph. +39 0331-344211  
Fax +39 0331-351860  
[info@nupigeco.com](mailto:info@nupigeco.com)  
[www.nupigeco.com](http://www.nupigeco.com)

**Production, Operations and Administration Centre**  
via dell'Artigianato 13  
40023 Castel Gelfo (BO) Italy  
Ph. +39 0542-624911  
Fax +39 0542-670851  
[info@nupigeco.com](mailto:info@nupigeco.com)  
[www.nupigeco.com](http://www.nupigeco.com)

**Production Facility**  
via Colombarotto 58  
40026 Imola (BO) Italy  
Ph. +39 0542-624911  
Fax +39 0542-670851  
[info@nupigeco.com](mailto:info@nupigeco.com)  
[www.nupigeco.com](http://www.nupigeco.com)

